

43201 PRADEEP KUMAR 35 YRS M 25/03/2023 CHEST PA  
DIVYANSHI HOSPITAL PVT. LTD, RAMNAGAR ROAD, FRIENDS COLONY, ETAWAH

## DIVYANSHI HOSPITAL ETAWAH

### ULTRASOUND WHOLE ABDOMEN

Patient Name	: Pradeep	UHID	: 00
Exam Date	: 25/Mar/2023	Age/Sex	: 35Y/M
Referred By	: Dr. Health chekup		

Liver normal in size 152 mm. normal in echotexture . No focal lesion is seen. IHBRs are not dilated.

Gall bladder is well distended and shows anechoic lumen. The wall thickness is normal. No evidence of any mass or calculus is seen. No pericholecystic fluid is seen.

Proximal CBD is normal in caliber.

Pancreas is partially obscured by bowel gas. Visualized portion is grossly normal in size and echotexture.

Spleen is normal in size 127 mm ,outline and echotexture.

Right kidney is normal in size 99x43mm and outline. Cortical thickness and echogenicity are normal. The CM differentiation is maintained. No obvious calculus or hydronephrosis is seen.


Left kidney is normal in size 106x45 mm and outline. Cortical thickness and echogenicity are normal. The CM differentiation is maintained. No obvious calculus or hydronephrosis is seen.

Urinary bladder appears well distended. The wall thickness is normal. No evidence of any calculus or mass lesion could be seen within the bladder or at UV junctions.

Prostate is grossly normal in size outline and echotexture

**Impression. No sonographic abnormality is seen.**

Please correlate clinically.

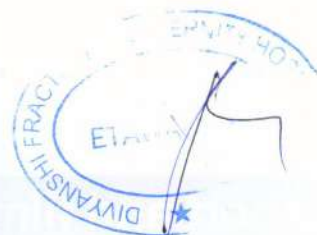

DIYANSHI HOSPITAL  
ETAWAH


PATIENT INFORMATION :-


ID:- 10351 CASE:- 328  
NAME:- PRADEEP KUMAR  
AGE:- 35Y 11M 16D GENDER:- M SMOKER:- No  
HEIGHT:- 181 cms WEIGHT:- 84 K9  
DOCTOR:- DR SHEELA PAL  
REF:- DR SHEELA PAL  
DATE/TIME:- 25/03/2023 11:31:40

ECG SETTINGS :-

PRINTING MODE:- AUTO 3\*1  
GAIN mm/mV:- 10  
SPEED mm/Sec:- 25  
FILTER Hz:- 0.05 - 35  
NOTCH/BLC:- ON/ON  
RHYTHM LEAD:- II

ALLENGERS PISCES 106 (17) VER 5.10

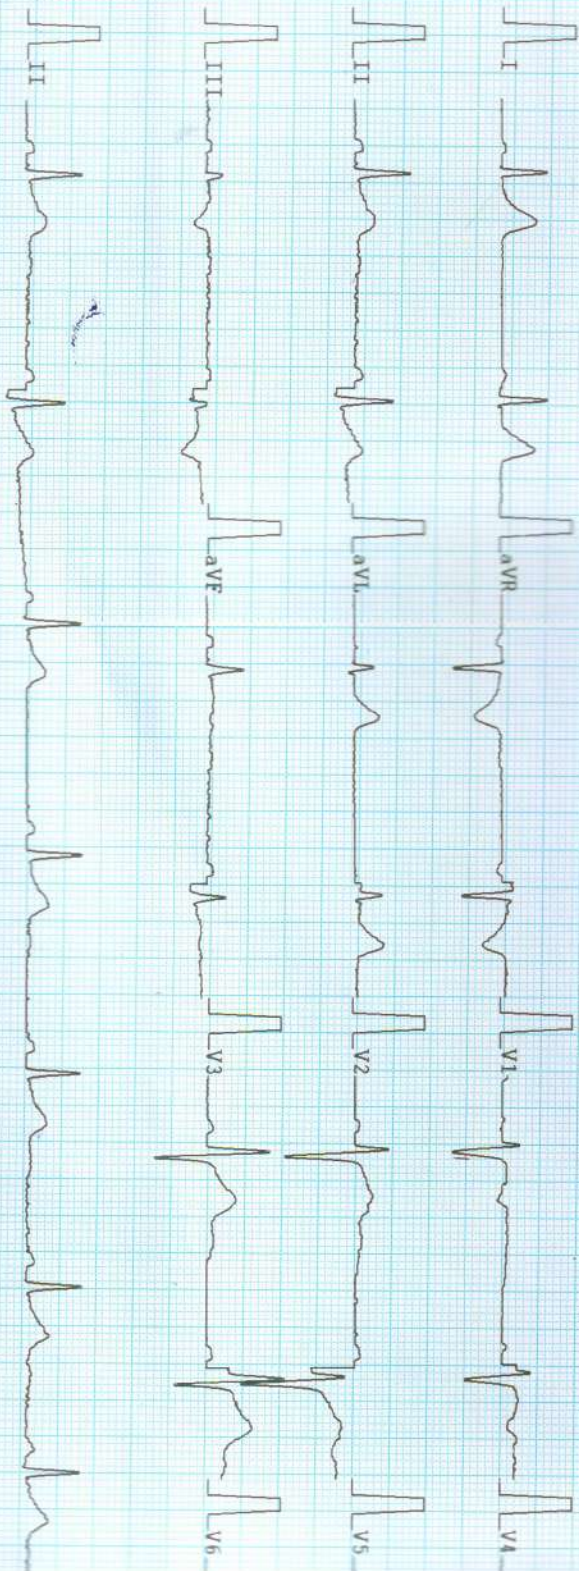

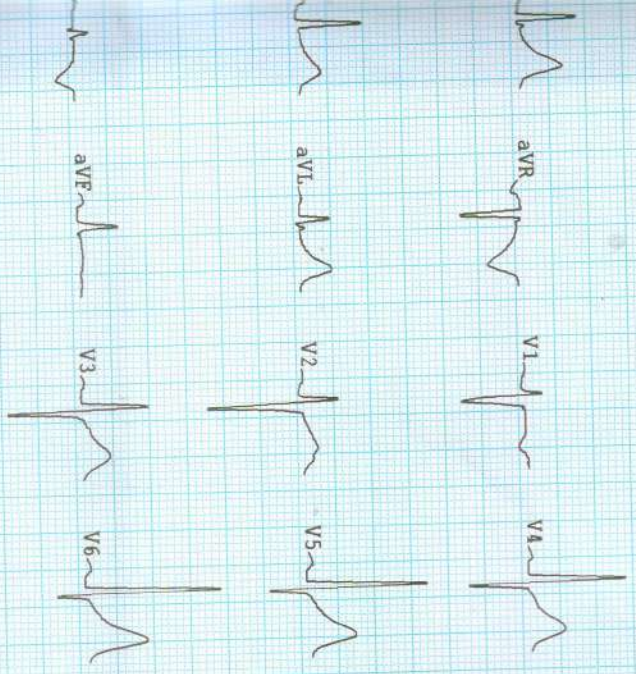


**OBSERVATIONS :-**

HEART RATE :	51 bpm
R-R	: 1155 ms
P-R	: 146 ms
P DUR	: 104 ms
QRS	: 92 ms
T DUR	: 242ms
ST DUR	: 76 ms
QT	: 410 ms
QTc	: 394 ms
P AXIS	: 46 °
R AXIS	: 39 °
T AXIS	: 03 °

REMARKS :-

**GRAPHICAL AXIS**

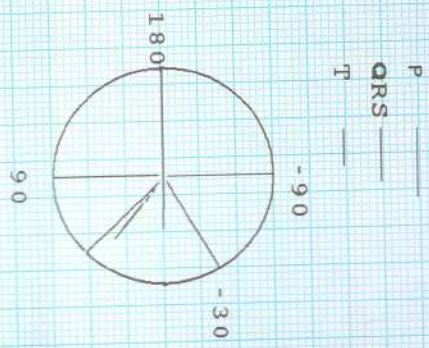

**INTERPRETATION :-**

SINUS ARRHYTHMIA  
NORMAL ECG

*[Signature]*  
Divyanshi Krasture  
Maternity Hospital Pvt. L  
Erawan

CORRELATE THE FINDINGS CLINICALLY



# DIVYANSHI FRACTURE & MATERNITY HOSPITAL PVT. LTD.



Ramnagar Road, Etawah

## PATHOLOGY REPORT

Lab. No : 4900 Date : 25/Mar/2023  
 Patient Name : Mr. PRADEEP KUMAR Guardian Name : S/O RAJENDRA SINGH  
 Age/Gender : 34.09 Years/M UHID No. : 42854 OPD No: 11099  
 Referred By : HEALTH CHECKUP Sample Date & Time : 25/Mar/2023 14:48

Test Requested : PHC PACK 5

	Observed Values	Unit	Biological Ref. Range
<b>PHC PACK 5 HEMATOLOGY</b>			
cbc	P.L.T 148	PLT	
<b>Remarks :-</b>			
ESR (Erythrocyte Sedimentation Ra	9.00	mm 1st hr.	0.00 - 15.00 mm 1st hr.
<b>Remarks :-</b>			
Hba1C	5.1	%	1. Normal = 5.6 % 2. Pre-diabetes = 5.7 ~ 6.4% 3. Diabetes = 6.5 %
<b>Remarks :-</b>			
1. Normal	-	≤ 5.6 %	
2. Pre-diabetes	-	5.7 ~ 6.4%	
3. Diabetes	-	≥ 6.5 %	
<b>BIO-CHEMISTRY</b>			
Blood Sugar (R)	108.10	Mg/dl	60.00 - 160.00 Mg/dl
<b>Remarks :-</b>			
Serum Creatinine	0.90	mg/dl	0.60 - 1.40 mg/dl
<b>Remarks :-</b>			
Blood Urea	38.1	mg/dl	15.0 - 40.0 mg/dl

Divyanshi Fracture & Maternity Path/Tech Ltd.



All Tests have technical limitations. In case of disparity, report test immediately.  
 Clinical Correlation with test is a must. Not Valid for medico legal purposes.

आधुनिक उपकरणों से सुसज्जित पूर्णतया: कम्प्यूटाइज्ड लैब



# DIVYANSHI FRACTURE & MATERNITY HOSPITAL PVT. LTD.



Ramnagar Road, Etawah

## PATHOLOGY REPORT

Lab. No : 4900 Date : 25/Mar/2023  
 Patient Name : Mr. PRADEEP KUMAR Guardian Name : S/O RAJENDRA SINGH  
 Age/Gender : 34.09 Years/M UHID No. : 42854 OPD No: 11099  
 Referred By : HEALTH CHECKUP Sample Date & Time : 25/Mar/2023 14:48

Test Requested : PHC PACK 5

	Observed Values	Unit	Biological Ref. Range
<b>KFT (Kidney Function Test)</b>			
BLOOD UREA	38.10	mg/dl	13.00 - 45.00 mg/dl
CREATINIINE	0.80	mg/dl	0.60 - 1.40 mg/dl
URIC ACID	4.30	mg/dl	3.50 - 7.20 mg/dl
B.UREA BUN	16.10	mg/dl	7.00 - 20.00 mg/dl

**Remarks :-**

**Lipid Profile**

Cholesterol, Total, Serum	179.20	mg/dl	140.00 - 250.00 mg/dl
Triglycerides, Serum	68.30	mg/dl	25.00 - 160.00 mg/dl
HDL Cholesterol, Serum	51.10	mg/dl	30.00 - 180.00 mg/dl
LDL Cholesterol, Serum	114.44	mg/dl	90.00 - 140.00 mg/dl
VLDL Cholesterol, Serum	<b>13.66</b>	mg/dl	15.00 - 32.00 mg/dl
Cholesterol-HDL Ratio	3.51		0.00 - 6.00
Cholesterol-Triglycerides Ratio	2.62		0.00 - 5.00*

**Remarks :-**

**LFT (Liver Function Test)**

<b>SERUM BILIRUBIN</b>			
Bilirubin, Total	0.74	mg/dl	0.10 - 1.20 mg/dl
Bilirubin, Direct	<b>0.43</b>	mg/dl	0.00 - 0.30 mg/dl
Bilirubin, Indirect	0.31	mg/dl	0.00 - 0.75 mg/dl
Protein, Total	7.60	g/dl	6.00 - 8.30 g/dl
Albumin	4.30	g/dl	3.20 - 5.00 g/dl
Globulin	3.30	g/dl	2.00 - 3.50 g/dl
Albumin-globulin Ratio	1.20	g/dl	1.00 - 1.50 g/dl

Divyanshi Fracture & Maternity Hospital Pvt. Ltd. Path/Tech



All Tests have technical limitations. Clinical Correlation with test is a must.

In case of disparity, report test immediately Not Valid for medico legal purposes.

आधुनिक उपकरणों से सुसज्जित पूर्णतया: कम्प्यूटराइज्ड लैब



# DIVYANSHI FRACTURE & MATERNITY HOSPITAL PVT. LTD.



Ramnagar Road, Etawah

## PATHOLOGY REPORT

Lab. No : 4900 Date : 25/Mar/2023  
 Patient Name : Mr. PRADEEP KUMAR Guardian Name : S/O RAJENDRA SINGH  
 Age/Gender : 34.09 Years/M UHID No. : 42854 OPD No: 11099  
 Referred By : HEALTH CHECKUP Sample Date & Time : 25/Mar/2023 14:48

Test Requested : PHC PACK 5

	Observed Values	Unit	Biological Ref. Range
SGPT/ALT	34.10	U/L	0.00 - 40.00 U/L
SGOT/AST	32.10	IU/L	5.00 - 35.00 IU/L
Alkaline Phosphatase	89.60	IU/L	15.00 - 112.00 IU/L

Remarks :-

### CLINICAL PATHOLOGY

Urine Albumin Absent

Remarks :-

### URINE EXAMINATION

Urine R/M

#### PHYSICAL EXAMINATION

Volume 10 ML ml  
 Colour White  
 Appearance Clear  
 Sediment Absent  
 Specific Gravity 1.015

#### CHEMICAL EXAMINATION

Ph Acidic  
 Sugar Absent  
 Albumin Absent  
 Ketone Bodies Absent  
 Bile Salts Absent  
 Bile Pigment Absent  
 Urobilinogen Absent  
 Occult Blood Absent

#### MACROSCOPICAL EXAMINATION

Epithelial Cell 2-4  
 Pus Cell 2-3

*Dr. Divyanshi*  
 Divyanshi Fracture & Maternity Hospital Pvt. Ltd.  
 Path/Tech 5  
 Etawah



All Tests have technical limitations. In case of disparity, report test immediately  
 Clinical Correlation with test is a must. Not Valid for medico legal purposes.

आधुनिक उपकरणों से सुसज्जित पूर्णतया: कम्प्यूटराइज्ड लैब



# DIVYANSHI FRACTURE & MATERNITY HOSPITAL PVT. LTD.



Ramnagar Road, Etawah

## PATHOLOGY REPORT

Lab. No : 4900 Date : 25/Mar/2023  
Patient Name : Mr. PRADEEP KUMAR Guardian Name : S/O RAJENDRA SINGH  
Age/Gender : 34.09 Years/M UHID No. : 42854 OPD No: 11099  
Referred By : HEALTH CHECKUP Sample Date & Time : 25/Mar/2023 14:48

Test Requested : PHC PACK 5

	Observed Values	Unit	Biological Ref. Range
RBC	Absent		
Bacteria	Absent		
Casts	Absent		
Others	Absent		

Remarks :-

### HORMONAL ASSAY

T3 1.78 nmol/L 1.30 - 3.10 nmol/L

Remarks :-

1. Normal - 1.3 - 3.1 nmol/L

T4 9.24 ug/dL 5.74 - 13.03 ug/dL

Remarks :-

1. Normal - 5.74 - 13.03 pmol/L

Divyanshi Fracture &  
Maternity Hospital Pvt. Ltd.  
Patho-Tech  
Etawah



All Tests have technical limitations. In case of disparity, report test immediately  
Clinical Correlation with test is a must. Not Valid for medico legal purposes.

आधुनिक उपकरणों से सुसज्जित पूर्णतया: कम्प्यूटराइज्ड लैब





# DIVYANSHI FRACTURE & MATERNITY HOSPITAL PVT. LTD.



Ramnagar Road, Etawah

## PATHOLOGY REPORT

Lab. No : 4900	Date : 25/Mar/2023
Patient Name : Mr. PRADEEP KUMAR	Guardian Name : S/O RAJENDRA SINGH
Age/Gender : 34.09 Years/M	UHID No. : 42854 OPD No: 11099
Referred By : HEALTH CHECKUP	Sample Date & Time : 25/Mar/2023 14:48

Test Requested : PHC PACK 5

	Observed Values	Unit	Biological Ref. Range
TSH (Thyroid Stimulating Hormone)	1.84	mIU/L	Adults Euthyroid : 0.44 - 3.45 uu/ml Suggestive of Hyperthyroidism : <0.44 uu/ml Suggestive of Hypothyroid : >3.45 uu/ml Additional tests of Hypothyroidism : FT3 and FT4 Additional tests of Hypothyroidism : FT4 Note: Please allow a period of 4-6 weeks for a repeat sample after any DOSE ADJUSTMENTS (or Irregularity of dose/ Skipping of Dose) Children upto 18 years should be referred to the Pediatric reference range. Clinically non correlating samples are suggested to perform free hormone estimation.

**Remarks :-**

1. Normal - 0.45 to 4.5 mIU/L
2. Level Below - 0.45 mIU/L indicative of hyperthyroidism
3. Level Above - 4.5 mIU/L Indicative of hypothyroidism

\*\* End of Report \*\*

Divyanshi Fracture & Maternity Hospital Pvt. Ltd.  
Path/Tech



All Tests have technical limitations. In case of disparity, report test immediately  
Clinical Correlation with test is a must. Not Valid for medico legal purposes.

आधुनिक उपकरणों से सुसज्जित पूर्णतया: कम्प्यूटराइज्ड लैब



# DIVYANSHI FRACTURE & MATERNITY HOSPITAL PVT. LTD.



Ramnagar Road, Etawah

## PATHOLOGY REPORT

### Report

Sample ID: 8      Sample Type:      Mode: OV-WB-CBC+5DIFF  
 Test Time: 25/Mar/2023 4:38 PM      Inst: Hematology Hematology  
 Name: PRADEEP KUMAR      Patient ID:  
 Gender: Male      Dept.: HEALTH CHEKUP      Diagnosis:  
 Age: 35 Year      Bed No.:  
 Comments:

Parameter		Result	Unit	Ref.range	
WBC	R	6.14	10 <sup>9</sup> /L	4.00-10.00	WBC Flag
Neu#	R	3.79	10 <sup>9</sup> /L	2.00-7.00	WBC Abn.
Lym#	R	1.72	10 <sup>9</sup> /L	0.80-4.00	
Mon#	R	0.40	10 <sup>9</sup> /L	0.12-1.20	
Eos#	R	0.23	10 <sup>9</sup> /L	0.02-0.50	
Bas#	R	0.00	10 <sup>9</sup> /L	0.00-0.10	
Neu%	R	61.6	%	50.0-70.0	
Lym%	R	28.0	%	20.0-40.0	
Mon%	R	6.5	%	3.0-12.0	RBC Flag
Eos%	R	3.9	%	0.5-5.0	
Bas%	R	0.0	%	0.0-1.0	
RBC		5.28	10 <sup>12</sup> /L	4.00-5.50	
HGB		14.7	g/dL	12.0-16.0	
HCT		51.2	%	40.0-54.0	
MCV		96.9	fL	80.0-100.0	
MCH		27.9	pg	27.0-34.0	
MCHC	L	28.8	g/dL	32.0-36.0	PLT Flag
RDW-CV		13.4	%	11.0-16.0	
RDW-SD		43.8	fL	35.0-56.0	
PLT		148	10 <sup>9</sup> /L	100-300	
MPV	H	14.4	fL	6.5-12.0	
PDW		16.6		9.0-17.0	
PCT		0.214	%	0.108-0.282	
P-LCC		82	10 <sup>9</sup> /L	30-90	
P-LCR	H	55.7	%	11.0-45.0	

LAS DIFF

WBC

Divyanshi Fracture & Maternity Hos

Path/ Tech



All Tests have technical limitations. Clinical Correlation with test is a must. In case of disparity, report test immediately. Not Valid for medico legal purposes.

आधुनिक उपकरणों से सुसज्जित पूर्णतया: कम्प्यूटराइज्ड लैब

RBC


PLT



120 / PRADEEP KUMAR / 35 Yrs / M / 181 Cms / 84 Kg / HR : 60

Date: 25-Mar-2023 12:57:16 PM METS: 1.1/ 60 bpm 32% of THR BP: 125/80 mmHg Raw ECG/ BLC On/ Notch On/ HF 0.05 Hz/LF 35 Hz

ExTime: 00:00 1.7 mph, 10.0%

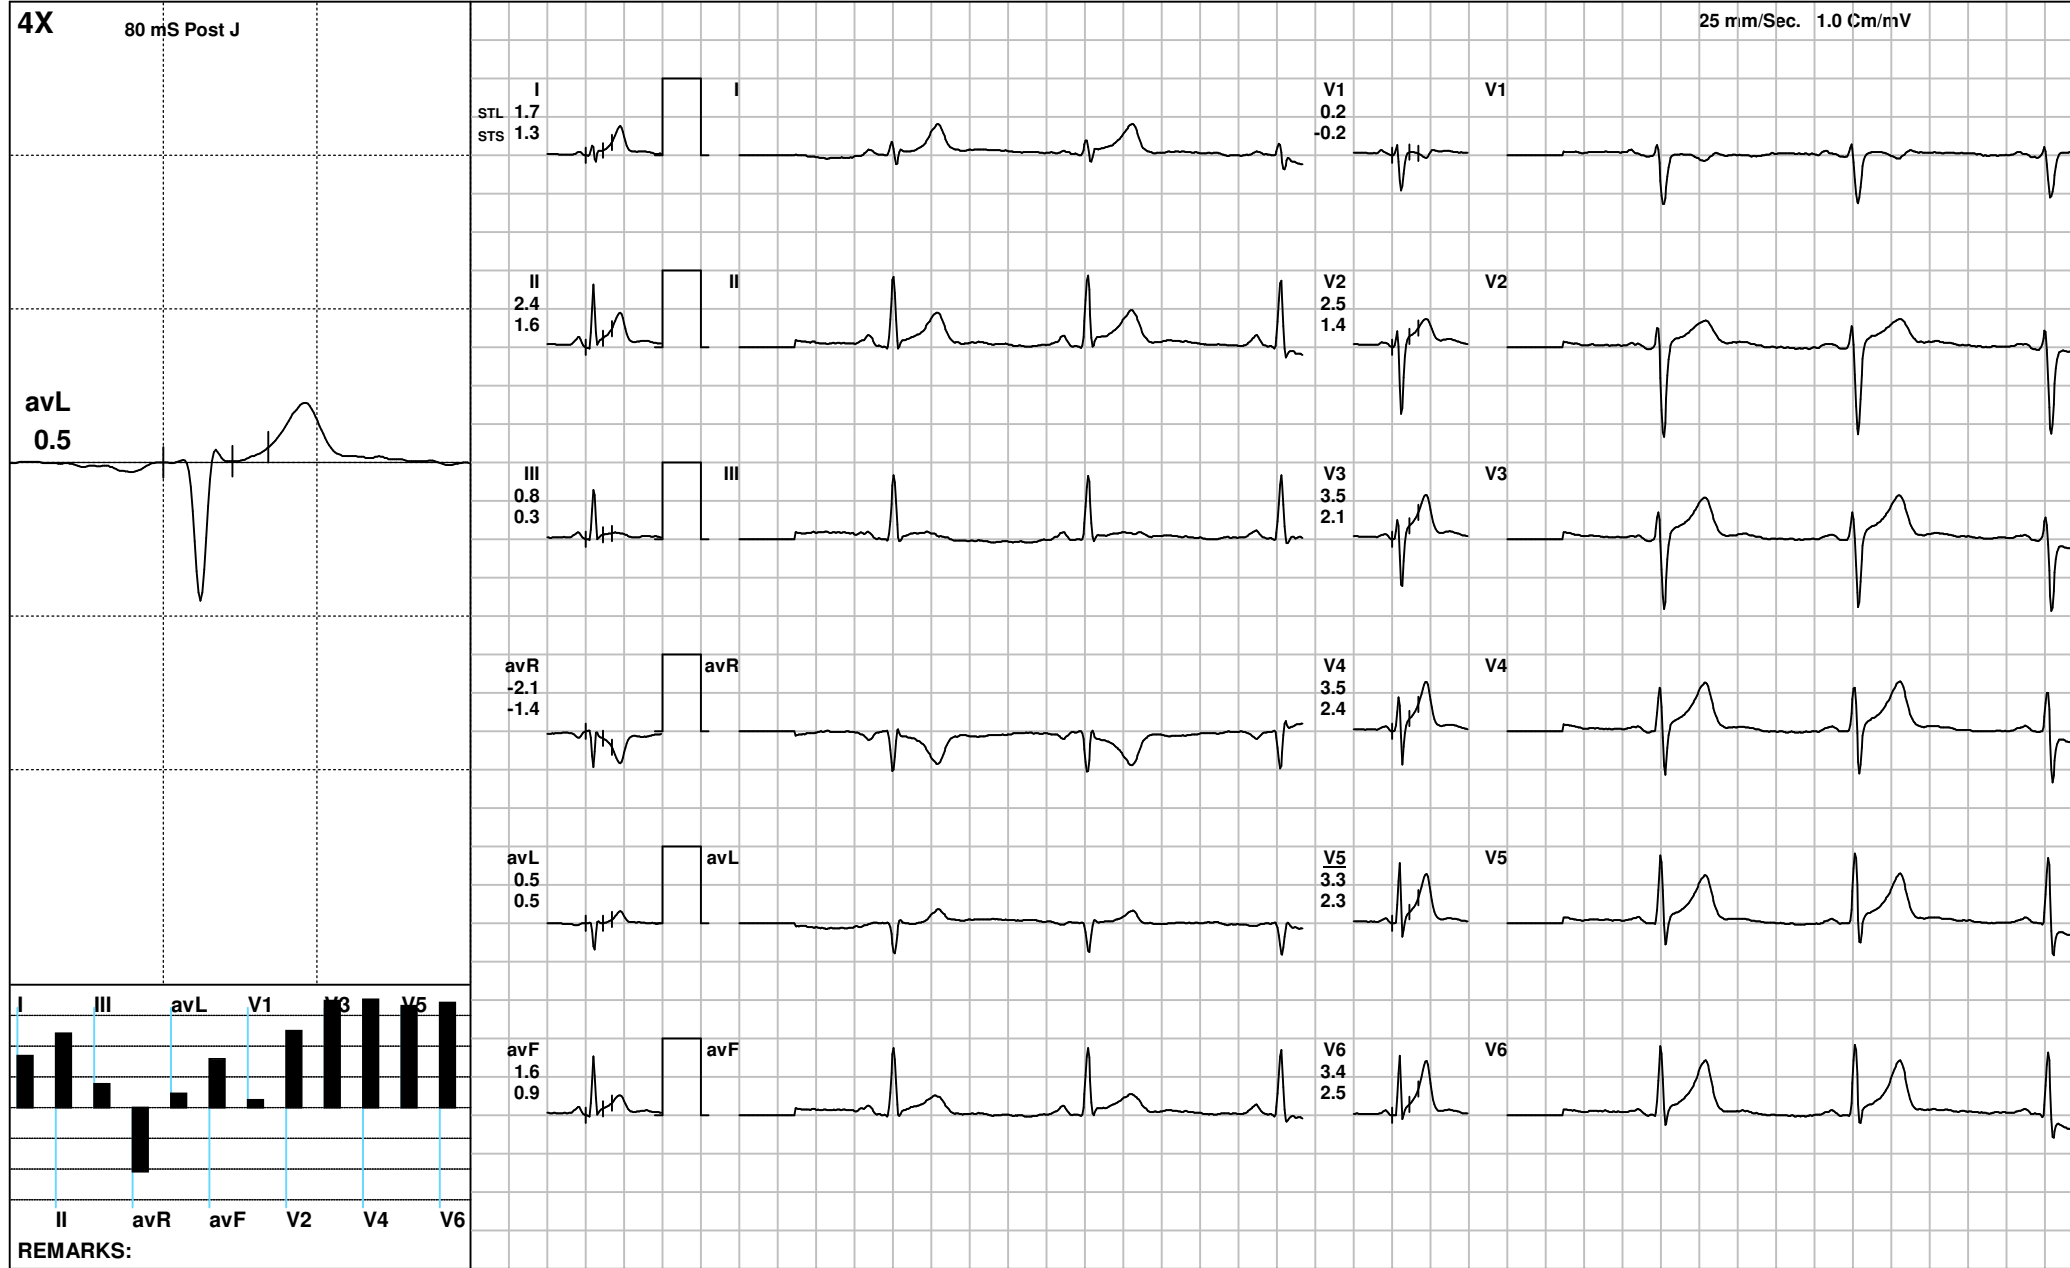




120 / PRADEEP KUMAR / 35 Yrs / M / 181 Cms / 84 Kg / HR : 122

Date: 25-Mar-2023 12:57:16 PM METS: 4.7/ 122 bpm 66% of THR BP: 128/81 mmHg Raw ECG/ BLC On/ Notch On/ HF 0.05 Hz/LF 35 Hz

ExTime: 03:00 1.7 mph, 10.0%

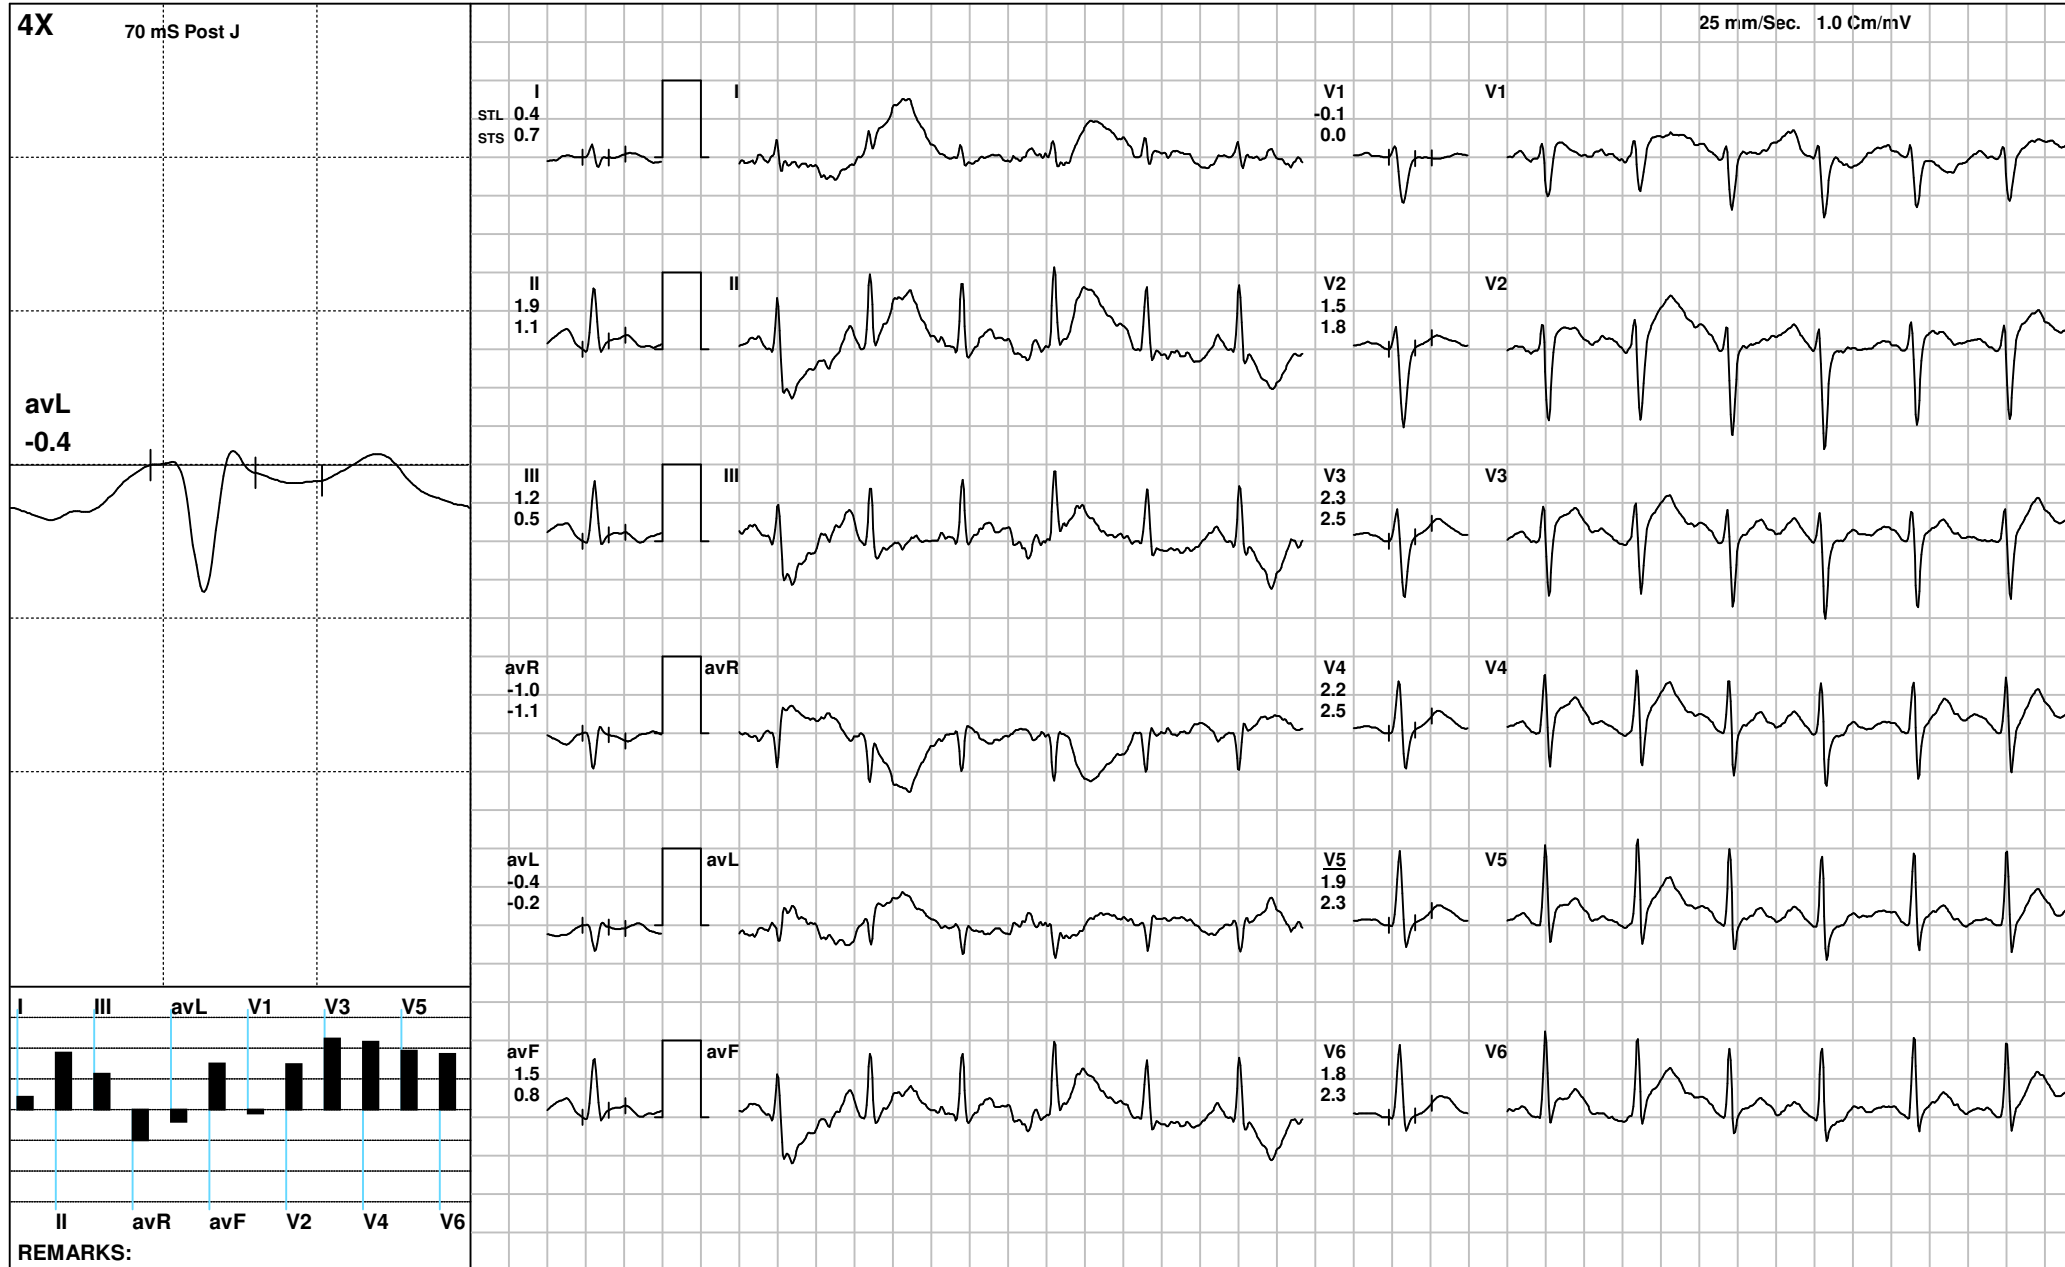




120 / PRADEEP KUMAR / 35 Yrs / M / 181 Cms / 84 Kg / HR : 149

Date: 25-Mar-2023 12:57:16 PM METS: 7.1/ 149 bpm 81% of THR BP: 132/85 mmHg Raw ECG/ BLC On/ Notch On/ HF 0.05 Hz/LF 35 Hz

ExTime: 06:00 2.5 mph, 12.0%

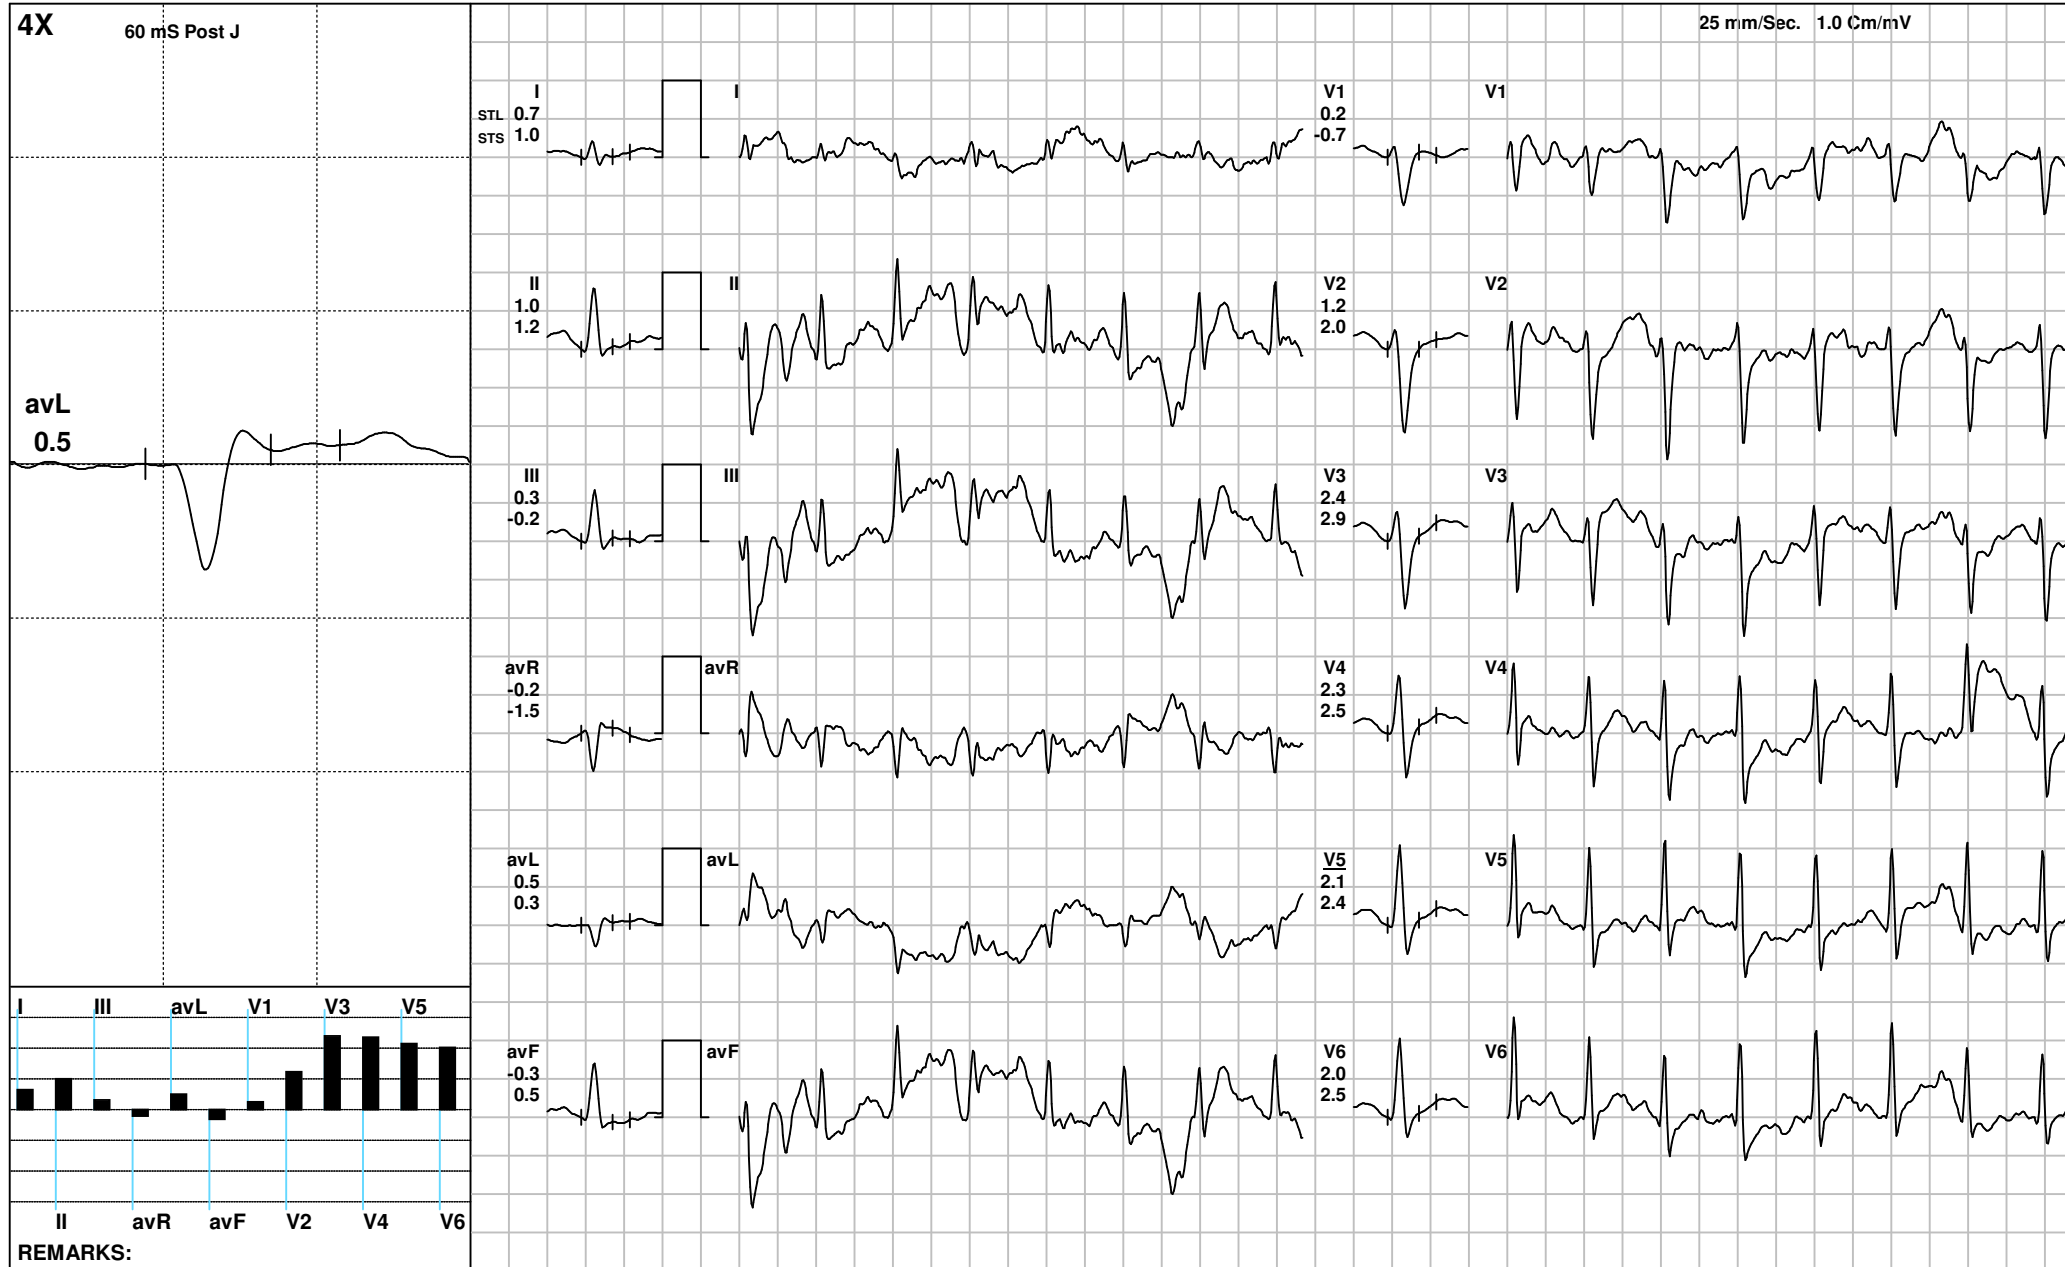



120 / PRADEEP KUMAR / 35 Yrs / M / 181 Cms / 84 Kg / HR : 157

Date: 25-Mar-2023 12:57:16 PM METS: 7.8/ 157 bpm 85% of THR BP: 135/86 mmHg Raw ECG/ BLC On/ Notch On/ HF 0.05 Hz/LF 35 Hz

ExTime: 06:40 3.4 mph, 14.0%






120 / PRADEEP KUMAR / 35 Yrs / M / 181 Cms / 84 Kg / HR : 152

Date: 25-Mar-2023 12:57:16 PM METS: 4.2/ 152 bpm 82% of THR BP: 134/85 mmHg Raw ECG/ BLC On/ Notch On/ HF 0.05 Hz/LF 35 Hz

ExTime: 06:40 0.0 mph, 0.0%

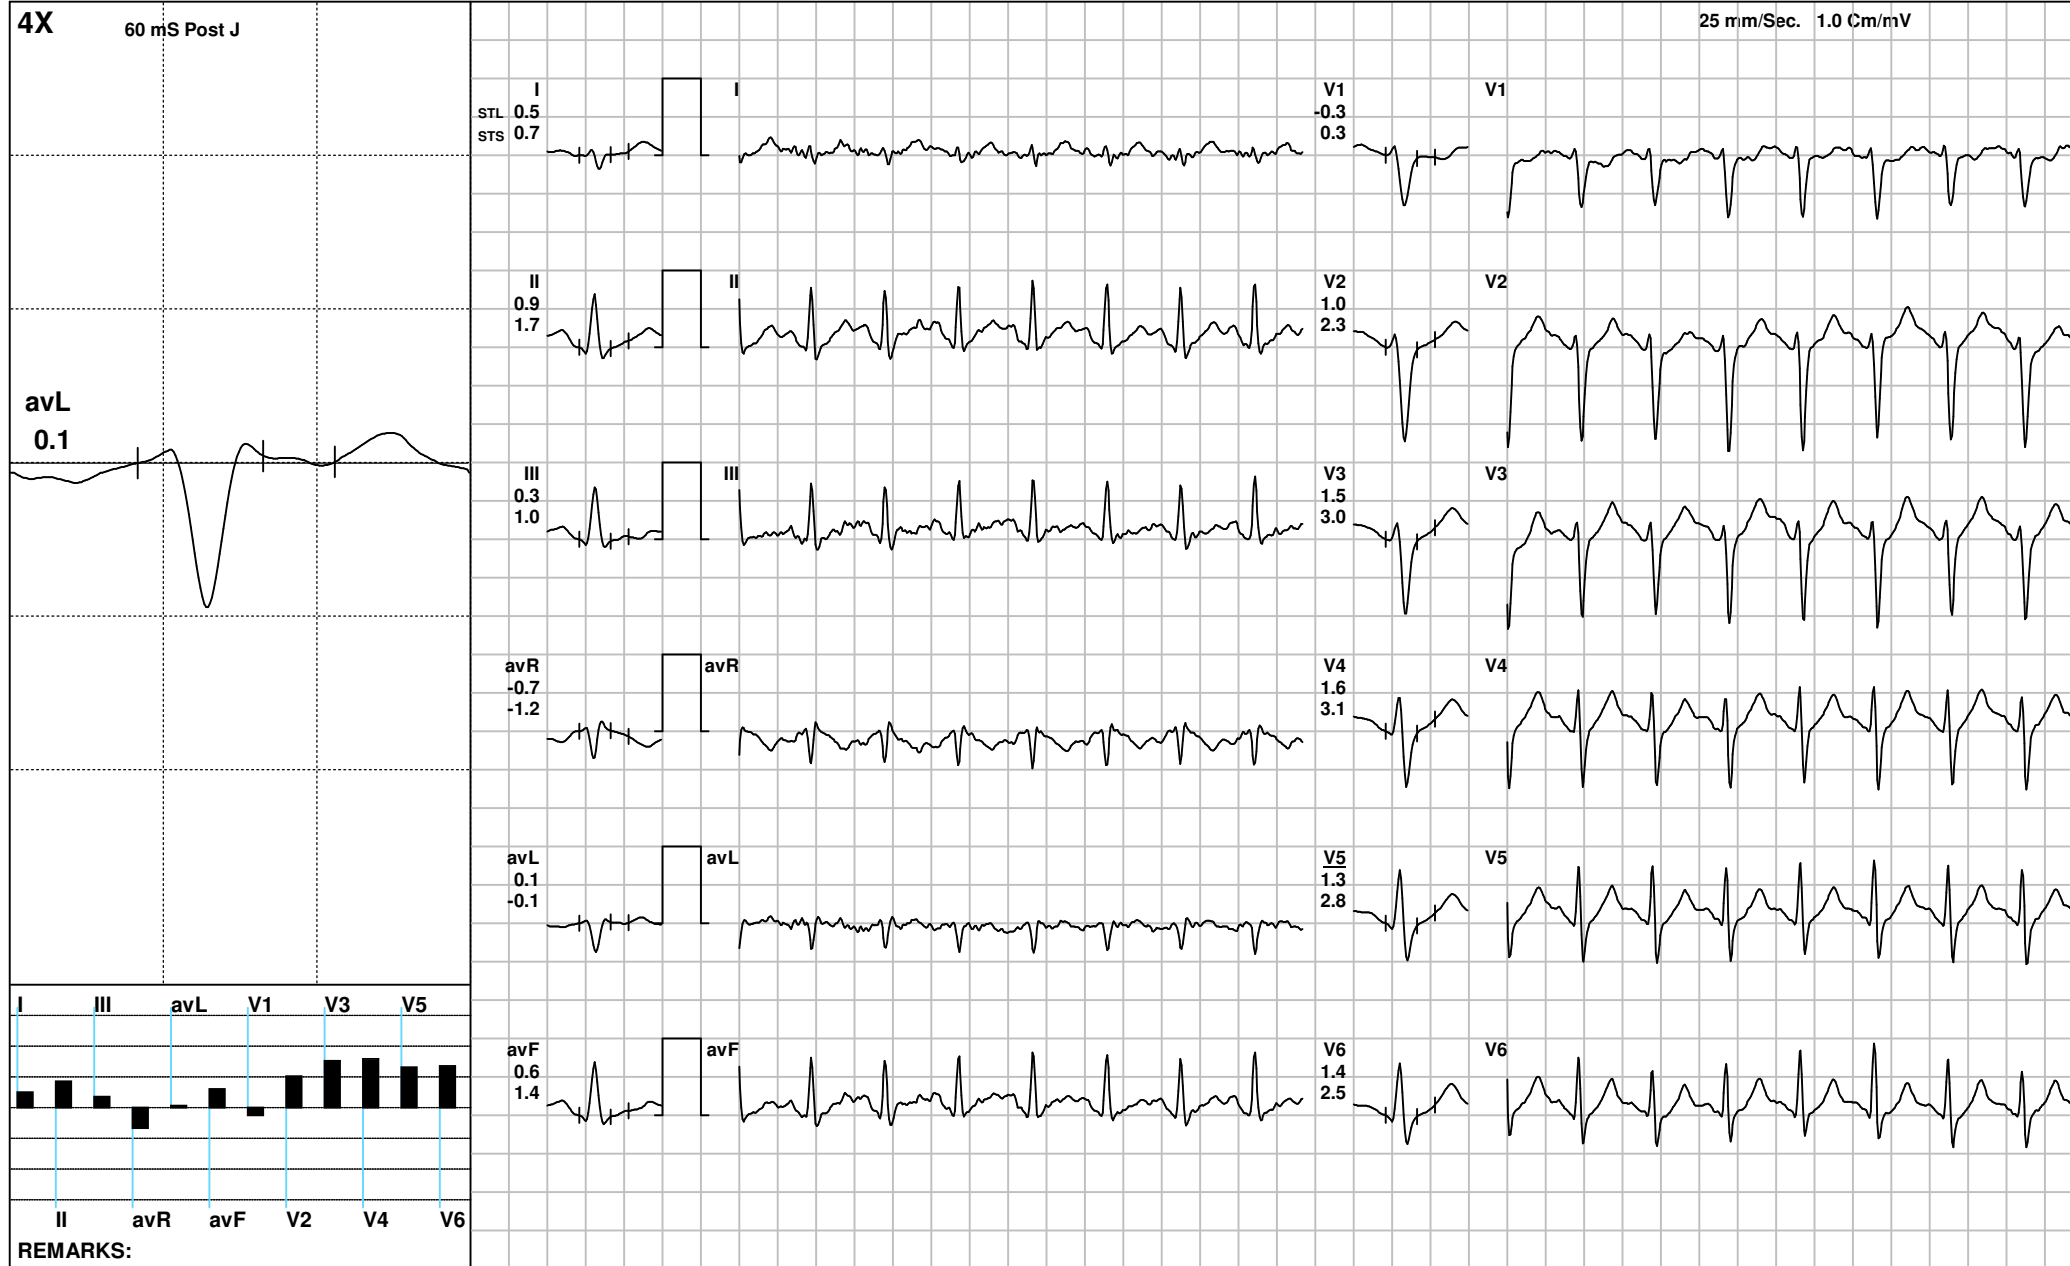




120 / PRADEEP KUMAR / 35 Yrs / M / 181 Cms / 84 Kg / HR : 146

Date: 25-Mar-2023 12:57:16 PM METS: 1.2/ 146 bpm 79% of THR BP: 132/83 mmHg Raw ECG/ BLC On/ Notch On/ HF 0.05 Hz/LF 35 Hz

ExTime: 06:40 0.0 mph, 0.0%

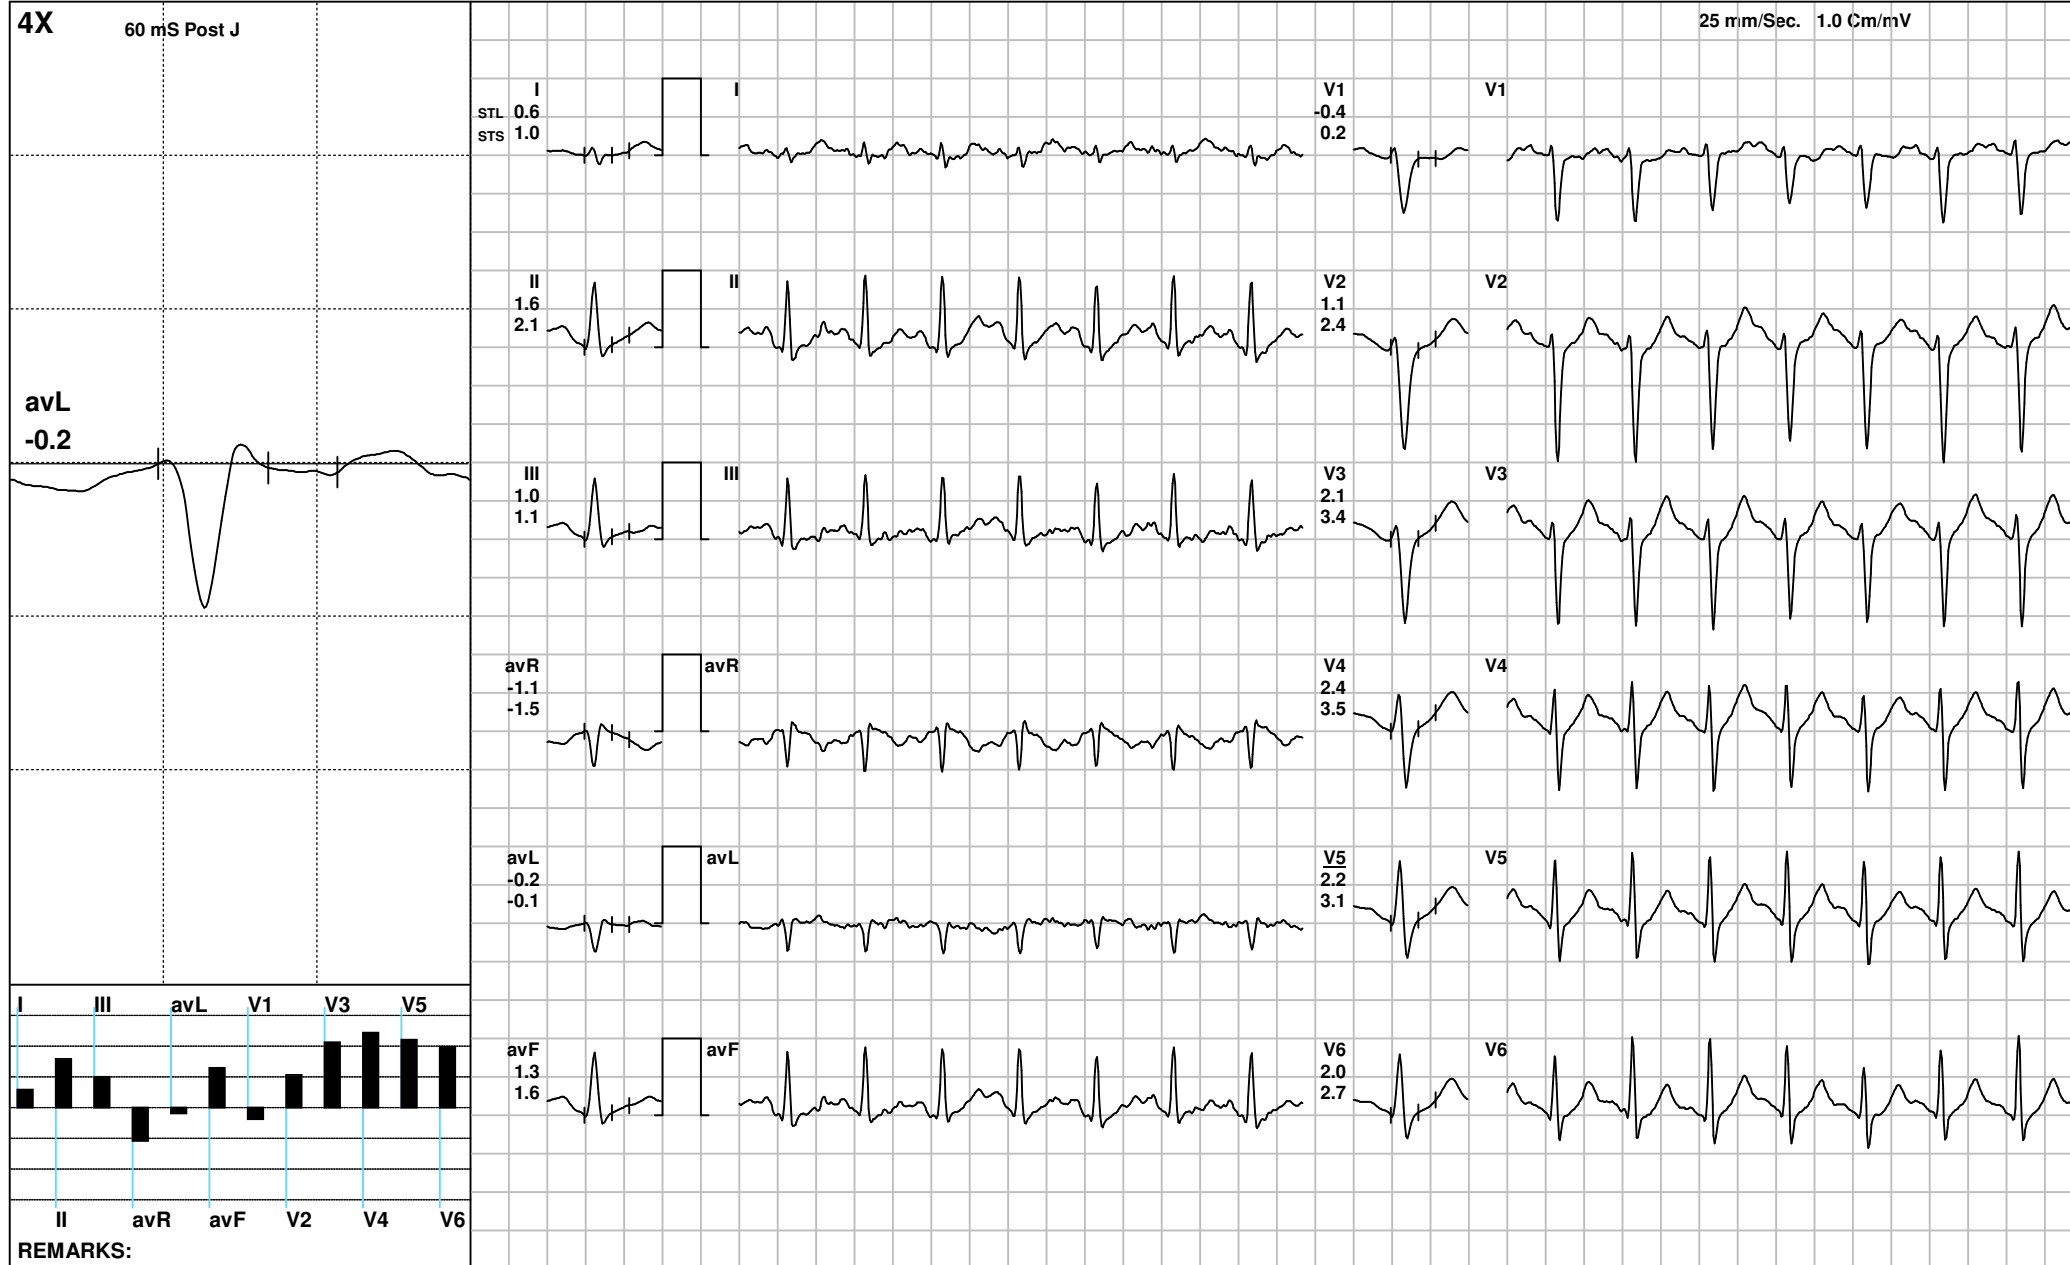






120 / PRADEEP KUMAR / 35 Yrs / M / 181 Cms / 84 Kg / HR : 127

Date: 25-Mar-2023 12:57:16 PM METS: 1.0/ 127 bpm 69% of THR BP: 130/82 mmHg Raw ECG/ BLC On/ Notch On/ HF 0.05 Hz/LF 35 Hz

ExTime: 06:40 0.0 mph, 0.0%

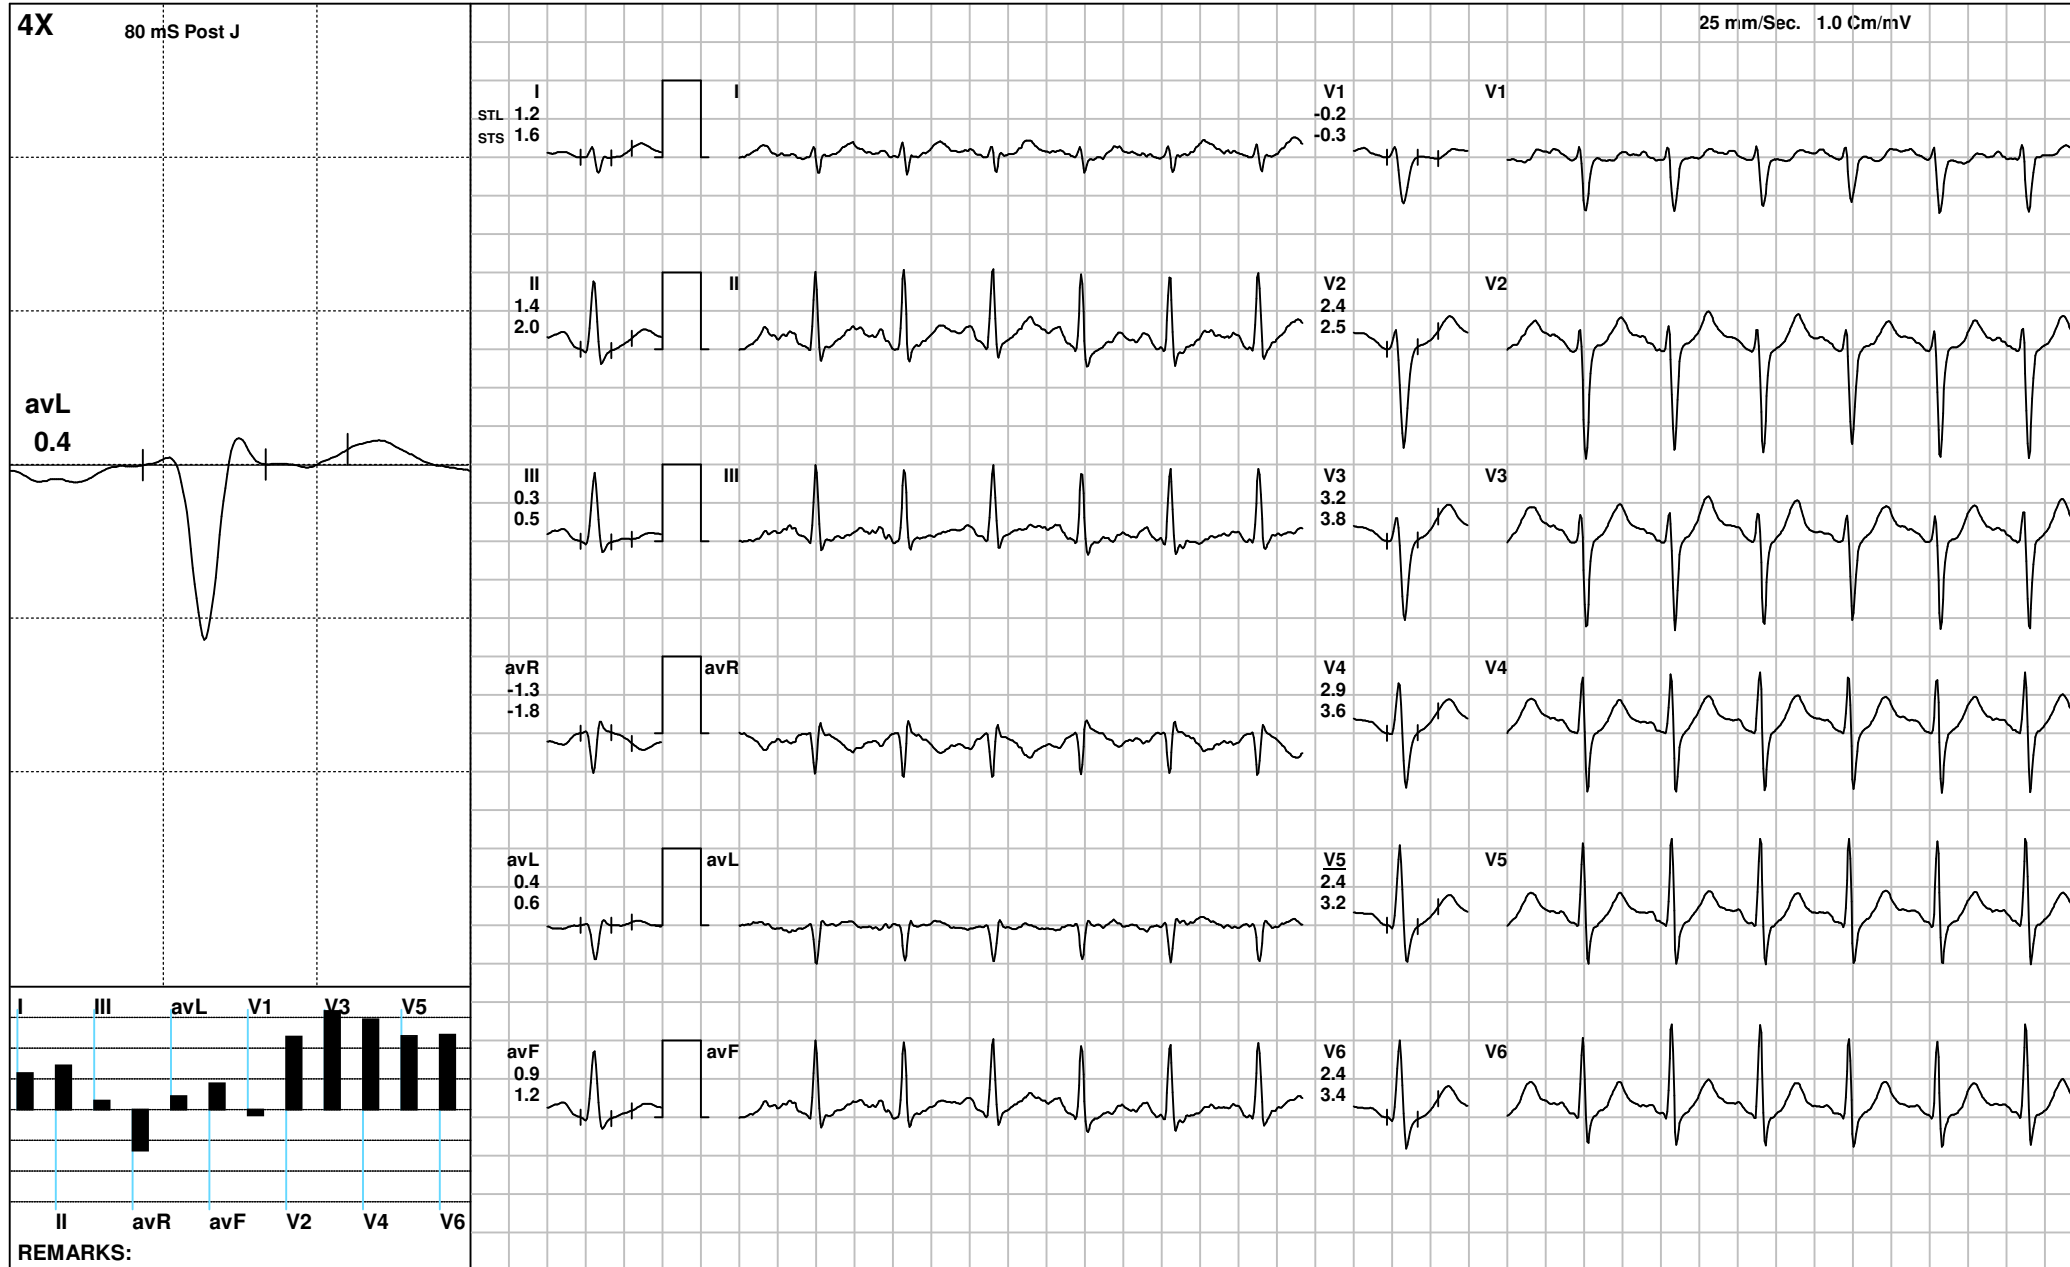




120 / PRADEEP KUMAR / 35 Yrs / M / 181 Cms / 84 Kg / HR : 117

Date: 25-Mar-2023 12:57:16 PM METS: 1.0/ 117 bpm 63% of THR BP: 128/82 mmHg Raw ECG/ BLC On/ Notch On/ HF 0.05 Hz/LF 35 Hz

ExTime: 06:40 0.0 mph, 0.0%

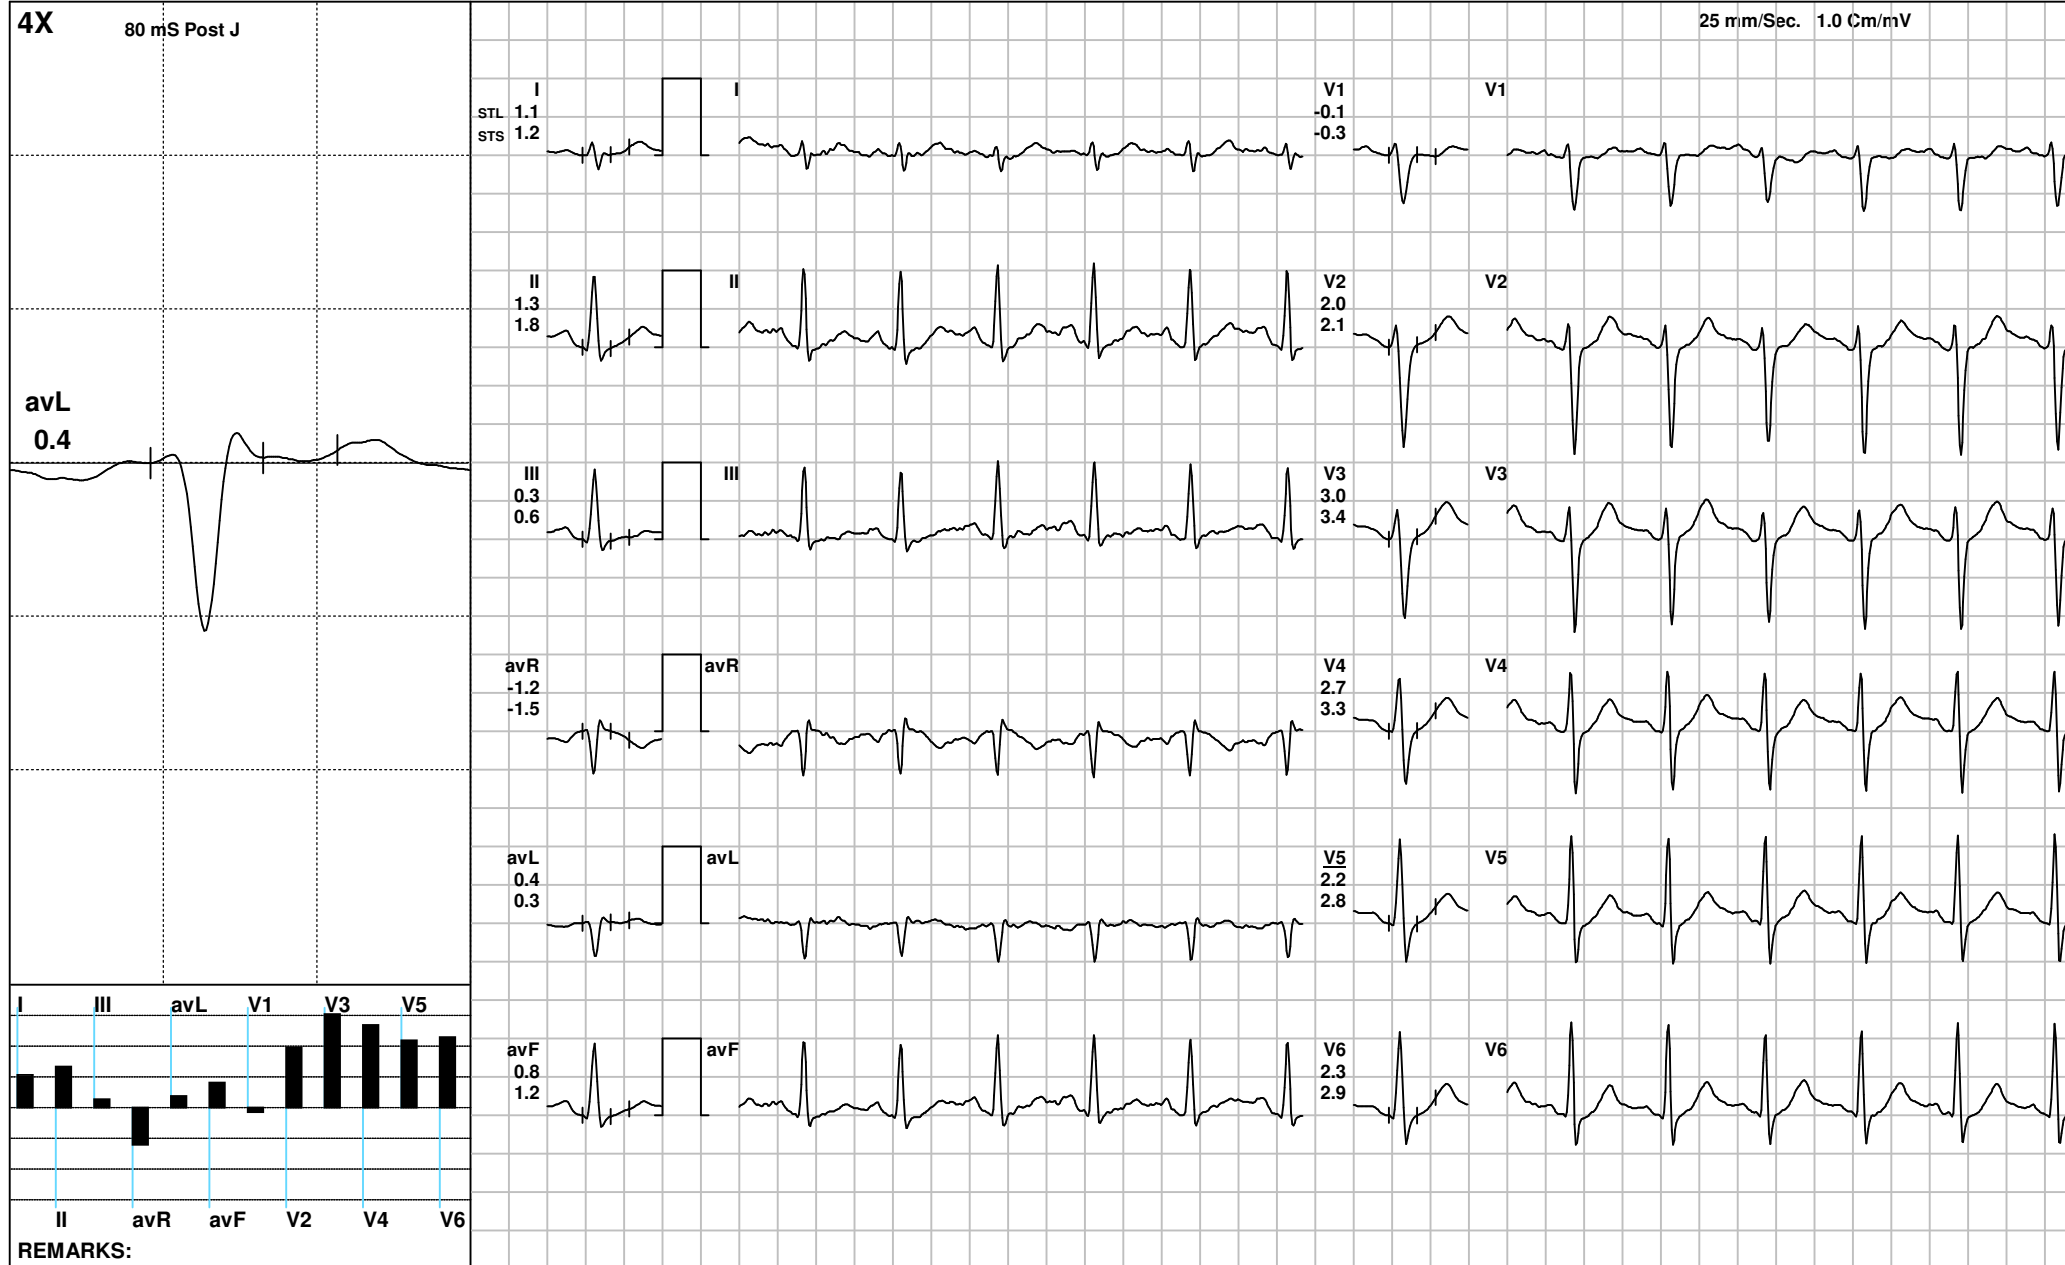




120 / PRADEEP KUMAR / 35 Yrs / M / 181 Cms / 84 Kg / HR : 113

Date: 25-Mar-2023 12:57:16 PM METS: 1.0/ 113 bpm 61% of THR BP: 126/80 mmHg Raw ECG/ BLC On/ Notch On/ HF 0.05 Hz/LF 35 Hz

ExTime: 06:40 0.0 mph, 0.0%

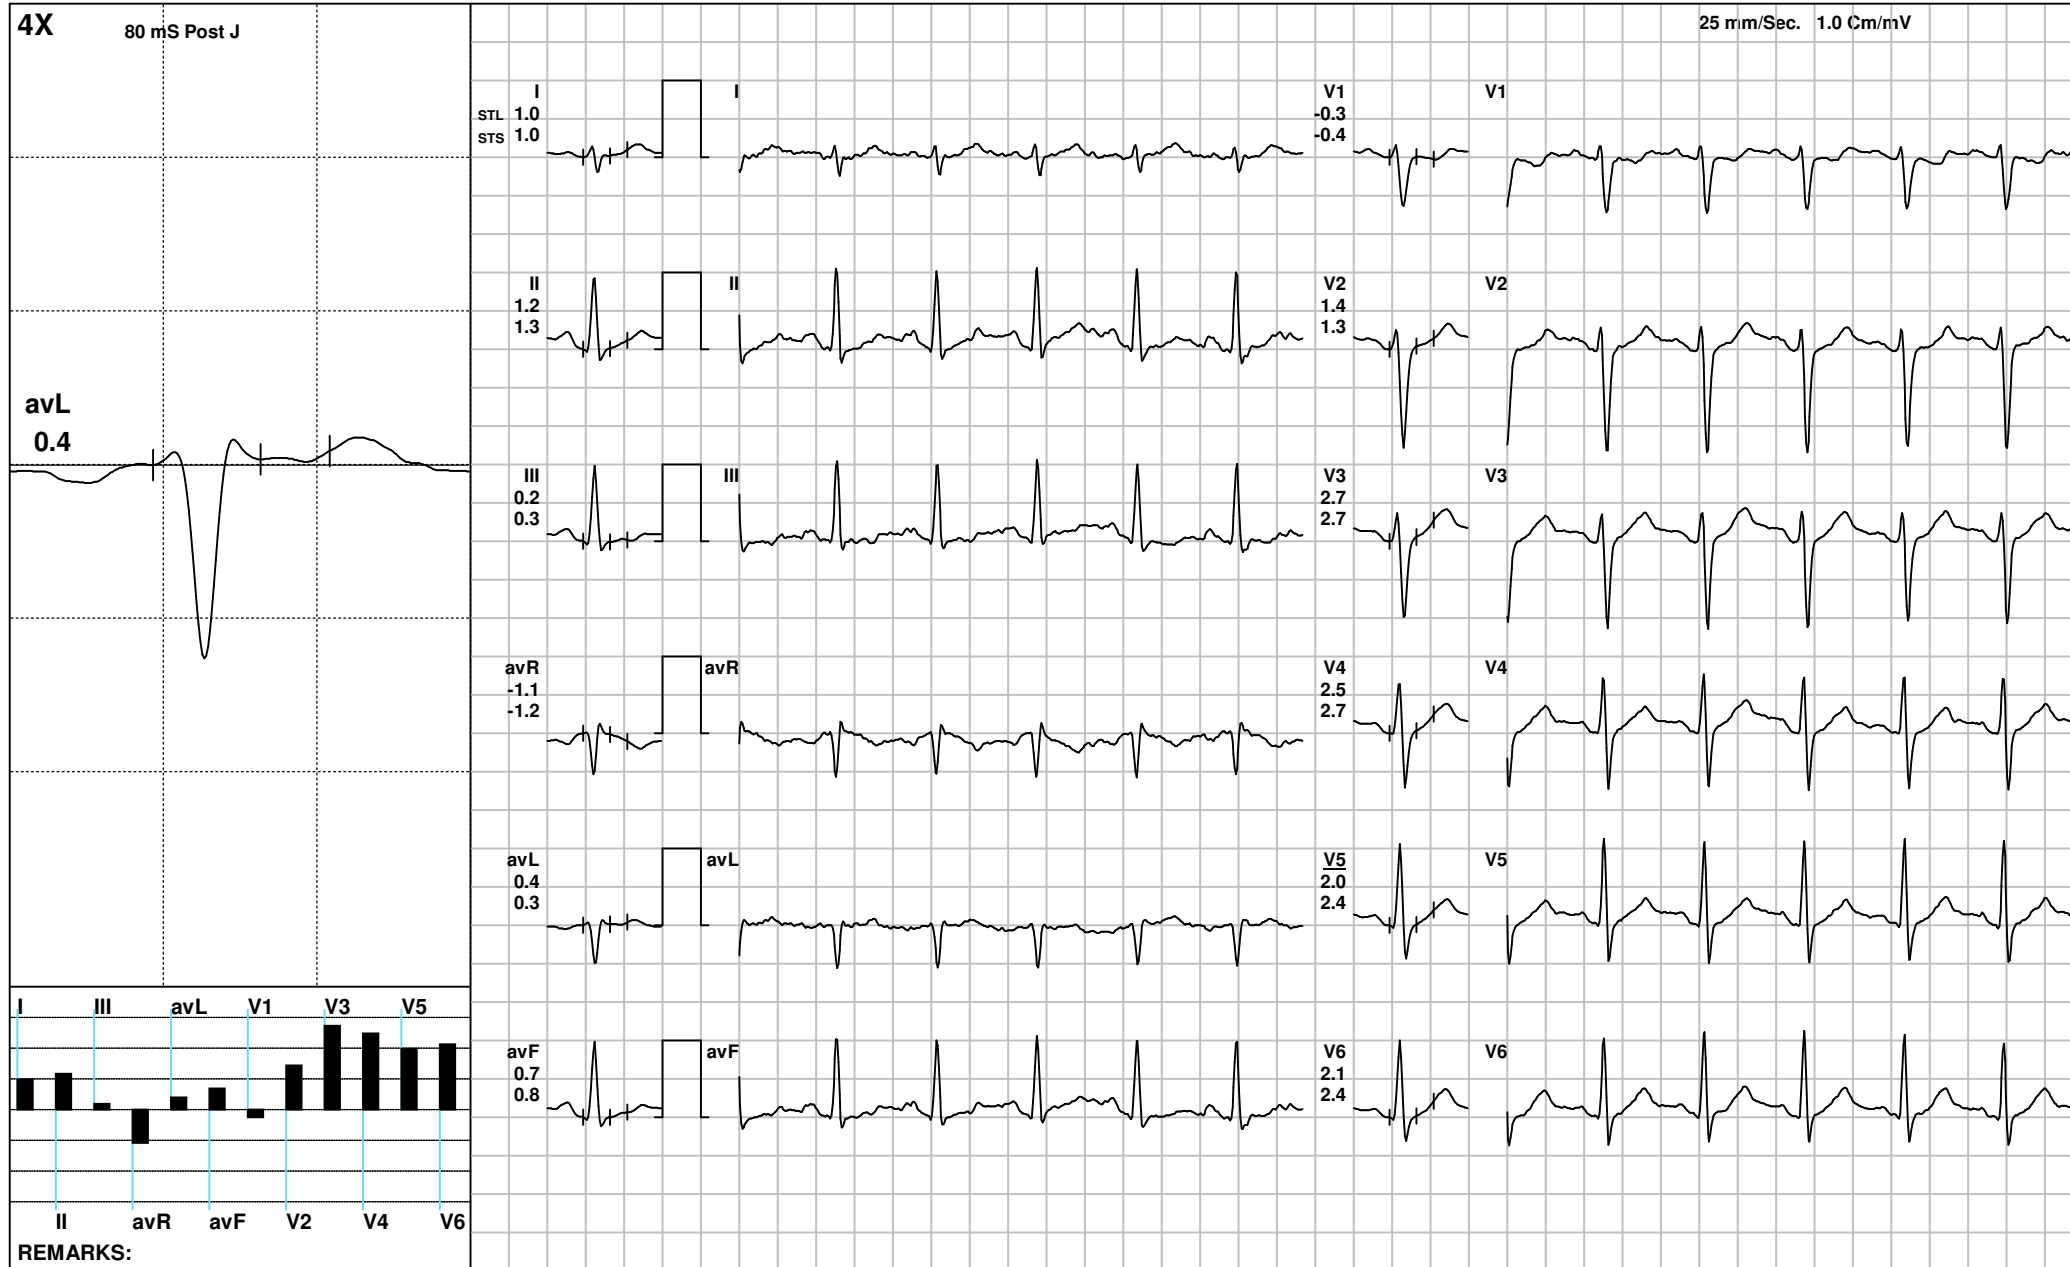




120 / PRADEEP KUMAR / 35 Yrs / M / 181 Cms / 84 Kg / HR : 109

Date: 25-Mar-2023 12:57:16 PM METS: 1.0/ 109 bpm 59% of THR BP: 125/80 mmHg Raw ECG/ BLC On/ Notch On/ HF 0.05 Hz/LF 35 Hz

ExTime: 06:40 0.0 mph, 0.0%

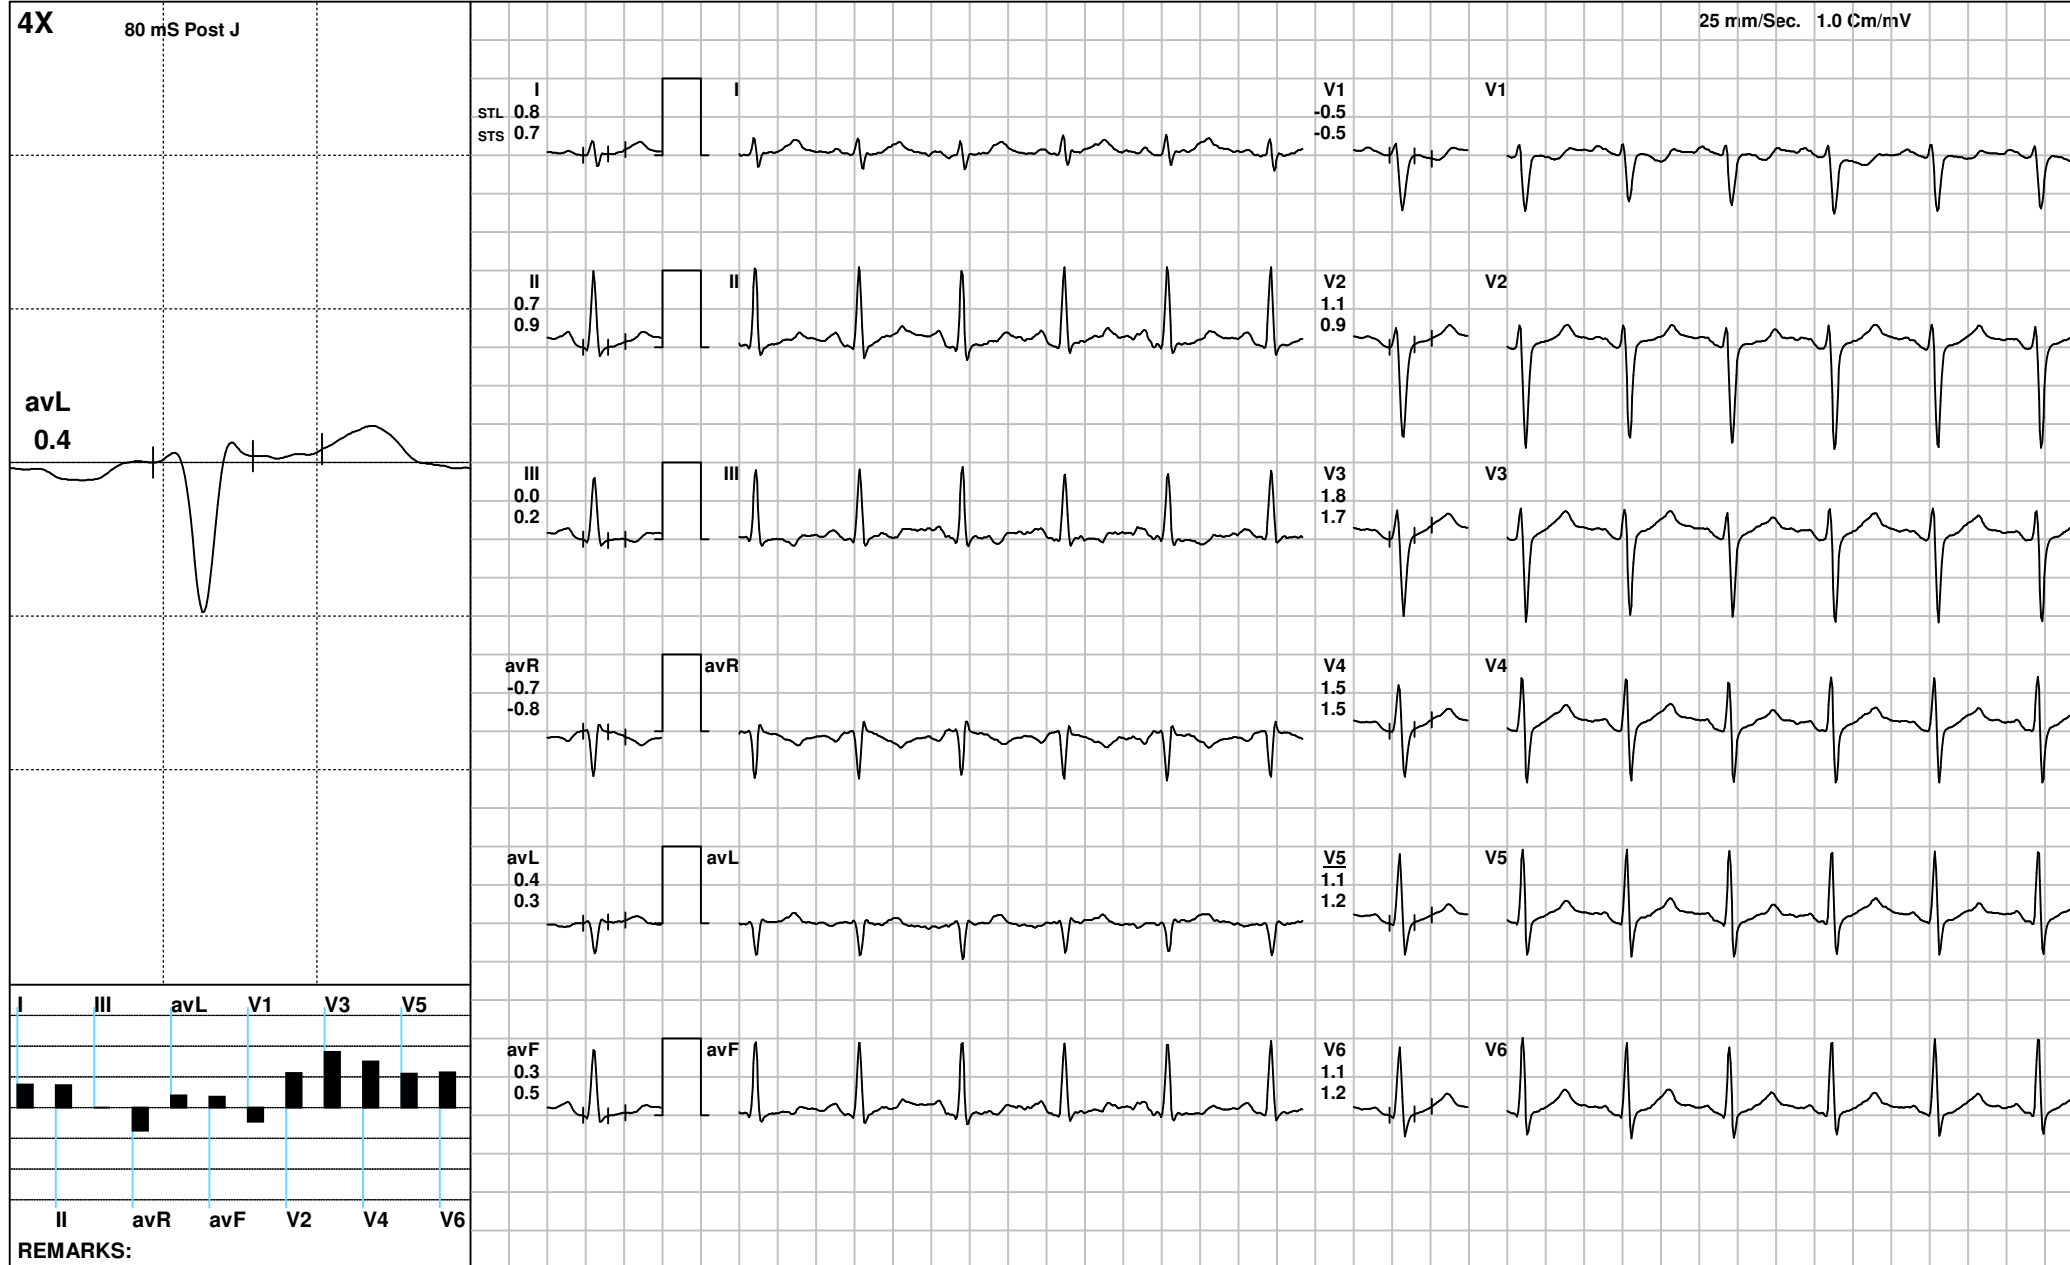




120 / PRADEEP KUMAR / 35 Yrs / M / 181 Cms / 84 Kg / HR : 109

Date: 25-Mar-2023 12:57:16 PM METS: 1.0/ 109 bpm 59% of THR BP: 125/80 mmHg Raw ECG/ BLC On/ Notch On/ HF 0.05 Hz/LF 35 Hz

ExTime: 06:40 0.0 mph, 0.0%

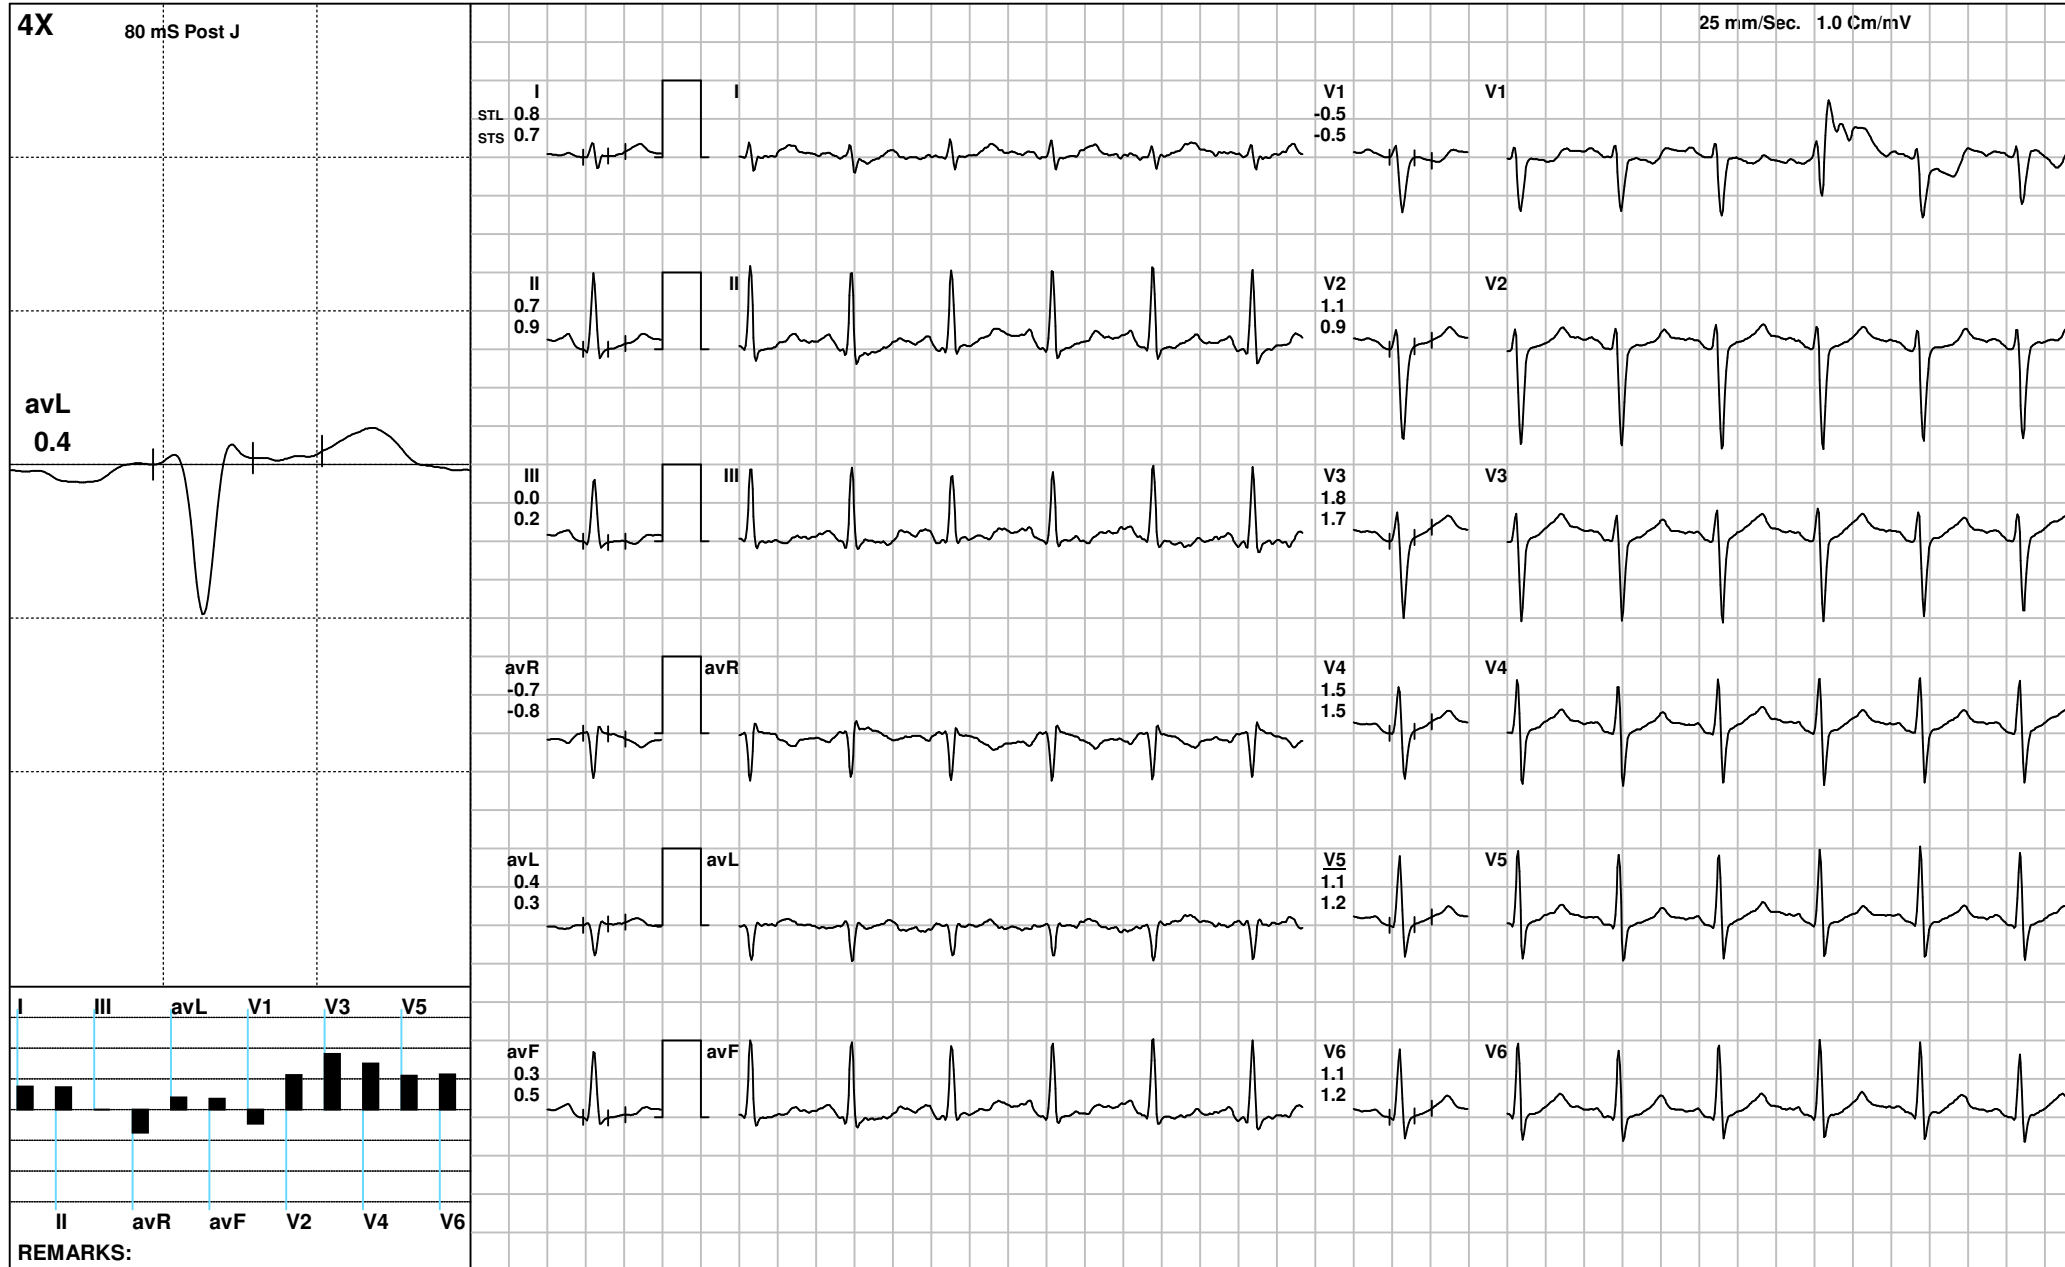



Ramnagar Road. Etawah

120 / PRADEEP KUMAR / 35 Yrs / M / 181 Cms / 84 Kg / NonSmoker Date: 25-Mar-2023

NonCardiacPain Angina /Non-Hypercholestromia/Non-Diabetic/Negative Estrogen/Non-Athlete

Stage	Time	Duration	Speed(mph)	Elevation	METs	Rate	% THR	BP	RPP	PVC	Comments
ExStart	00:03	0:03	01.7	10.0	01.1	060	32 %	125/80	075	00	
BRUCE Stage 1	03:03	3:00	01.7	10.0	04.7	122	66 %	128/81	156	00	
BRUCE Stage 2	06:03	3:00	02.5	12.0	07.1	149	81 %	132/85	196	00	
PeakEx	06:43	0:40	03.4	14.0	07.8	157	85 %	135/86	211	00	
Recovery	07:13	0:30	00.0	00.0	04.2	152	82 %	134/85	203	00	
Recovery	07:43	1:00	00.0	00.0	01.2	146	79 %	132/83	192	00	
Recovery	08:43	2:00	00.0	00.0	01.0	127	69 %	130/82	165	00	
Recovery	09:43	3:00	00.0	00.0	01.0	117	63 %	128/82	149	00	
Recovery	10:43	4:00	00.0	00.0	01.0	113	61 %	126/80	142	00	
Recovery	11:43	5:00	00.0	00.0	01.0	109	59 %	125/80	136	00	
Recovery	11:48	5:05	00.0	00.0	01.0	109	59 %	125/80	136	00	

**FINDINGS :**

**Exercise Time** : 06:40  
**Max HR Attained** : 157 bpm 85% of Target 185  
**Max BP Attained** : 135/86  
**Max WorkLoad Attained** : 7.8 Fair response to induced stress  
**Max ST Dep Lead & Avg ST Value** : V1 & -0.5 mm in Recovery  
**Duke Treadmill Score** : 04.7  
**Test End Reasons** : Test Complete, Heart Rate Achieved

**REPORT :**