

**INDIAN UNION DRIVING LICENCE**  
**MADHYA PRADESH STATE** Form 7

सत्यमेव जयते

Number : MP04N-2012-0289822  
 Name : ROHIT KULKARNI  
 S/D/W of : PRAKASH KULKARNI  
 Address : 223 MAHABALI NA TAR  
 KOLAR ROAD  
 BHOPAL, MP

Issued on: 29-06-2012  
 DOB : 11-10-1982 BG:  
 is Licence to drive

Vehicle Class: MCWGR LMV-NT  
 Date of Issue: 29-06-2012 29-06-2012

Valid till (Transport)  
 Valid till (Non-Transport): 29-06-2032

HOLDER'S SIGNATURE  
 AUTHENTICATION  
 BHOPLA RFO  
 Auth. by: SATISH PATHAK

*[Handwritten Signature]*

## SUBURBAN DIAGNOSTICS MALAD(W)

### Patient Details

Date: 12-Feb-22

Time: 11:34:03

Name: ROHIT KULKARNI ID: 2204331854

Age: 39 y

Sex: M

Height: 173 cms

Weight: 85 Kgs

Clinical History:

Medications:

### Test Details

Protocol: Bruce

Pr.MHR: 181 bpm

THR: 162 (90 % of Pr.MHR) bpm

Total Exec. Time: 7 m 9 s

Max. HR: 166 ( 92% of Pr.MHR )bpm

Max. Mets: 10.20

Max. BP: 140 / 80 mmHg

Max. BP x HR: 23240 mmHg/min

Min. BP x HR: 5520 mmHg/min

Test Termination Criteria: Target HR attained

### Protocol Details

Stage Name	Stage Time (min : sec)	Mets	Speed (mph)	Grade (%)	Heart Rate (bpm)	Max. BP (mm/Hg)	Max. ST Level (mm)	Max. ST Slope (mV/s)
Supine	0 : 20	1.0	0	0	78	120 / 80	-0.64 aVR	1.06 II
Standing	0 : 13	1.0	0	0	69	120 / 80	-0.64 aVR	1.42 II
Hyperventilation	0 : 15	1.0	0	0	76	120 / 80	-0.64 aVR	1.06 II
1	3 : 0	4.6	1.7	10	130	132 / 80	-1.27 aVR	3.18 V4
2	3 : 0	7.0	2.5	12	153	140 / 80	-1.06 aVR	4.95 V4
Peak Ex	1 : 9	10.2	3.4	14	166	140 / 80	-1.27 aVR	5.66 V4
Recovery(1)	1 : 0	1.8	1	0	139	140 / 80	-1.49 aVR	5.66 V3
Recovery(2)	1 : 0	1.0	0	0	114	140 / 80	-1.49 aVR	5.66 V4
Recovery(3)	1 : 0	1.0	0	0	109	140 / 80	-0.85 aVR	3.54 V4
Recovery(4)	0 : 5	1.0	0	0	108	140 / 80	-0.42 aVR	1.77 II

### Interpretation

The patient exercised according to the Bruce protocol for 7 m 9 s achieving a work level of Max. METS : 10.20. Resting heart rate initially 78 bpm, rose to a max. heart rate of 166 ( 92% of Pr.MHR ) bpm. Resting blood Pressure 120 / 80 mmHg, rose to a maximum blood pressure of 140 / 80 mmHg.

Good effort tolerance. Normal chronotropic response. Normal ionotropic response. No angina/ angina equivalents. No arrhythmia. No significant ST-T changes from baseline.

IMPRESSION: STRESS TEST IS NEGATIVE FOR STRESS INDUCIBLE ISCHEMIA

Disclaimer: Negative test does not rule out Coronary Artery Disease. Positive test is suggestive but not confirmatory of coronary artery disease. Hence clinical correlation is mandatory.

SUBURBAN DIAGNOSTICS (INDIA) PVT. LTD.

102-104, Bhoomi Castle,

Opp. Goregaon Sports Club,

Link Road, Malad (W), Mumbai - 400 064.

Doctor: DR. SONALI HONRAO

Ref. Doctor: ARCOFEMI

( Summary Report edited by user )

(c) Schiller Healthcare India Pvt. Ltd. V 4.7

DR. SONALI HONRAO  
MD (G.MED)  
CONSULTING PHYSICIAN  
REG. NO. 2001/04/1882

# SUBURBAN DIAGNOSTICS MALAD(W)

**ROHIT KULKARNI (39 M)**

ID: 2204331854

Date: 12-Feb-22

B.P: 120 / 80

Protocol: Bruce

Stage: Supine

Speed: 0 mph


Grade: 0 %

Exec Time : 0 m 0 s

Stage Time : 0 m 20 s

**HR: 78 bpm**

(THR: 162 bpm)

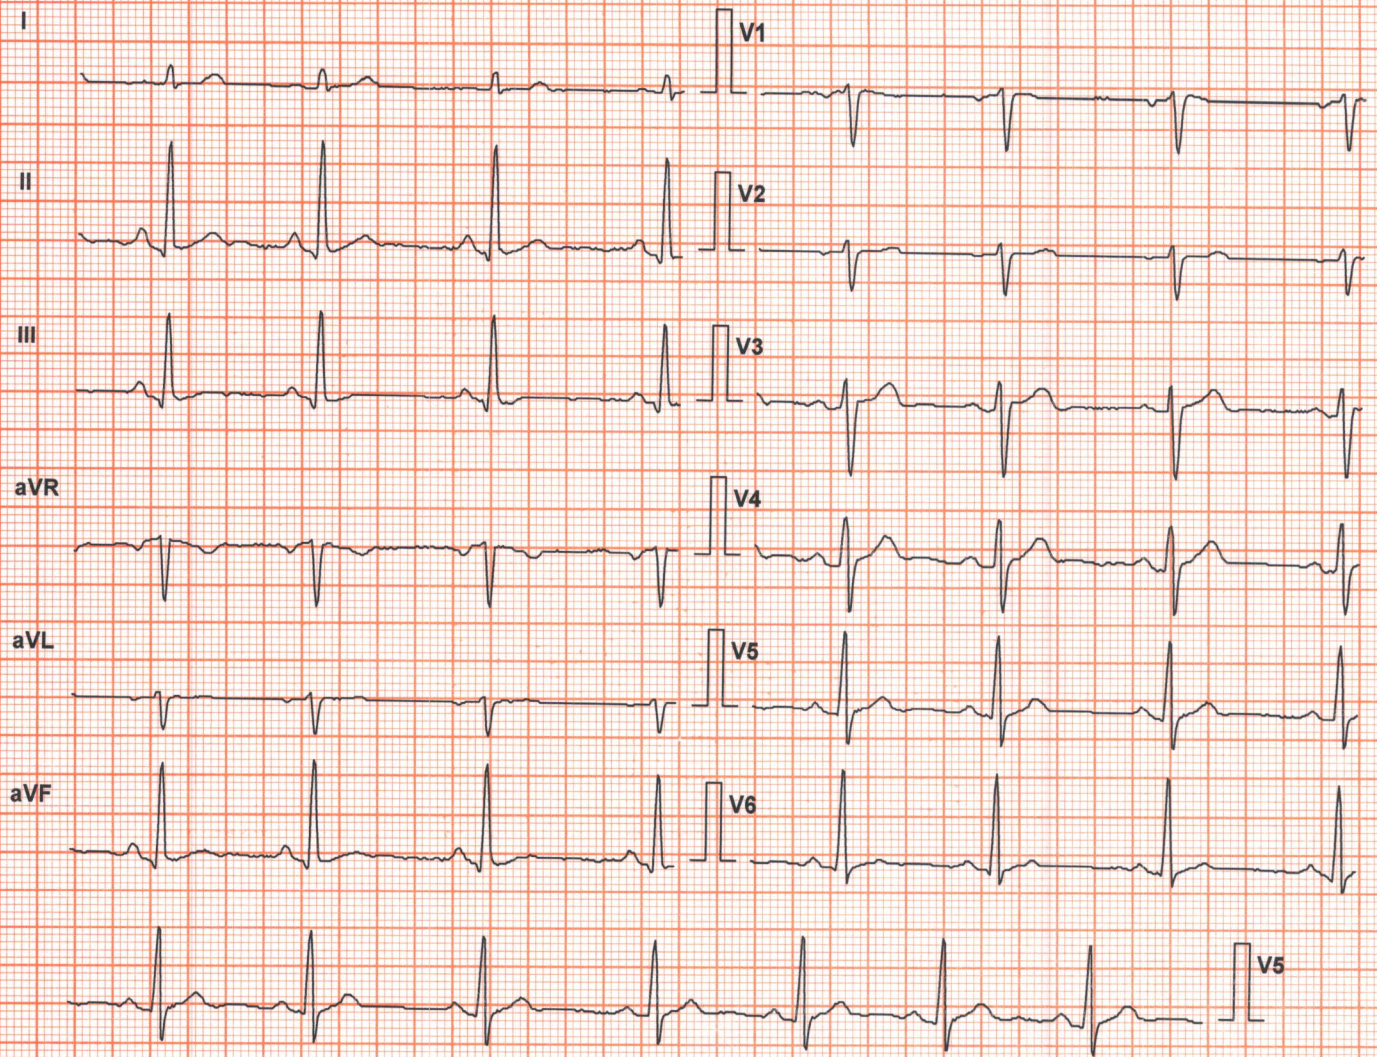

Lead	ST Level (mm)	ST Slope (mV/s)
I	0.2	0.0
II	0.6	1.1
III	0.2	0.7
aVR	-0.6	-0.7
aVL	0.0	0.0
aVF	0.4	0.7
V1	0.0	-0.4
V2	0.0	-0.4
V3	1.1	0.7
V4	1.3	0.4
V5	0.8	0.7
V6	0.6	1.1

Chart Speed: 25 mm/sec

Filter: 35 Hz

Mains Filt: ON

Amp: 10 mm

Schiller Spandan V 4.7

Iso = R - 60 ms J = R + 60 ms

Post J = J + 60 ms



# SUBURBAN DIAGNOSTICS MALAD(W)

**ROHIT KULKARNI (39 M)**

ID: 2204331854

Date: 12-Feb-22

B.P: 120 / 80

Protocol: Bruce

Stage: Standing

Speed: 0 mph


Grade: 0%

Exec Time : 0 m 0 s

Stage Time : 0 m 13 s

**HR: 69 bpm**

(THR: 162 bpm)

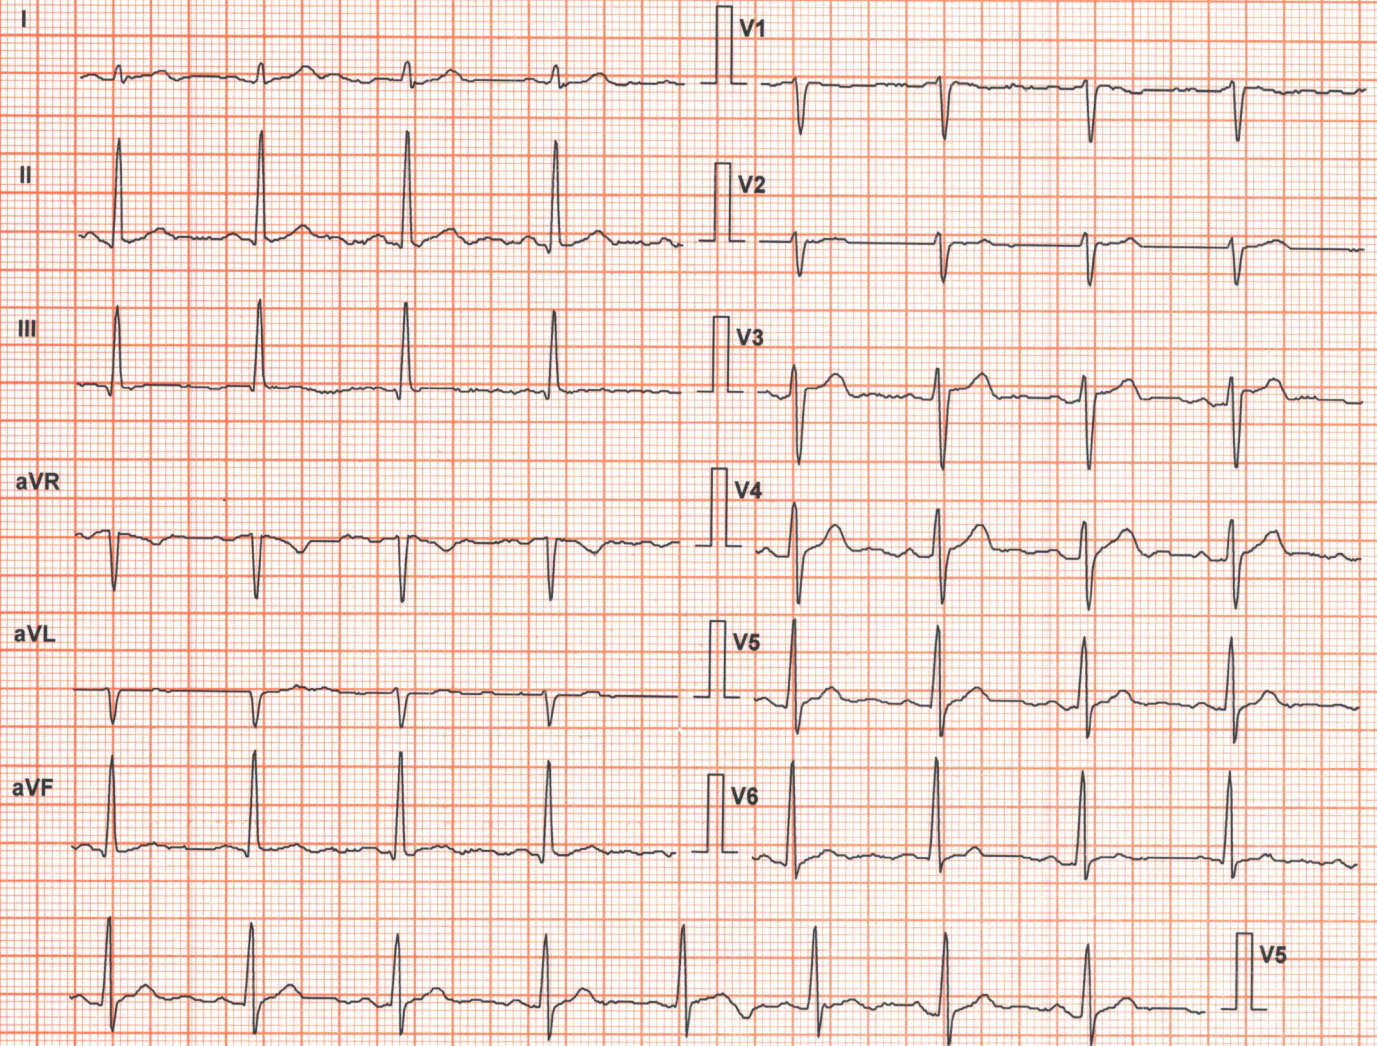

Lead	ST Level (mm)	ST Slope (mV/s)
I	0.2	0.0
II	0.6	0.7
III	0.2	0.4
aVR	-0.4	-0.4
aVL	0.0	0.0
aVF	0.4	0.4
V1	0.2	-0.4
V2	0.0	0.0
V3	1.1	0.4
V4	1.3	0.7
V5	0.6	0.4
V6	0.4	0.7

Chart Speed: 25 mm/sec

Filter: 35 Hz

Mains Filt: ON

Amp: 10 mm

Schiller Spandan V4.7

Iso = R - 60 ms J = R + 60 ms

Post J = J + 60 ms



# SUBURBAN DIAGNOSTICS MALAD(W)

**ROHIT KULKARNI (39 M)**

ID: 2204331854

Date: 12-Feb-22

B.P: 120 / 80

Protocol: Bruce

Stage: Hyperventilation

Speed: 0 mph


Grade: 0 %

Exec Time : 0 m 0 s

Stage Time : 0 m 15 s

**HR: 76 bpm**

(THR: 162 bpm)

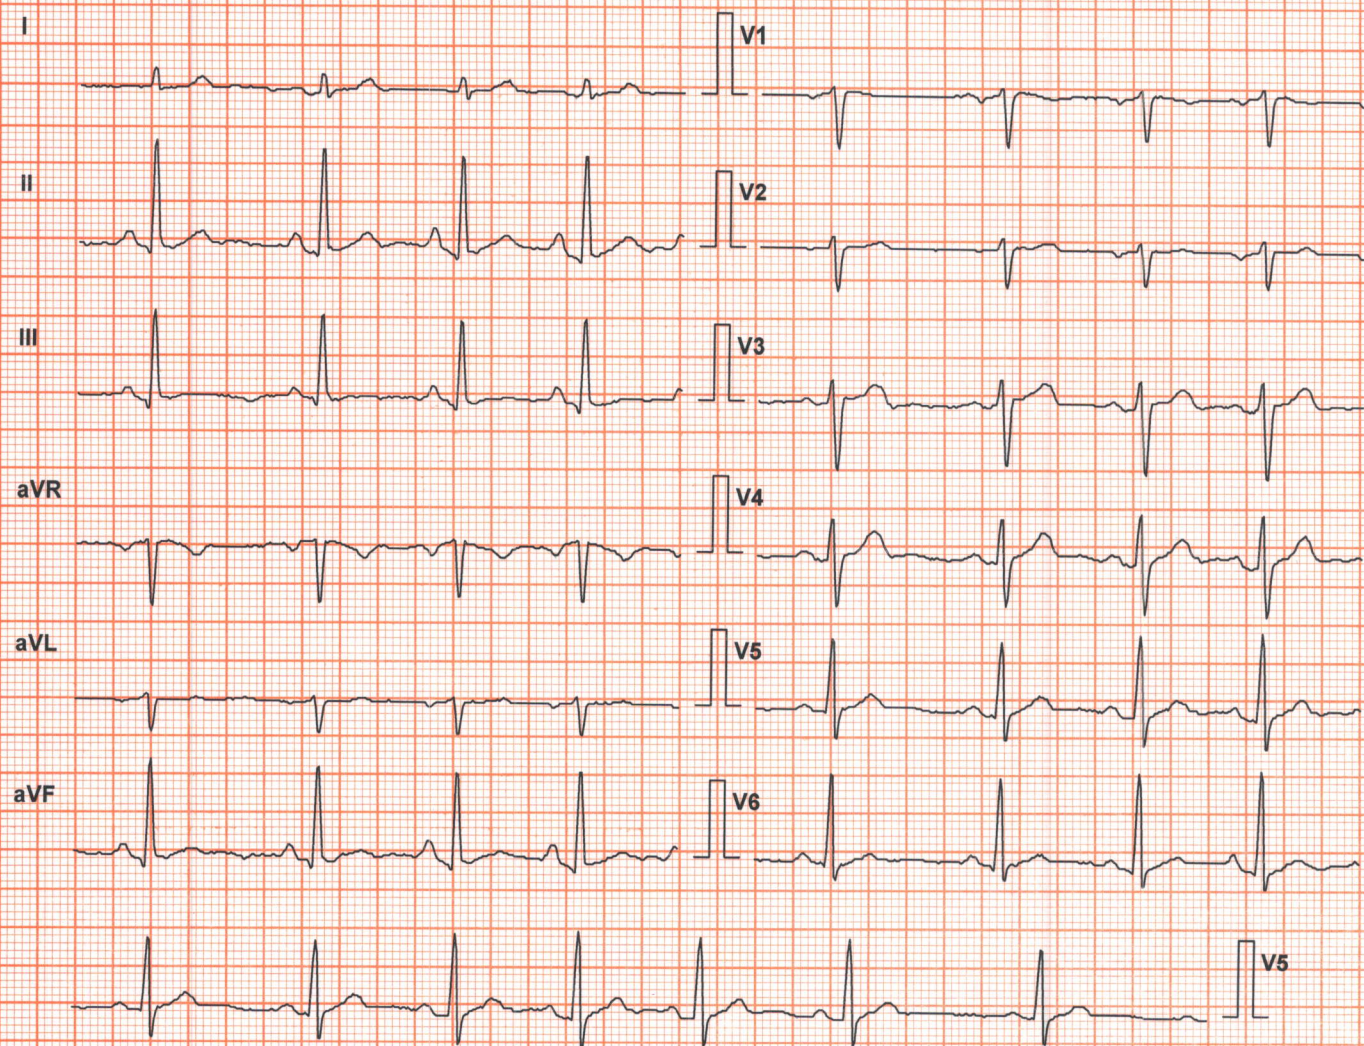

Lead	ST Level (mm)	ST Slope (mV/s)
I	0.2	0.0
II	0.4	0.7
III	0.2	0.4
aVR	-0.4	-0.7
aVL	0.0	0.0
aVF	0.4	0.4
V1	0.2	-0.4
V2	0.0	0.0
V3	1.3	0.7
V4	1.1	0.4
V5	0.8	0.7
V6	0.6	0.7

Chart Speed: 25 mm/sec

Filter: 35 Hz

Mains Filt: ON

Amp: 10 mm

Schiller Spandan V 4.7

Iso = R - 60 ms J = R + 60 ms

Post J = J + 60 ms



# SUBURBAN DIAGNOSTICS MALAD(W)

**ROHIT KULKARNI (39 M)**

ID: 2204331854

Date: 12-Feb-22

B.P: 132 / 80

Protocol: Bruce

Stage: 1

Speed: 1.7 mph


Grade: 10 %

Exec Time : 3 m 0 s

Stage Time : 3 m 0 s

**HR: 130 bpm**

(THR: 162 bpm)

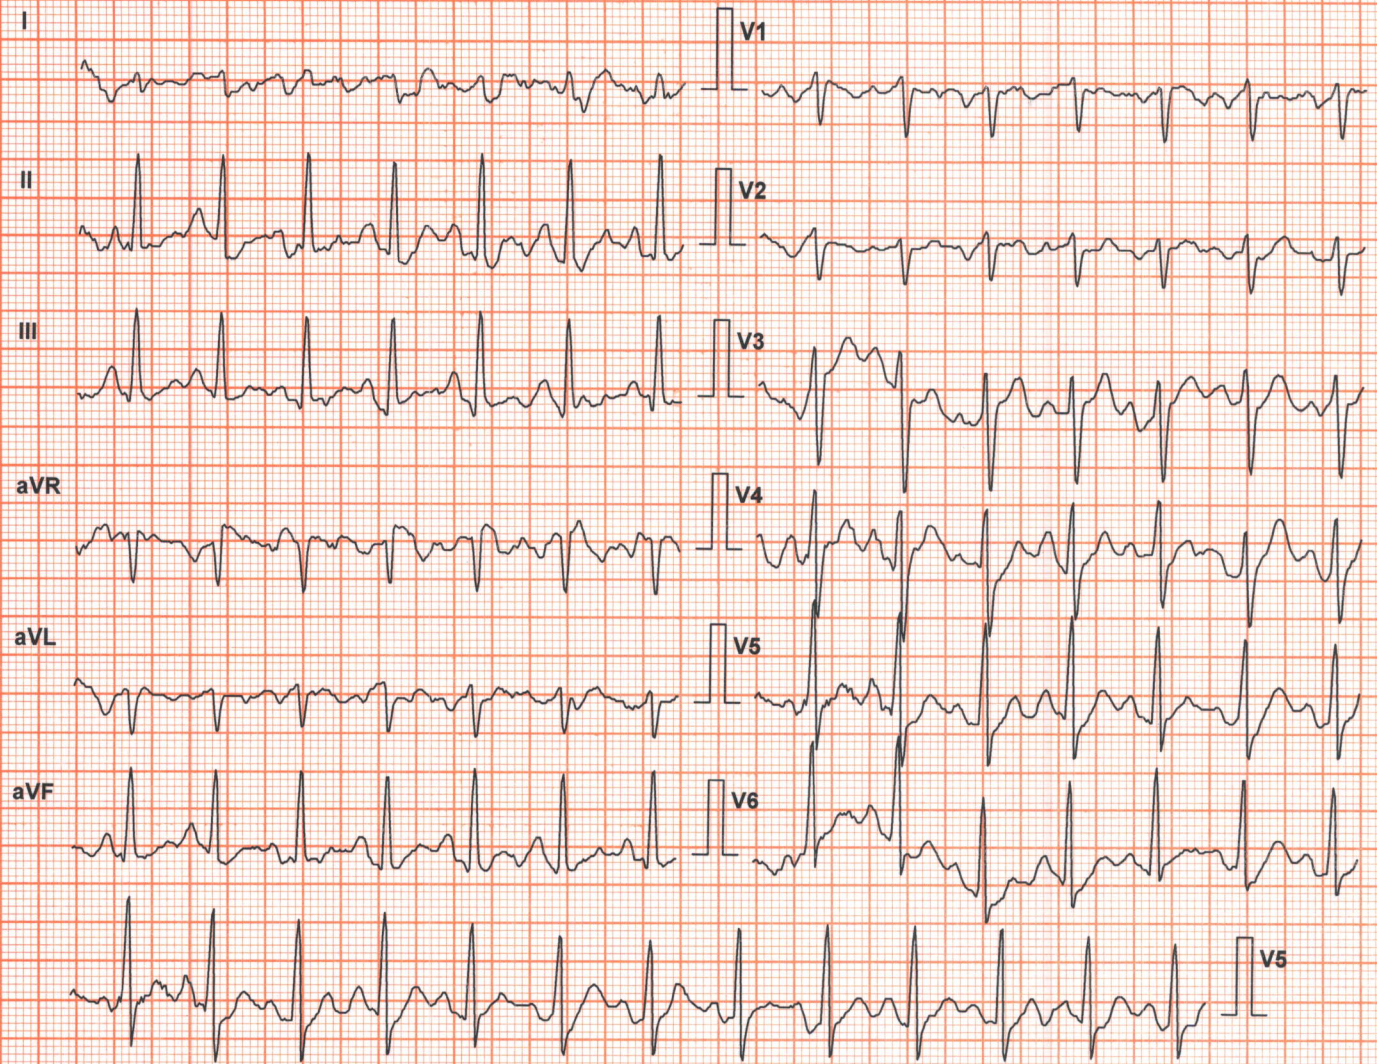

Lead	ST Level (mm)	ST Slope (mV/s)
I	-0.2	-0.4
aVR	-0.2	-0.4
V1	-0.2	-1.4
V4	1.9	1.8
II	0.4	1.4
aVL	0.0	-0.4
V2	0.4	0.0
V5	1.3	1.8
III	0.4	1.4
aVF	0.4	1.1
V3	2.3	2.1
V6	1.1	2.1

Chart Speed: 25 mm/sec

Filter: 35 Hz

Mains Filt: ON

Amp: 10 mm

Schiller Spandan V 4.7

Iso = R - 60 ms J = R + 60 ms

Post J = J + 60 ms



# SUBURBAN DIAGNOSTICS MALAD(W)

**ROHIT KULKARNI (39 M)**

ID: 2204331854

Date: 12-Feb-22

B.P: 140 / 80

Protocol: Bruce

Stage: 2

Speed: 2.5 mph


Grade: 12 %

Exec Time : 6 m 0 s

Stage Time : 3 m 0 s

**HR: 153 bpm**

(THR: 162 bpm)

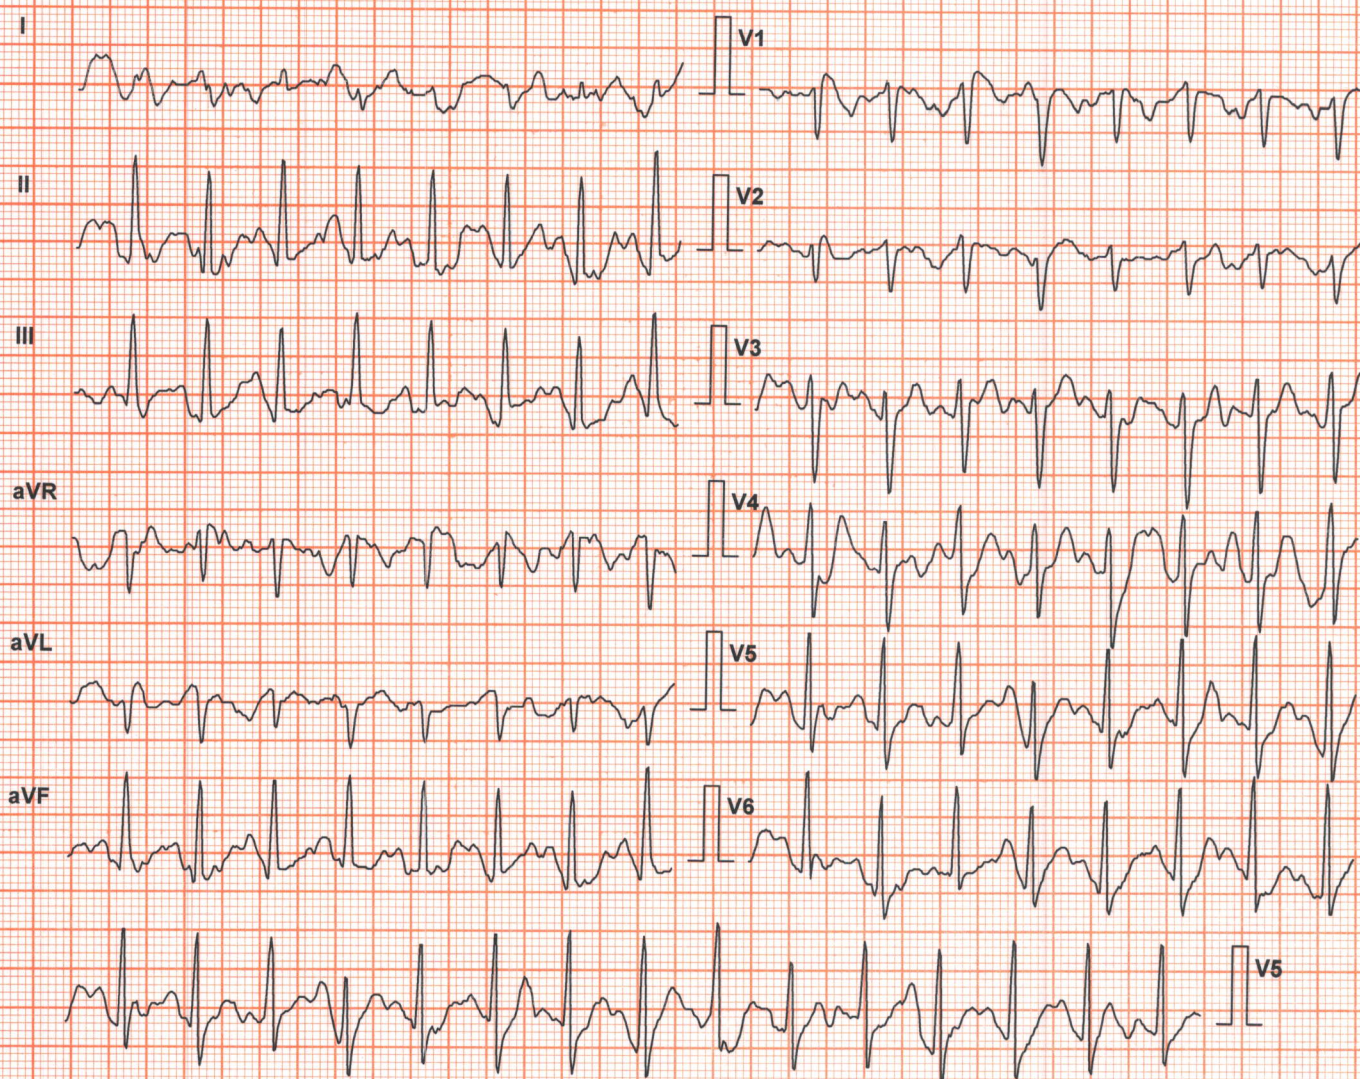

Lead	ST Level (mm)	ST Slope (mV/s)
I	0.2	1.1
aVR	-0.4	-1.8
V1	-0.4	-1.8
V4	2.1	4.2
II	0.4	2.1
aVL	-0.2	-0.4
V2	0.2	0.0
V5	1.9	3.2
III	0.4	1.1
aVF	0.4	1.8
V3	2.8	3.2
V6	1.1	2.5

Chart Speed: 25 mm/sec

Filter: 35 Hz

Mains Filt: ON

Amp: 10 mm

Schiller Spandan V 4.7

Iso = R - 60 ms J = R + 60 ms

Post J = J + 60 ms



# SUBURBAN DIAGNOSTICS MALAD(W)

**ROHIT KULKARNI (39 M)**

ID: 2204331854

Date: 12-Feb-22

B.P: 140 / 80

Protocol: Bruce

Stage: Peak Ex

Speed: 3.4 mph


Grade: 14 %

Exec Time : 7 m 9 s

Stage Time : 1 m 9 s

**HR: 166 bpm**

(THR: 162 bpm)

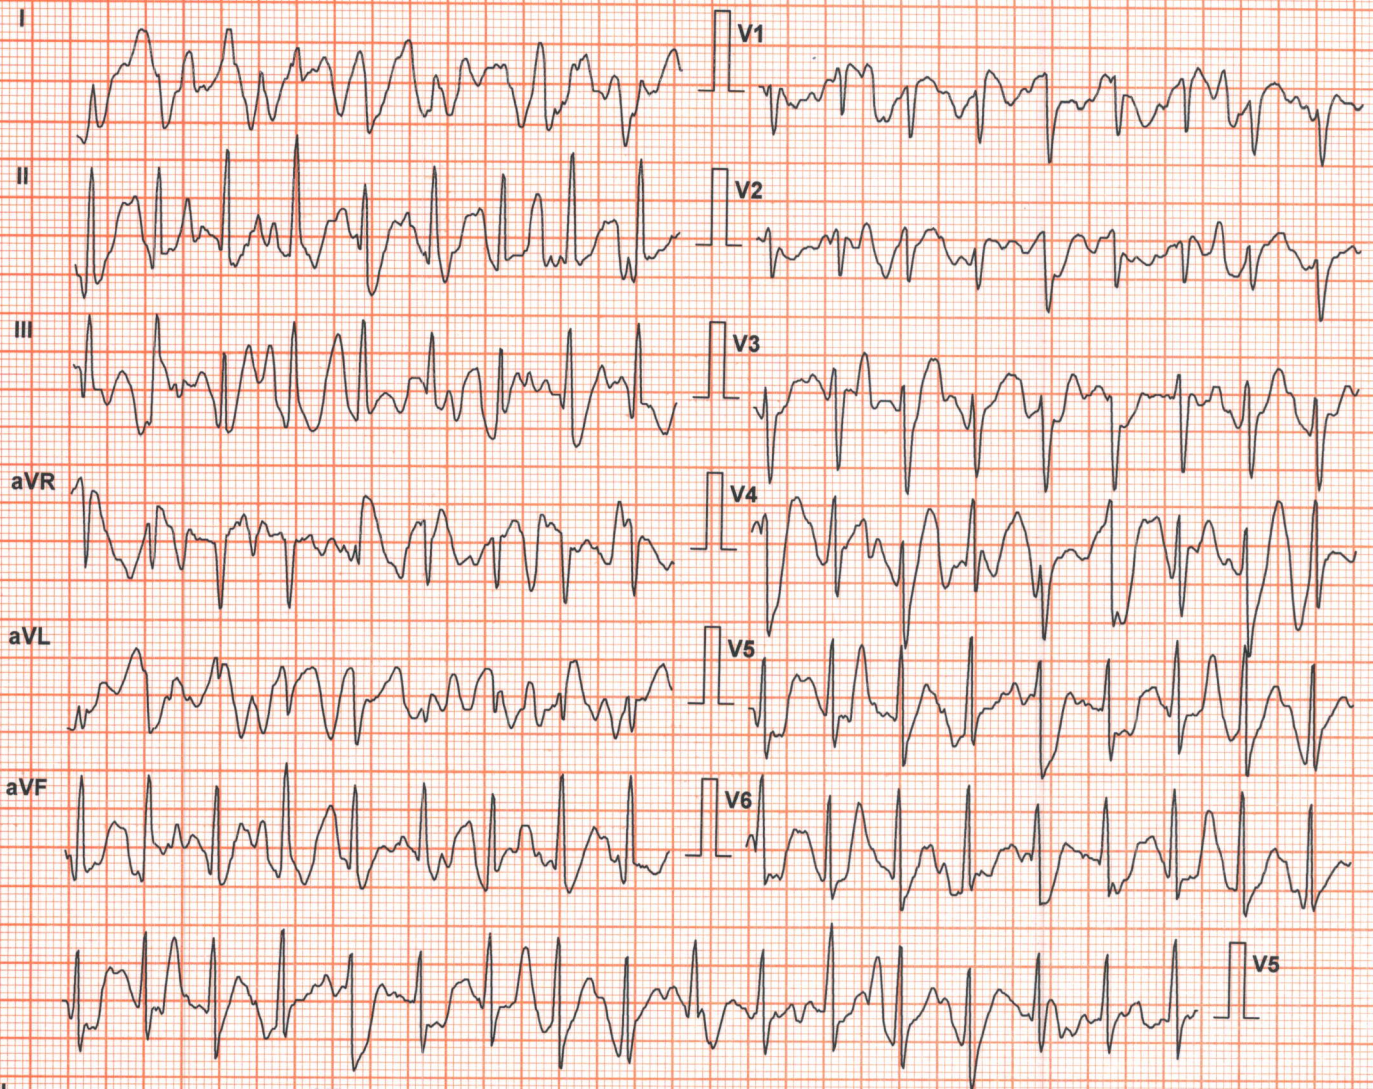

Lead	ST Level (mm)	ST Slope (mV/s)
I	0.0	0.4
aVR	-0.2	-1.4
V1	-0.6	-2.5
V4	2.5	5.0
II	0.2	2.8
aVL	0.0	-0.7
V2	0.6	0.4
V5	1.3	2.5
III	0.2	2.1
aVF	0.2	2.5
V3	3.2	3.9
V6	0.8	2.8

Chart Speed: 25 mm/sec

Filter: 35 Hz

Mains Filt: ON

Amp: 10 mm

Schiller Spandan V 4.7

Iso = R - 60 ms J = R + 60 ms

Post J = J + 60 ms





# SUBURBAN DIAGNOSTICS MALAD(W)

**ROHIT KULKARNI (39 M)**

ID: 2204331854

Date: 12-Feb-22

B.P: 140 / 80

Protocol: Bruce

Stage: Recovery(1)

Speed: 0 mph


Grade: 0 %

Exec Time : 7 m 9 s

Stage Time : 1 m 0 s

**HR: 139 bpm**

(THR: 162 bpm)

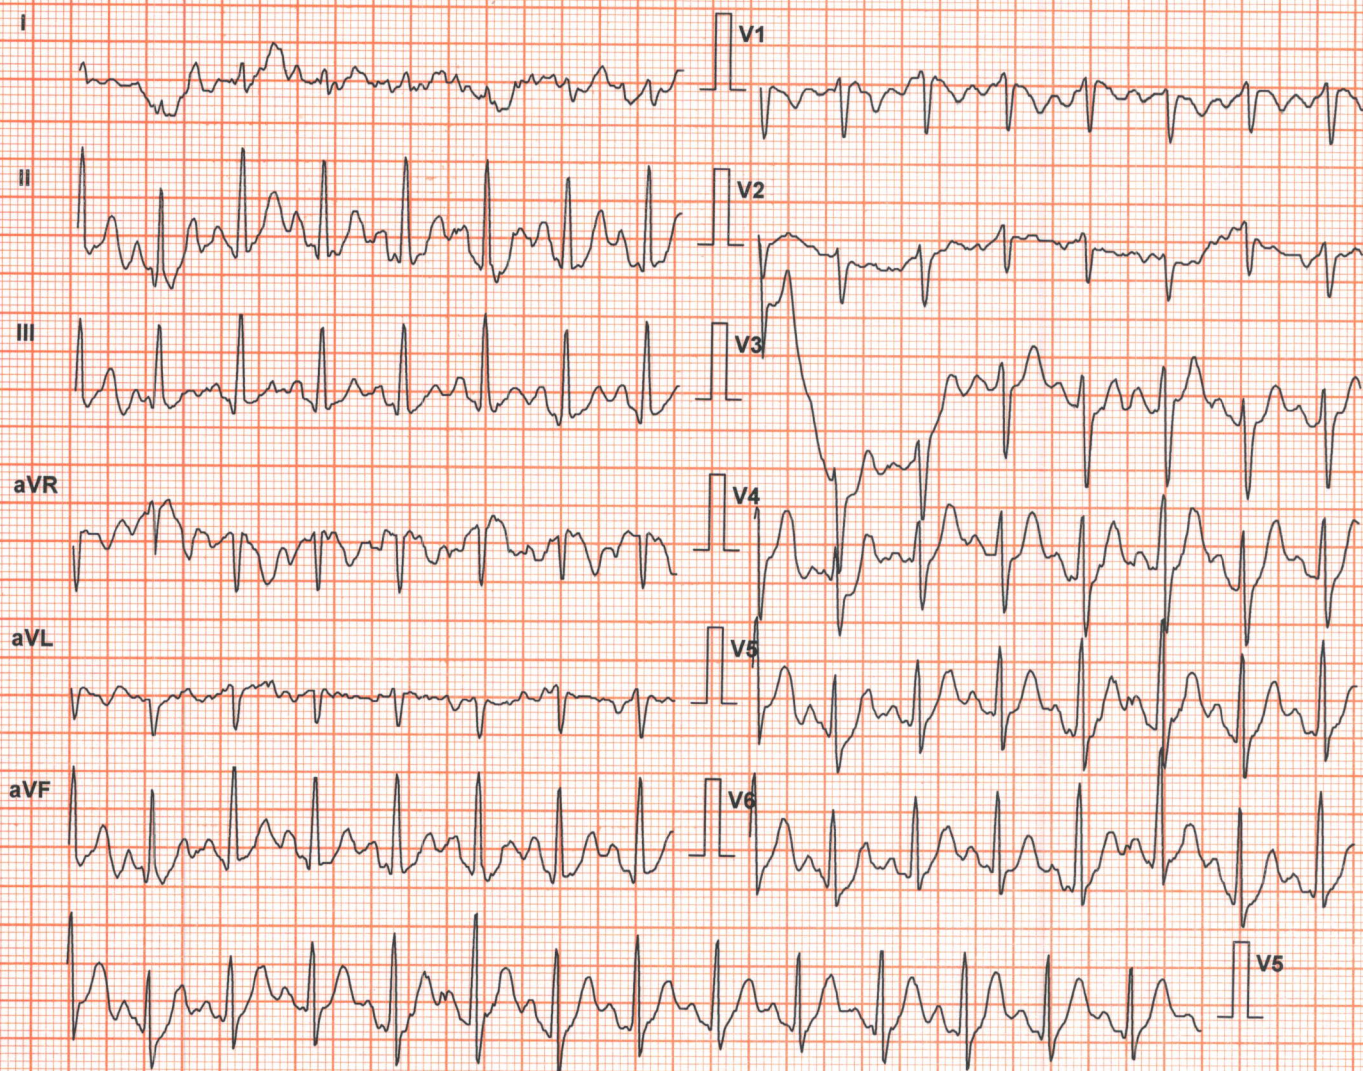

Lead	ST Level (mm)	ST Slope (mV/s)
I	0.8	1.8
aVR	-1.5	-3.2
V1	-0.6	-1.8
V4	4.0	5.7
II	1.9	4.2
aVL	0.2	0.0
V2	0.0	0.4
V5	3.4	5.3
III	0.8	2.1
aVF	1.5	3.2
V3	4.0	5.3
V6	2.3	4.2

Chart Speed: 25 mm/sec

Filter: 35 Hz

Mains Filt: ON

Amp: 10 mm

Schiller Spandan V 4.7

Iso = R - 60 ms J = R + 60 ms

Post J = J + 60 ms



# SUBURBAN DIAGNOSTICS MALAD(W)

**ROHIT KULKARNI (39 M)**

ID: 2204331854

Date: 12-Feb-22

B.P: 140 / 80

Protocol: Bruce

Stage: Recovery(2)

Speed: 0 mph


Grade: 0 %

Exec Time : 7 m 9 s

Stage Time : 1 m 0 s

**HR: 114 bpm**

(THR: 162 bpm)

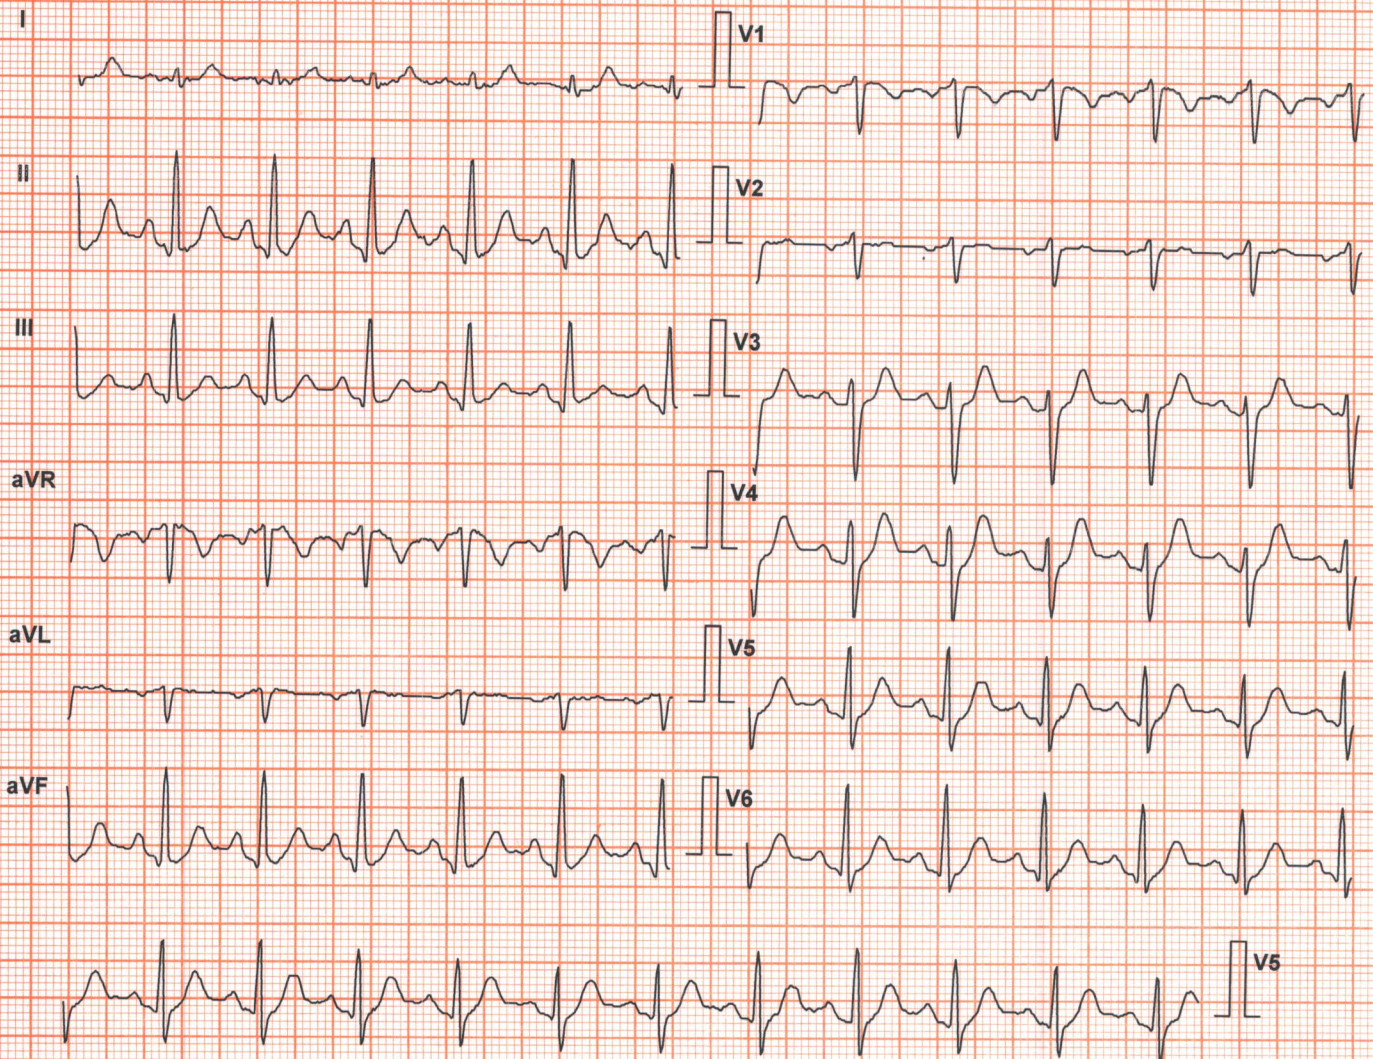

Lead	ST Level (mm)	ST Slope (mV/s)
I	0.2	0.7
aVR	-0.8	-1.8
V1	-0.2	-1.1
V4	2.3	3.5
II	1.3	2.8
aVL	0.0	0.0
V2	0.2	0.4
V5	1.5	2.5
III	0.8	1.8
aVF	1.1	2.1
V3	2.1	2.5
V6	1.1	2.1

Chart Speed: 25 mm/sec

Filter: 35 Hz

Mains Filt: ON

Amp: 10 mm

Schiller Spandan V 4.7

Iso = R - 60 ms J = R + 60 ms

Post J = J + 60 ms



# SUBURBAN DIAGNOSTICS MALAD(W)

**ROHIT KULKARNI (39 M)**

ID: 2204331854

Date: 12-Feb-22

B.P: 140 / 80

Protocol: Bruce

Stage: Recovery(3)

Speed: 0 mph


Grade: 0 %

Exec Time : 7 m 9 s

Stage Time : 1 m 0 s

**HR: 109 bpm**

(THR: 162 bpm)

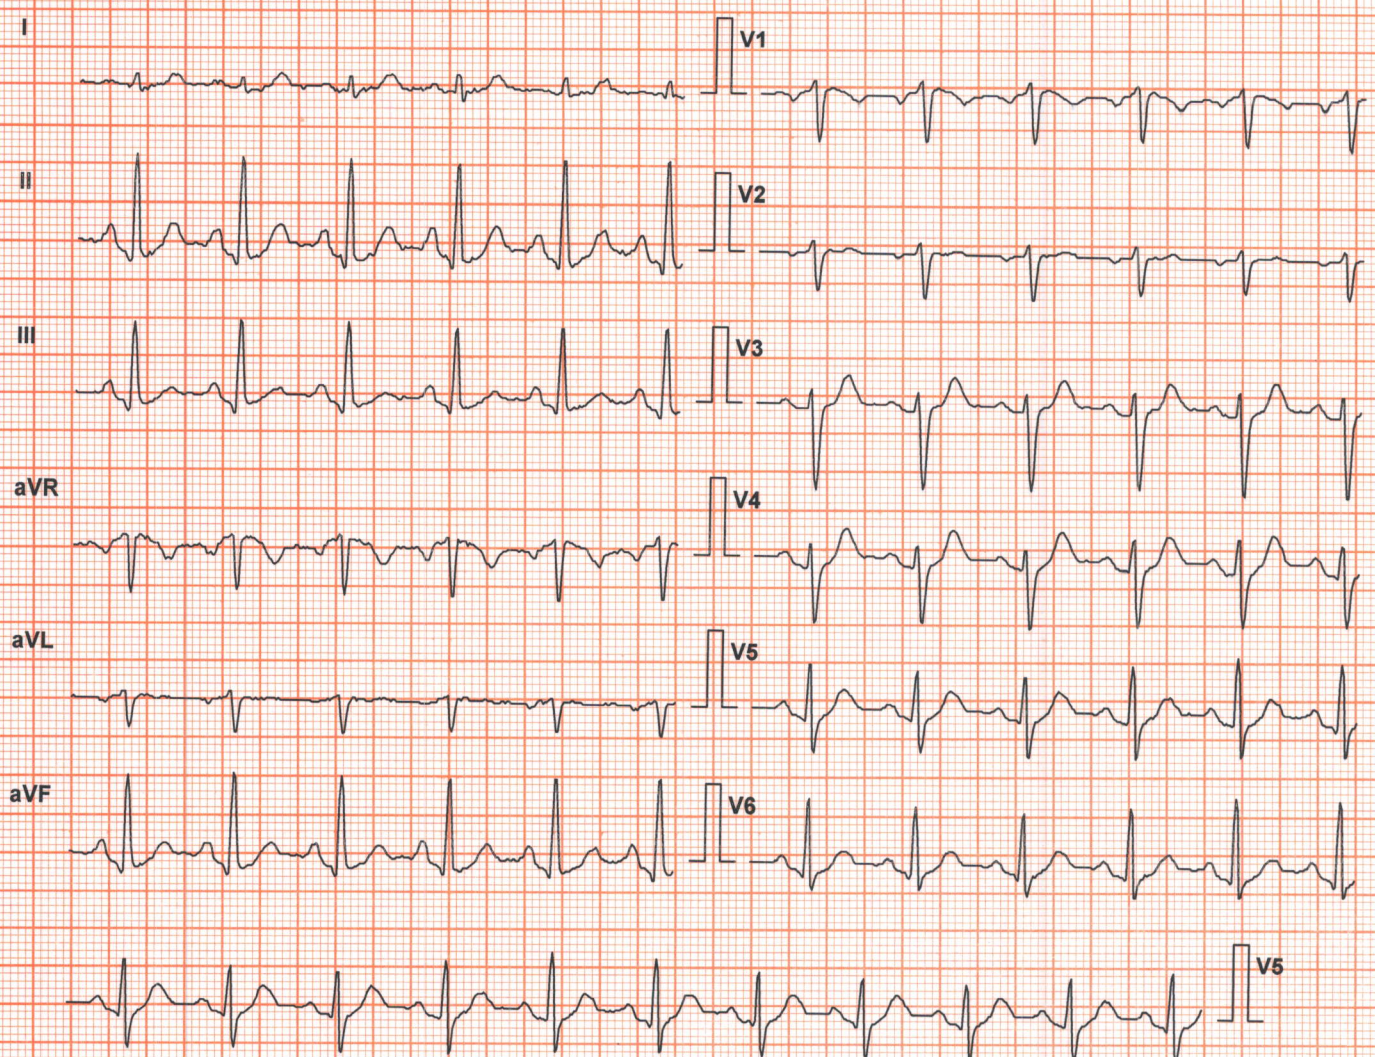

Lead	ST Level (mm)	ST Slope (mV/s)
I	0.2	0.7
aVR	-0.4	-1.1
V1	-0.2	-0.7
V4	1.3	1.8
II	0.8	1.8
aVL	0.0	-0.4
V2	0.2	0.4
V5	1.1	1.8
III	0.4	1.1
aVF	0.6	1.8
V3	1.3	1.4
V6	0.8	1.8

Chart Speed: 25 mm/sec

Filter: 35 Hz

Mains Filt: ON

Amp: 10 mm

Schiller Spandan V 4.7

Iso = R - 60 ms J = R + 60 ms

Post J = J + 60 ms

