



భారత ప్రభుత్వం

GOVERNMENT OF INDIA



లాలా నైక్ భూక్య
Lalu Naick Bhukya

పుట్టిన సంవత్సరం/Year of Birth: 1981
పురుషుడు / Male



8302 9375 0753

ఆధార్ - సామాన్యుని హక్కు



భారత విశిష్ట గుర్తింపు ప్రాధికార సంస్థ
UNIQUE IDENTIFICATION AUTHORITY OF INDIA

ధర్మానామా: S/O హరిచంద్ర నైక్,
2-648,
సుగాలి కాలనీ,
చిలకలూరిపేట,
పురుషోత్తపట్నం,
గుంటూరు,
ఆంధ్ర ప్రదేశ్,
522616

Address: S/O Harichandra Naick,
2-648, sugali colony,
Chilakaluripet H/O.Purushotha
Patnam, Purushothapatnam,
Guntur, Andhra Pradesh, 522616



1047
1800 180 1947




help@uidai.gov.in

WWW

www.uidai.gov.in



పి.సి. బాక్స్ నెం. 1947,
బెంగళూరు-560001

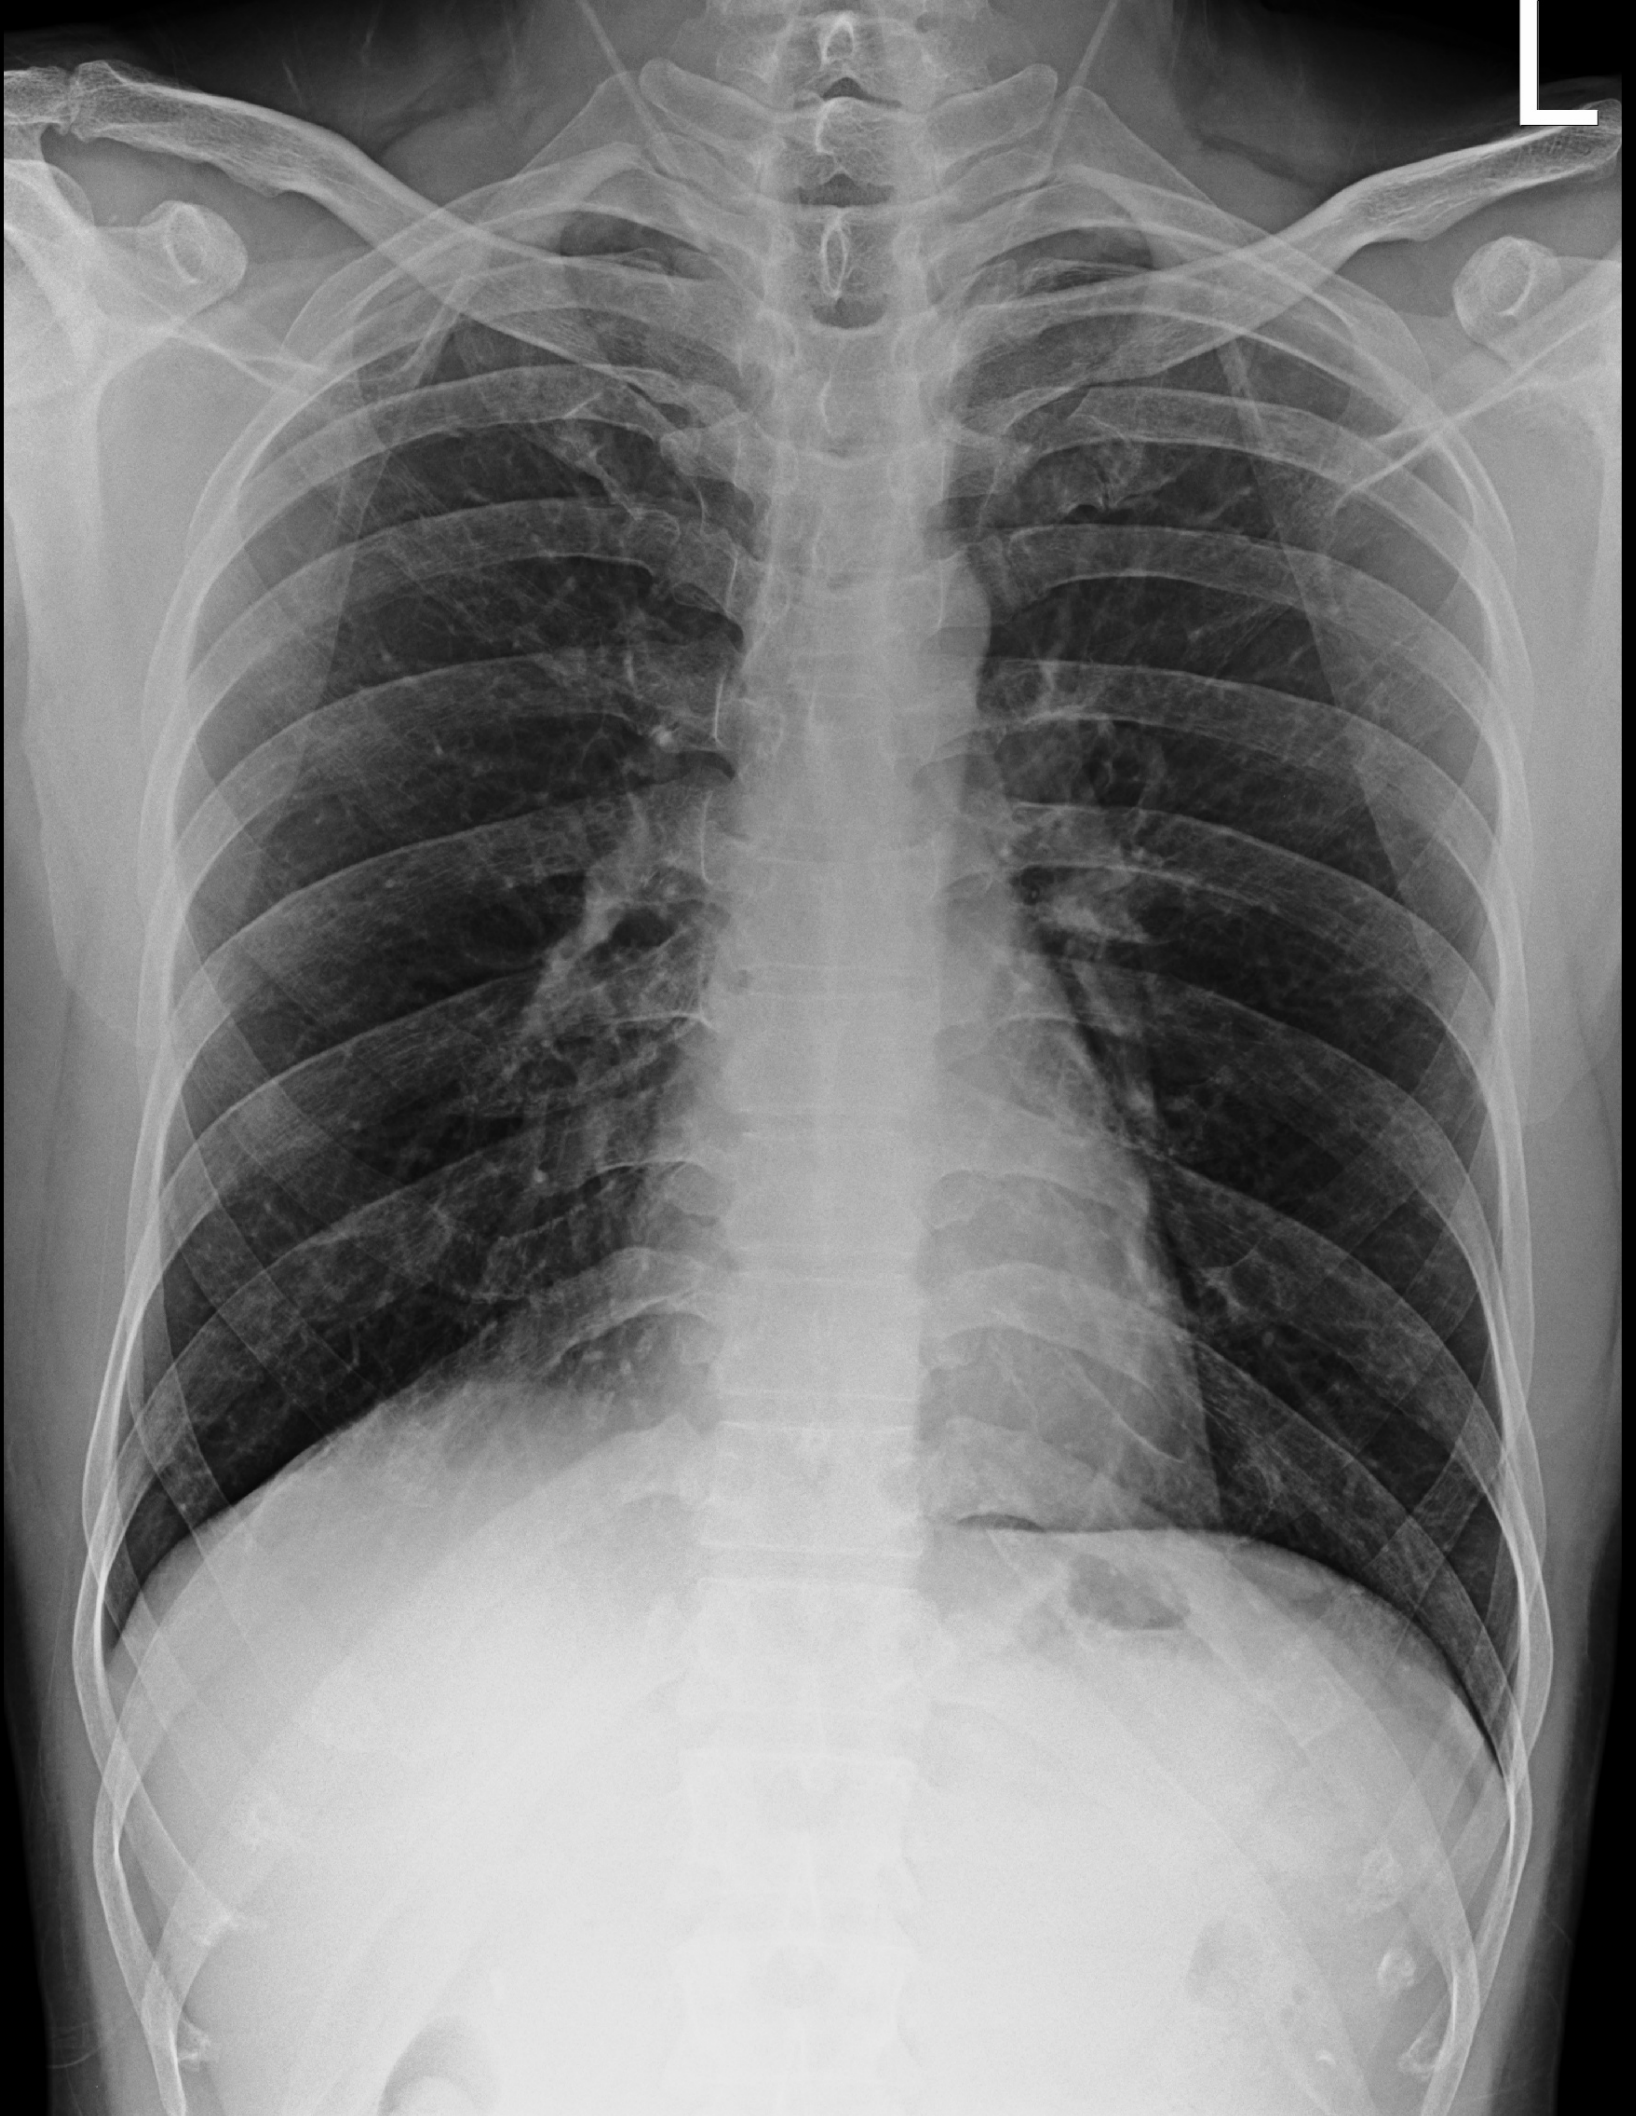

BHUKYA LALU NAICK 42Y MALE YGT53931 CHEST PA 10-Feb-24

YODA DIAGNOSTICS

Name: Mr. Bhukja Lal Naik
Date: 10/02/24 Age: 42 yrs Sex: Male
Address: Cuntur



Routine Health checkup

NO COMPLAINTS

NO H/O Hypertension / DM / CAD / AIB

TGL - 317 mg/dl

1) Low Fat Food

2) TABS. ADILIP 135m

0 0 1 - (20)

TEMP: 37.2
B.P: 110/70 mm/Hg
PULSE: 71 bts
WEIGHT: 58 kgs
HEIGHT: 174 cms

KEERTHI KISHORE GALLA
No: 64905 MBBS, M.D. General Medicine
CONSULTANT GENERAL PHYSICIAN
YODA DIAGNOSTICS CUNTUR




ID: 53931
BHUKYA LALU NAICK
Male 42Years
Req. No. :

10-02-2024 11:44:23
HR : 66 bpm
P : 77 ms
PR : 184 ms
QRS : 84 ms
QT/QTcBz : 386/404 ms
P/QRS/T : 66/82/62 °
RV5/SV1 : 1.653/0.932 mV

Diagnosis Information:
Sinus Rhythm
Slight ST Elevation(V4,V5)

Report Confirmed by:

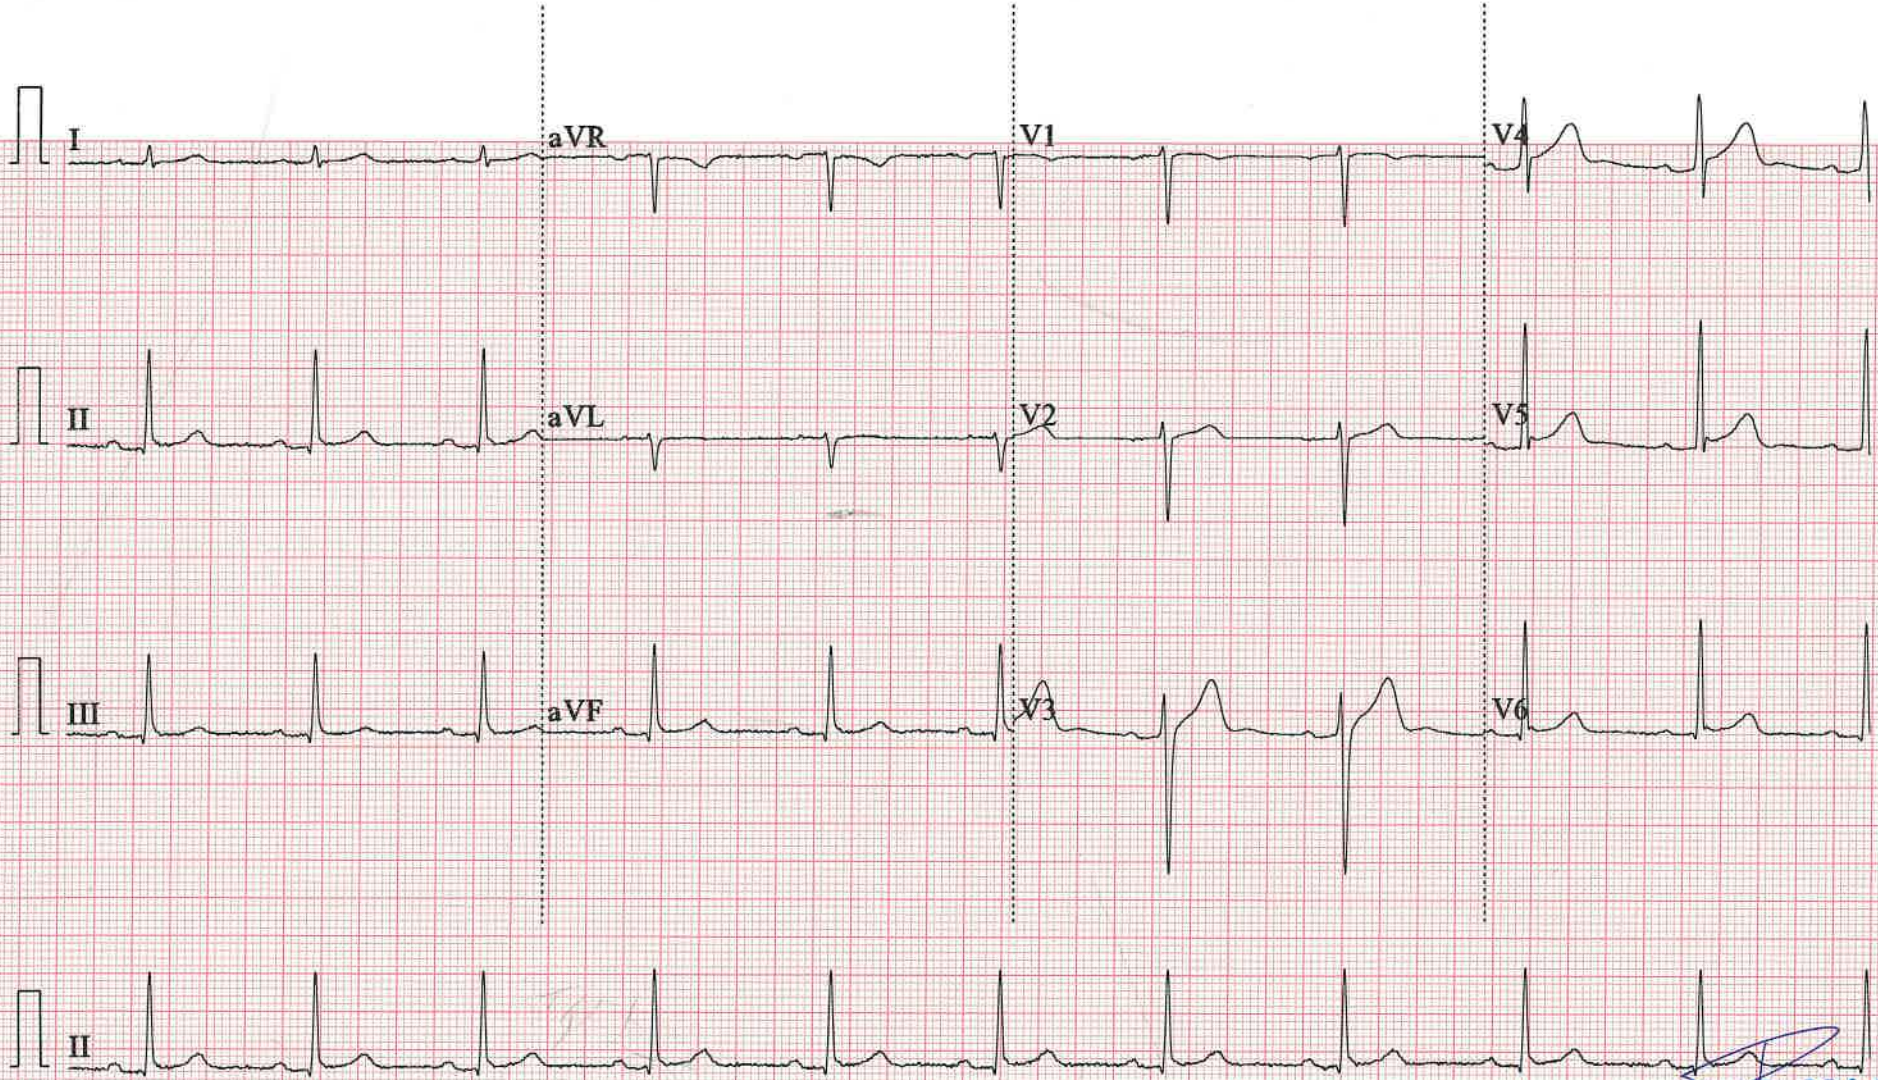

DATE: 10-02-24

NAME: BHUKYA KALU NAIK

AGE: 42/00 ADDRESS: _____

TYPE OF LENS: GLASS CONTACTS

CR POLYCARBONATE

COATINGS : ARC HARD COAT

TINT : White SP2 PHOTO GREY

BIFOCALS : KRYPTOK EXECUTIVE

"D" PROGRESSIVE

	R			L		
	SPH	CYL	AXIS	SPH	CYL	AXIS
DV	<u>-0.25</u>			<u>-0.25</u>		
ADD		<u>+1.50</u>		<u>Both eyes</u>		

INSTRUCTIONS _____

I.P.D. _____ D.V. _____


N.V. _____ CONSTANT USE _____

YODA DIAGNOSTICS CENTRE GUNTUR

Date: 10-02-2024

Time: 12:27

Name: MR.LALU NAICK BHUKYA

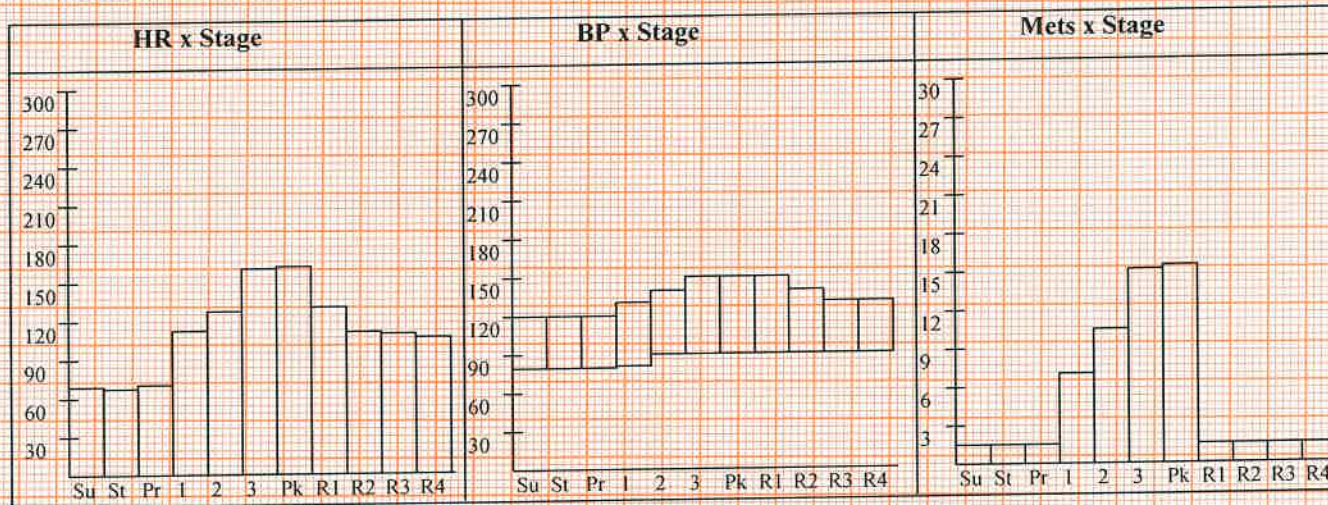

Interpretation

The Patient Exercised according to Bruce Protocol for 0:09:09 achieving a work level of 10.3 METS.
 Resting Heart Rate, initially 69 bpm rose to a max. heart rate of 162bpm (88% of Predicted Maximum Heart Rate).
 Resting Blood Pressure of 120/80 mmHg, rose to a maximum Blood Pressure of 150/90 mmHg
 *NO SIGNIFICANT ST T CHANGES DURING EXERCISE & RECOVERY
 *GOOD EFFORT TOLERANCE
 *TEST IS NEGATIVE FOR EXERCISE INDUCED ISCHEMIA

Ref. Doctor: SELF

Schiller Cardiovit CS-10 Version:3.5

Dr. B. NAGARAJU
 Regd No: 79760 MBBS, M.D, DM
 CONSULTANT CARDIOLOGIST
 YODA DIAGNOSTICS-GUNTUR

YODA DIAGNOSTICS CENTRE GUNTUR

Date: 10-02-2024

Time: 12:27

Name: MR.LALU NAICK BHUKYA

Age: 42

Gender: M

Height: 174 cms

Weight: 58 Kg

ID: 53931

Clinical History: NO

Medications: NO

Test Details:

Protocol: Bruce

Predicted Max HR: 184

Target HR: 156 (85% of Pr. MHR)

Exercise Time: 0:09:09

Achieved Max HR: 162 (88% of Pr. MHR)

Max BP: 150/90

Max BP x HR: 24300

Max Mets: 10.3

Test Termination Criteria:

Protocol Details:

Stage Name	Stage Time	METS	Speed kmph	Grade %	Heart Rate bpm	BP mmHg	RPP	ST Level mm	ST Slope mV/S
Supine	00:07	1	0	0	69	120/80	8280	2.3 V3	0.8 V3
Standing	00:11	1	0	0	68	120/80	8160	2.5 V3	0.7 V3
PreTest	00:07	1	1.6	0	71	120/80	8520	2 V3	0.6 V3
Stage: 1	03:00	4.7	2.7	10	113	130/80	14690	2 V3	0.9 V3
Stage: 2	03:00	7	4	12	128	140/90	17920	2 V3	1.2 V3
Stage: 3	03:00	10.1	5.5	14	161	150/90	24150	2.7 V3	2.2 V3
Peak Exercise	00:09	10.3	6.8	16	162	150/90	24300	2.7 V3	2.4 V3
Recovery1	01:00	1	0	0	130	150/90	19500	3.7 V3	3.1 V3
Recovery2	01:00	1	0	0	111	140/90	15540	3.3 V3	2.9 V3
Recovery3	01:00	1	0	0	109	130/90	14170	2.7 V3	2.1 V3
Recovery4	00:02	1	0	0	107	130/90	13910	2.4 V3	1.8 V3

YODA DIAGNOSTICS CENTRE GUNTUR

MR.LALU NAICK BHUKYA (42 M)
ID: 53931

Date: 10-02-2024

Exec Time : 0:00:00

Stage Time: 00:07

HR: 69 bpm

Bruce Protocol

Stage: Supine

Speed: 0 km/h

Slope: 0%

THR: 156 bpm

BP: 120/80 mmHg

STLevel(mm) STSlope(mV/s)

STLevel(mm) STSlope(mV/s)



YODA DIAGNOSTICS CENTRE GUNTUR

MR.LALU NAICK BHUKYA (42 M)

ID: 53931

Date: 10-02-2024

Exec Time : 0:00:00

Stage Time: 00:11

HR: 68 bpm

Bruce Protocol

Stage: Standing

Speed: 0

Slope: 0 %

THR: 156 bpm

BP: 120/80 mmHg

STLevel(mm) STSlope(mV/s)

STLevel(mm) STSlope(mV/s)

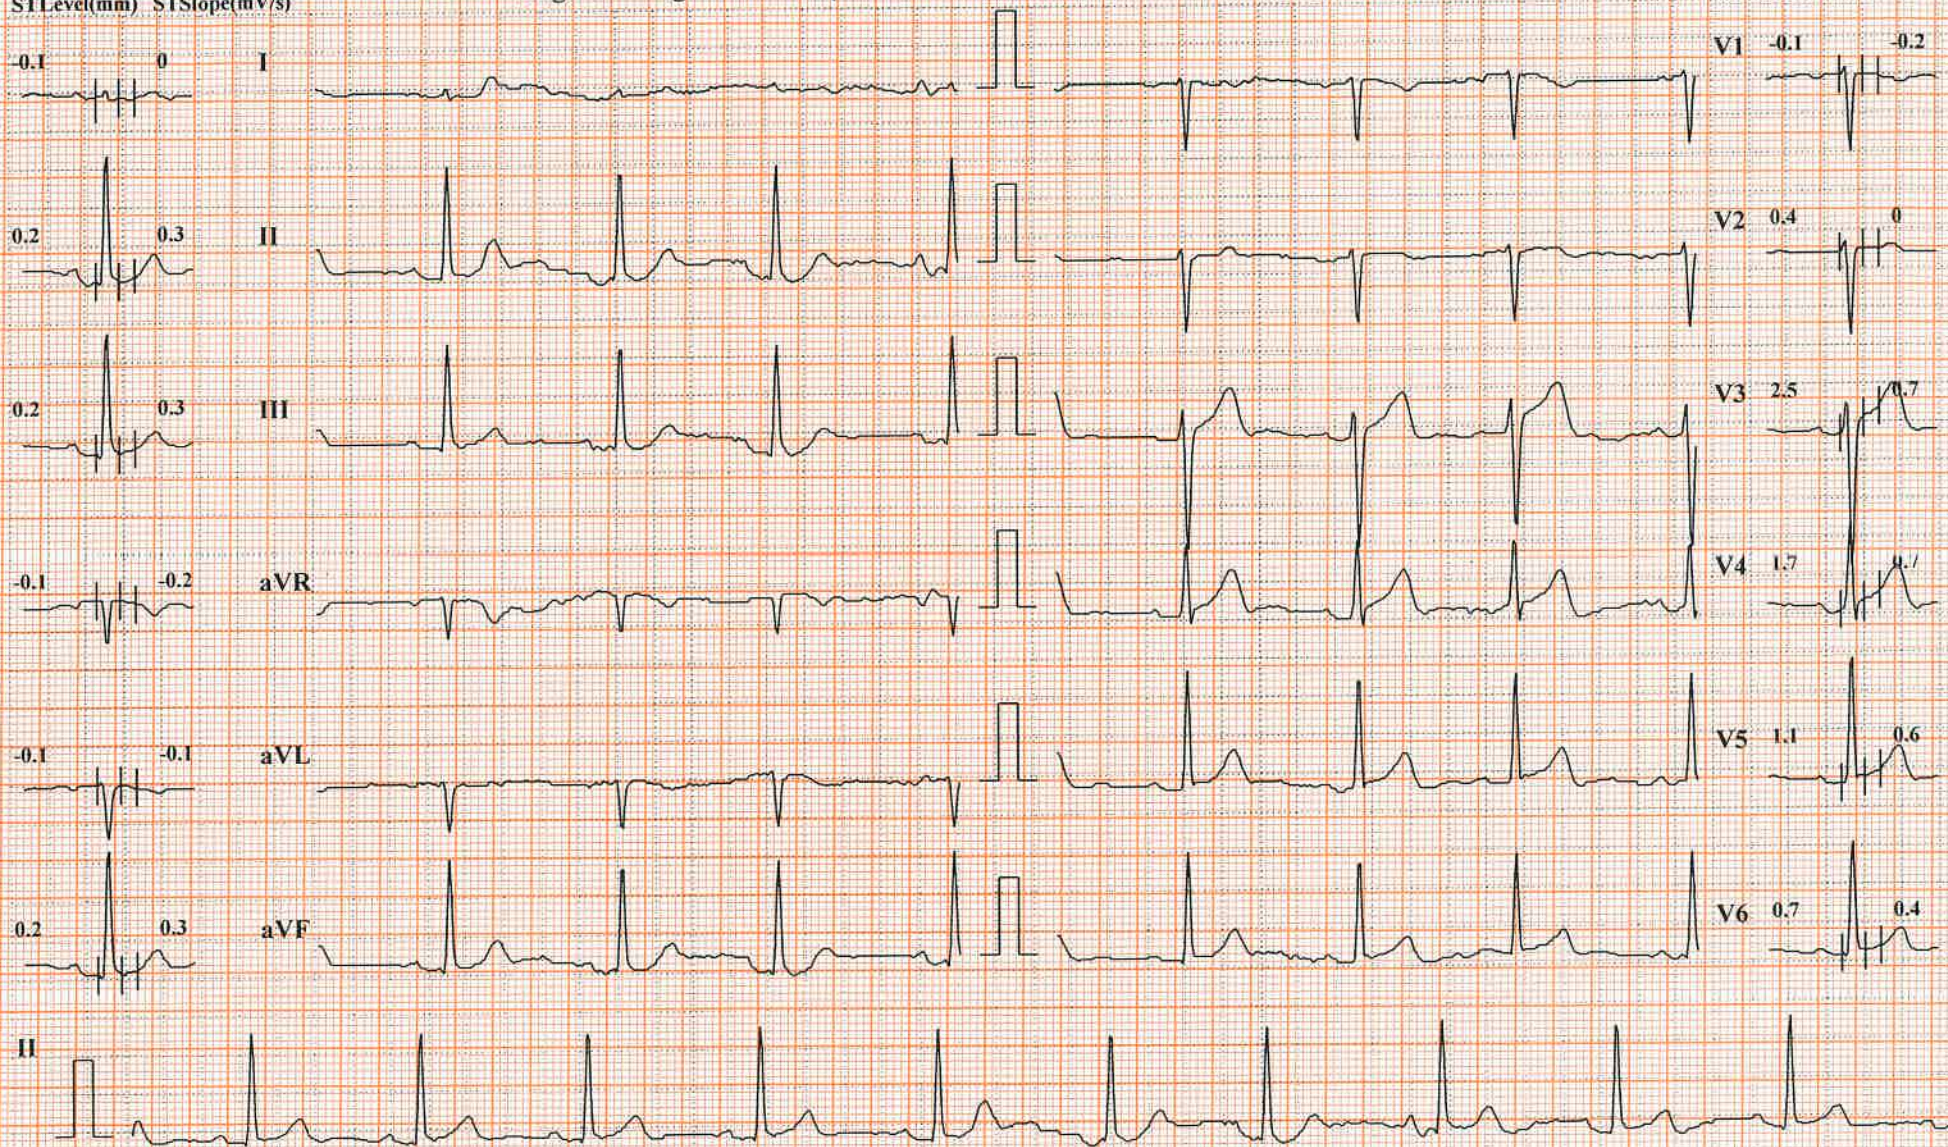


Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 25 Hz Mains Filter: ON

ISO = R - 60 ms, J = R + 60 ms, Post J = J + 80 ms

Schiller Cardiovit CS-10 Version: 3.5

YODA DIAGNOSTICS CENTRE GUNTUR

MR.LALU NAICK BHUKYA (42 M)

Bruce Protocol

ID: 53931

Date: 10-02-2024

Exec Time : 0:03:00

Stage Time: 03:00

HR: 113 bpm

BP: 130/80 mmHg

Stage: I

Speed: 2.7 kmph

Slope: 10 %

THR: 156 bpm

STLevel(mm) STSlope(mV/s)

STLevel(mm) STSlope(mV/s)

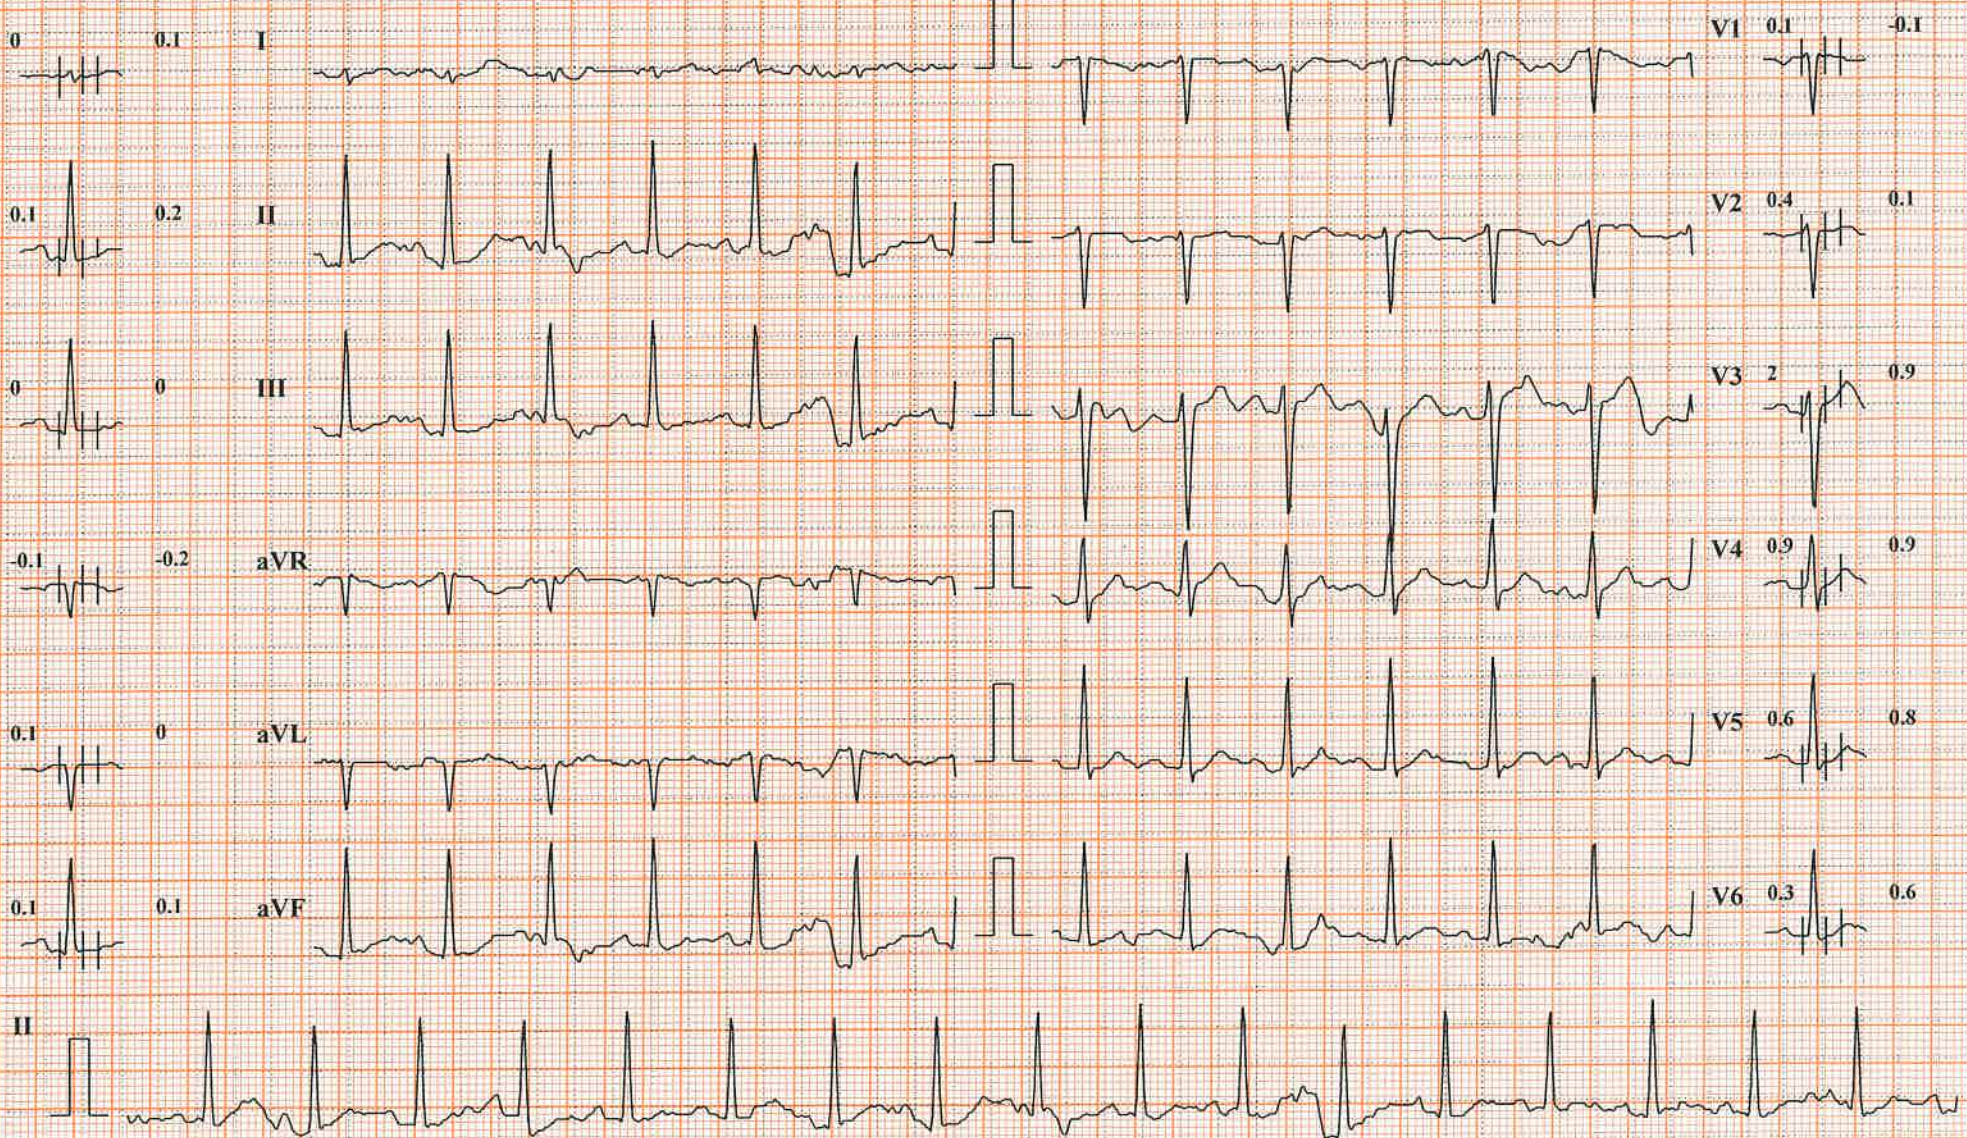


Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 25 Hz Mains Filter: ON

ISO = R - 60 ms, J = R + 60 ms, Post J = J + 80 ms

Schiller Cardiovit CS-10 Version:3.5

YODA DIAGNOSTICS CENTRE GUNTUR

MR.LALU NAICK BHUKYA (42 M)

ID: 53931

Date: 10-02-2024

Exec Time : 0:06:00

Stage Time: 03:00

HR: 128 bpm

Bruce Protocol

Stage: 2

Speed: 4 kmph

Slope: 12 %

THR: 156 bpm

BP: 140/90 mmHg

STLevel(mm) STSlope(mV/s)

STLevel(mm) STSlope(mV/s)

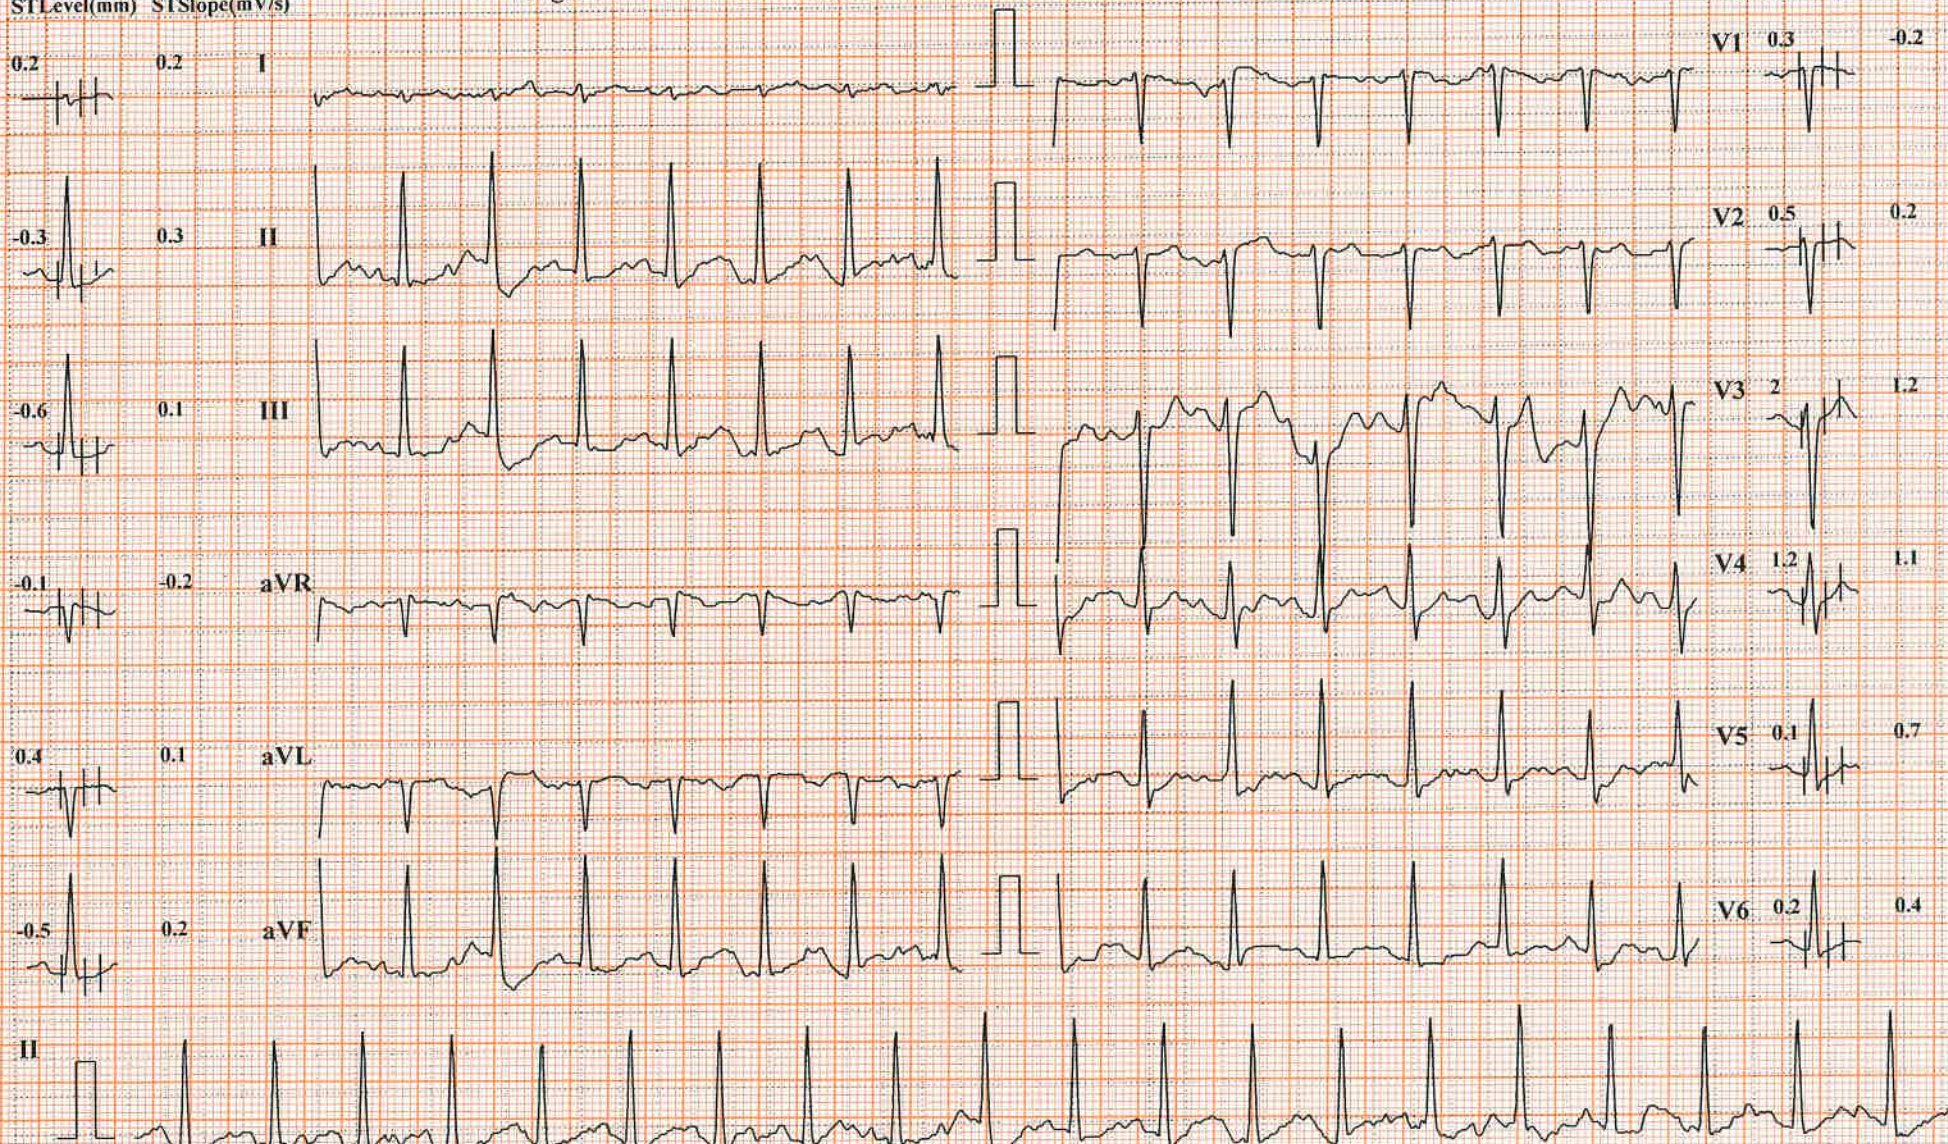


Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 25 Hz Mains Filter: ON

ISO = R - 60 ms, J = R + 60 ms, Post J = J + 80 ms

Schiller Cardiovit CS-10 Version 3.5

YODA DIAGNOSTICS CENTRE GUNTUR

MR.LALU NAICK BHUKYA (42 M)

ID: 53931

Date: 10-02-2024

Exec Time : 0:09:00

Stage Time: 03:00

HR: 161 bpm

Bruce Protocol

Stage: 3

Speed: 5.5 kmph

Slope: 14 %

THR: 156 bpm

BP: 150/90 mmHg

STLevel(mm) STSlope(mV/s)

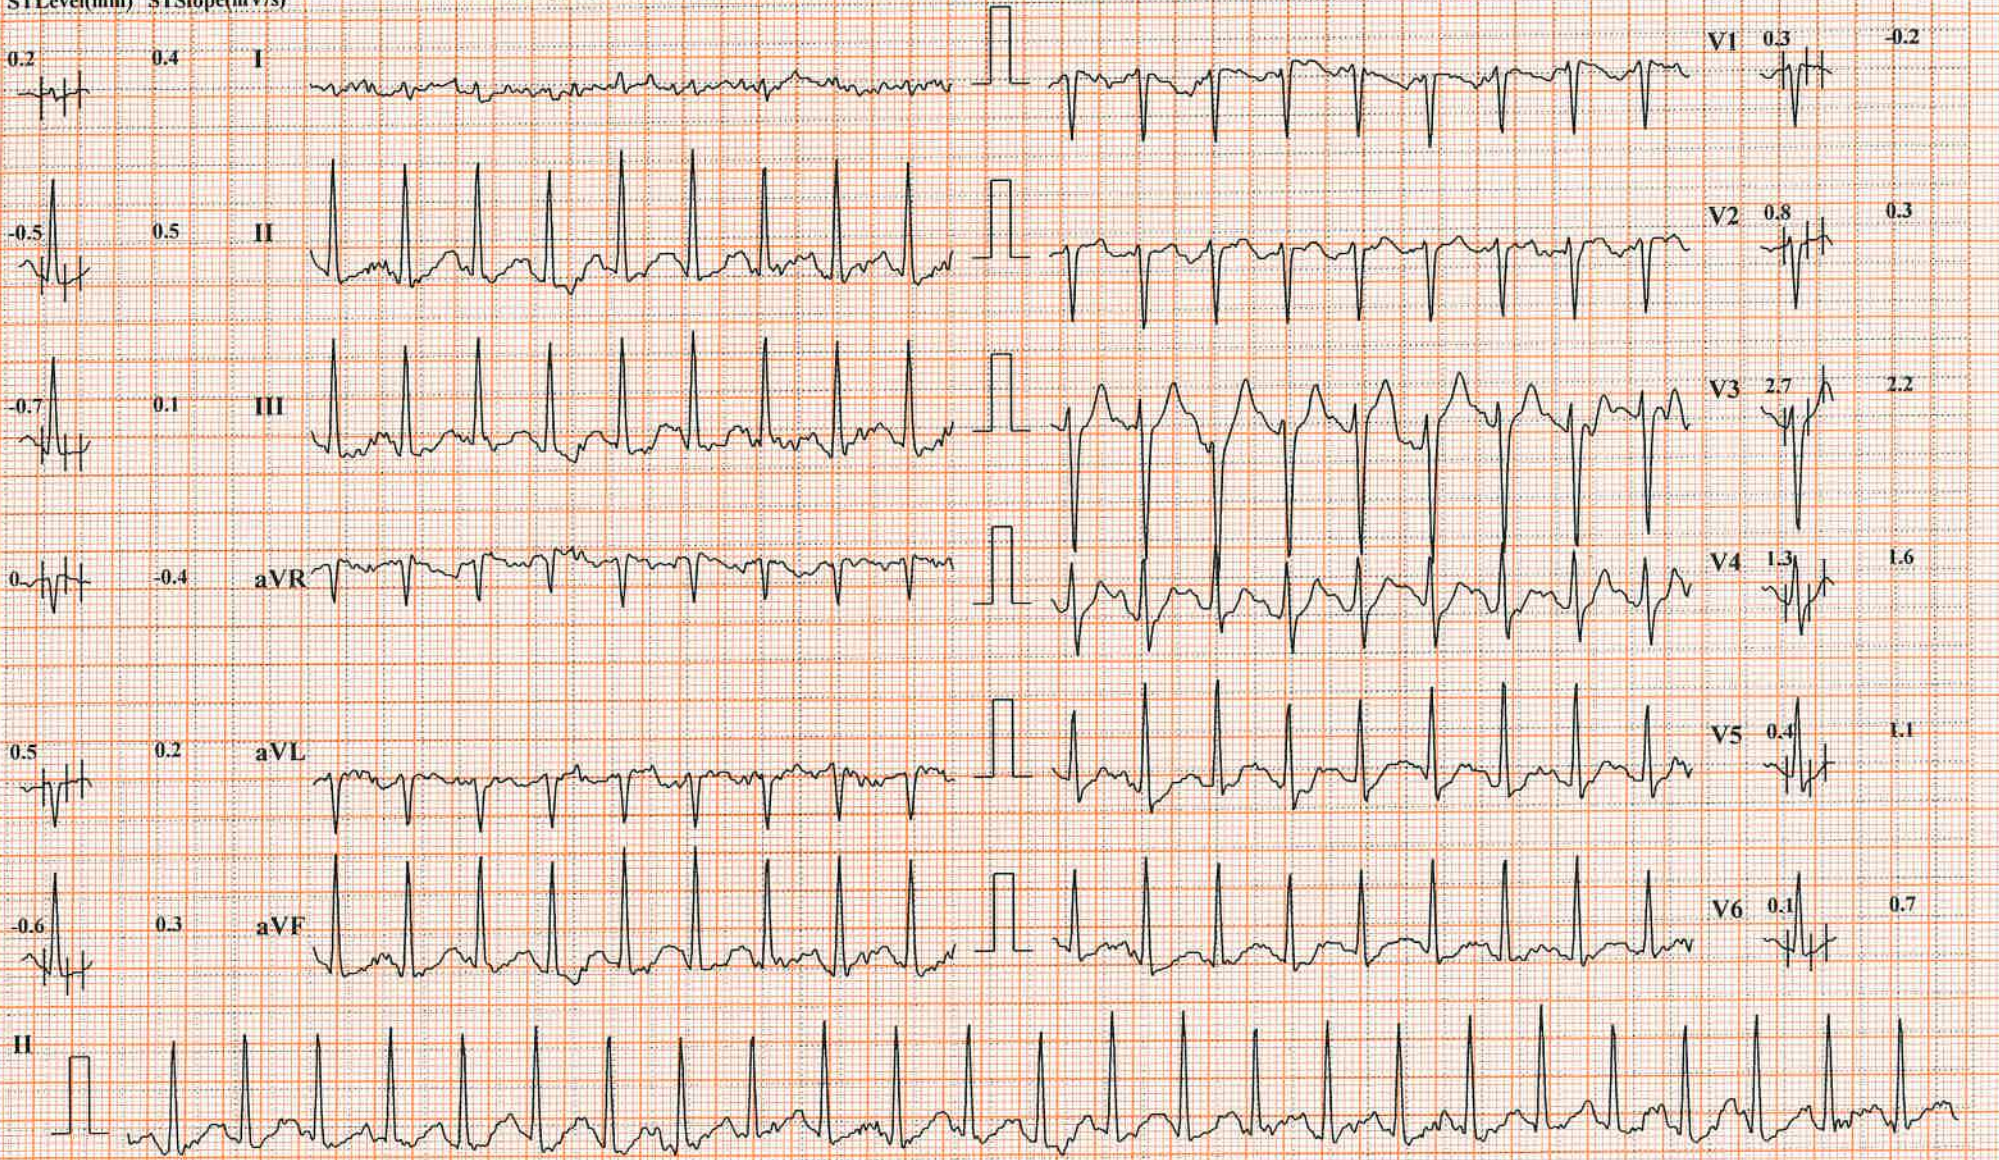


Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 25 Hz Mains Filter: ON

ISO = R - 60 ms, J = R + 60 ms, Post J = J + 80 ms

Schiller Cardiovit CS-10 Version:3.5

YODA DIAGNOSTICS CENTRE GUNTUR

MR.LALU NAICK BHUKYA (42 M)
ID: 53931

Date: 10-02-2024

Exec Time : 0:09:09

Stage Time: 00:09

HR: 162 bpm

Bruce Protocol

Stage: 4 Peak Exercise

Speed: 6.8 kmph

Slope: 16 %

THR: 156 bpm

BP: 150/90 mmHg

STLevel(mm) STSlope(mV/s)



YODA DIAGNOSTICS CENTRE GUNTUR

MR.LALU NAICK BHUKYA (42 M)

Bruce Protocol

ID: 53931

Date: 10-02-2024

Exec Time : 00:00

Stage Time: 01:00

HR: 130 bpm

Stage: Recovery I

Speed: 0 kmph

Slope: 0 %

THR: 156 bpm

BP: 150/90 mmHg

STLevel(mm) STSlope(mV/s)

STLevel(mm) STSlope(mV/s)

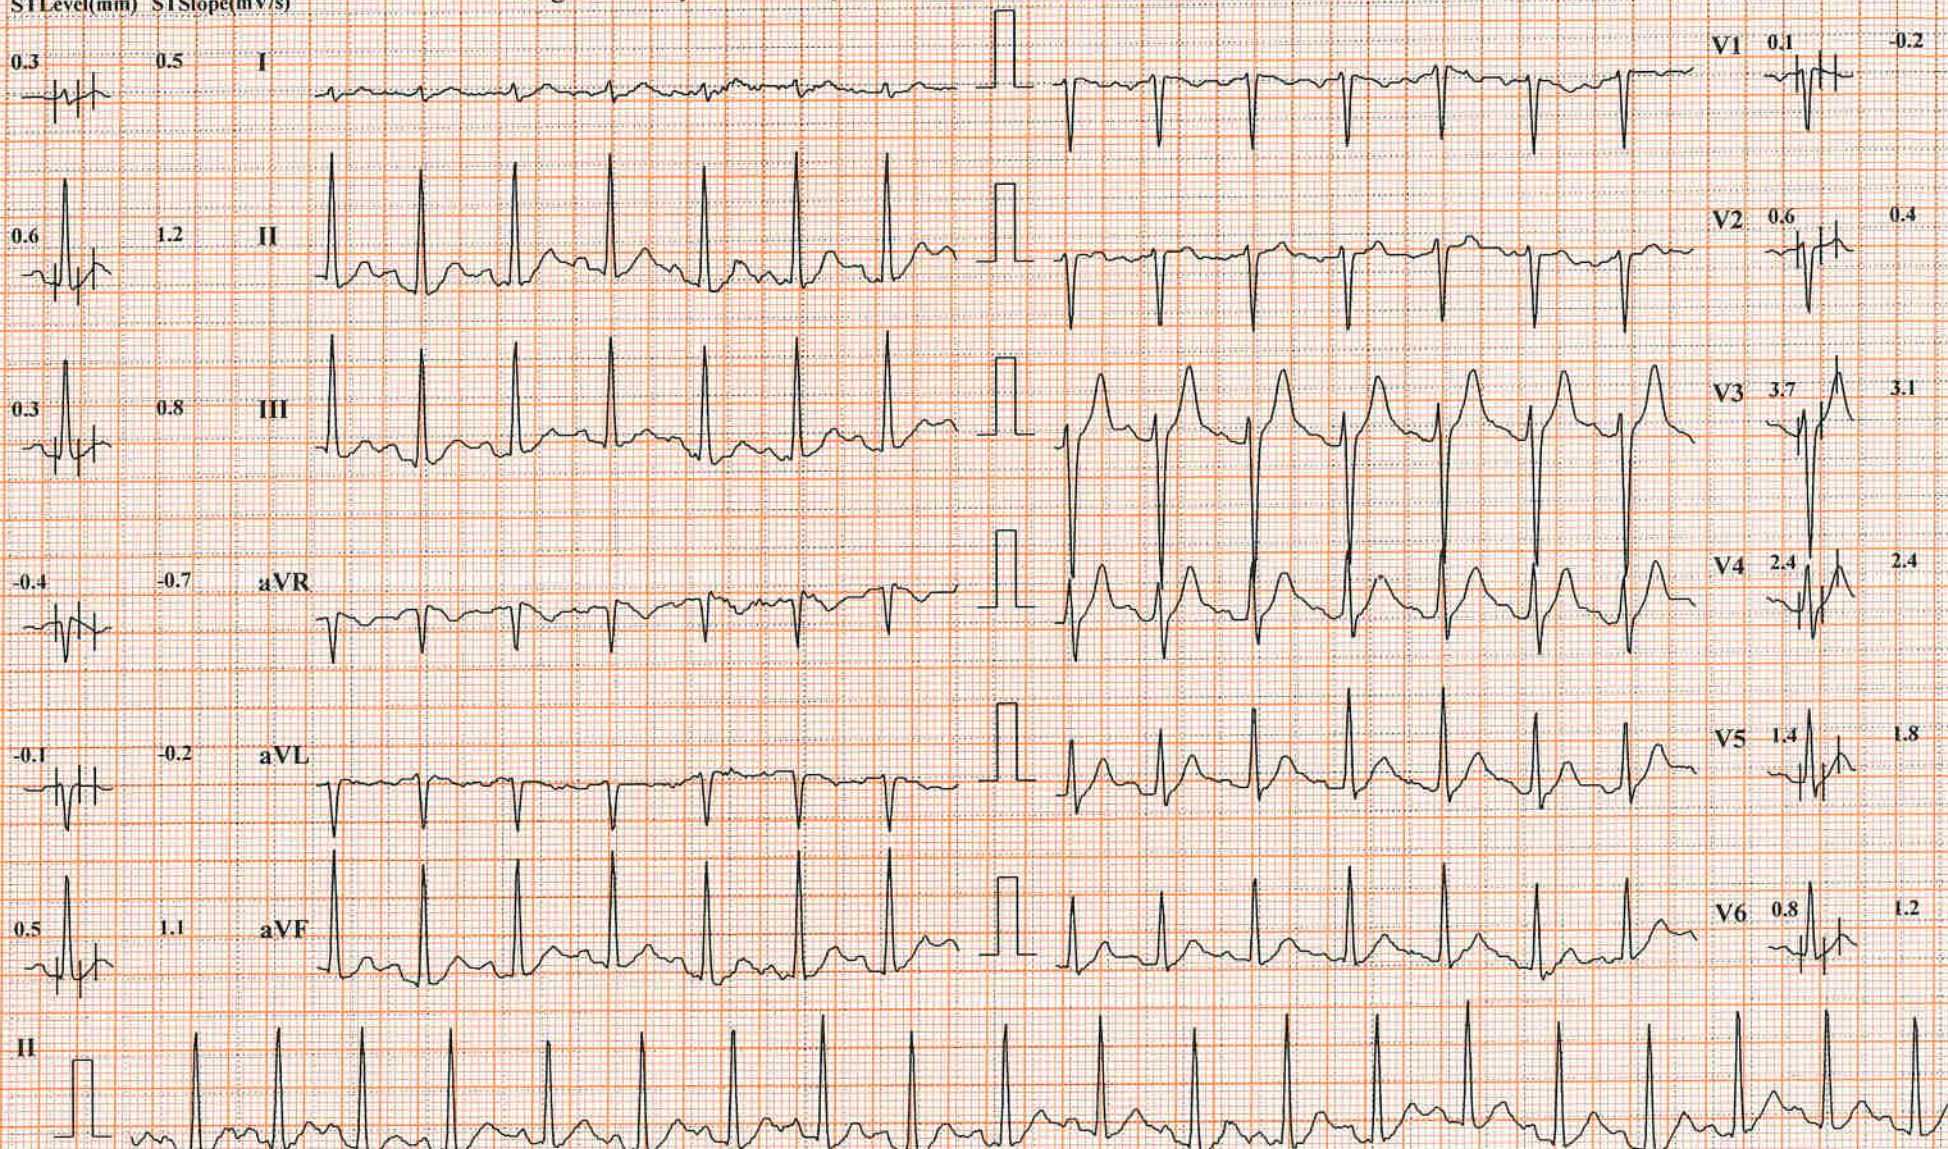


Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 25 Hz Mains Filter: ON

ISO = R - 60 ms, J = R + 60 ms, Post J = J + 80 ms

Schiller Cardiovit CS-10 Version:3.5

YODA DIAGNOSTICS CENTRE GUNTUR

MR.LALU NAICK BHUKYA (42 M)

ID: 53931

Date: 10-02-2024

Exec Time : 00:00

Stage Time: 01:00

HR: 111 bpm

Bruce Protocol

Stage: Recovery2

Speed: 0 kmph

Slope: 0 %

THR: 156 bpm

BP: 140/90 mmHg

STLevel(mm) STSlope(mV/s)

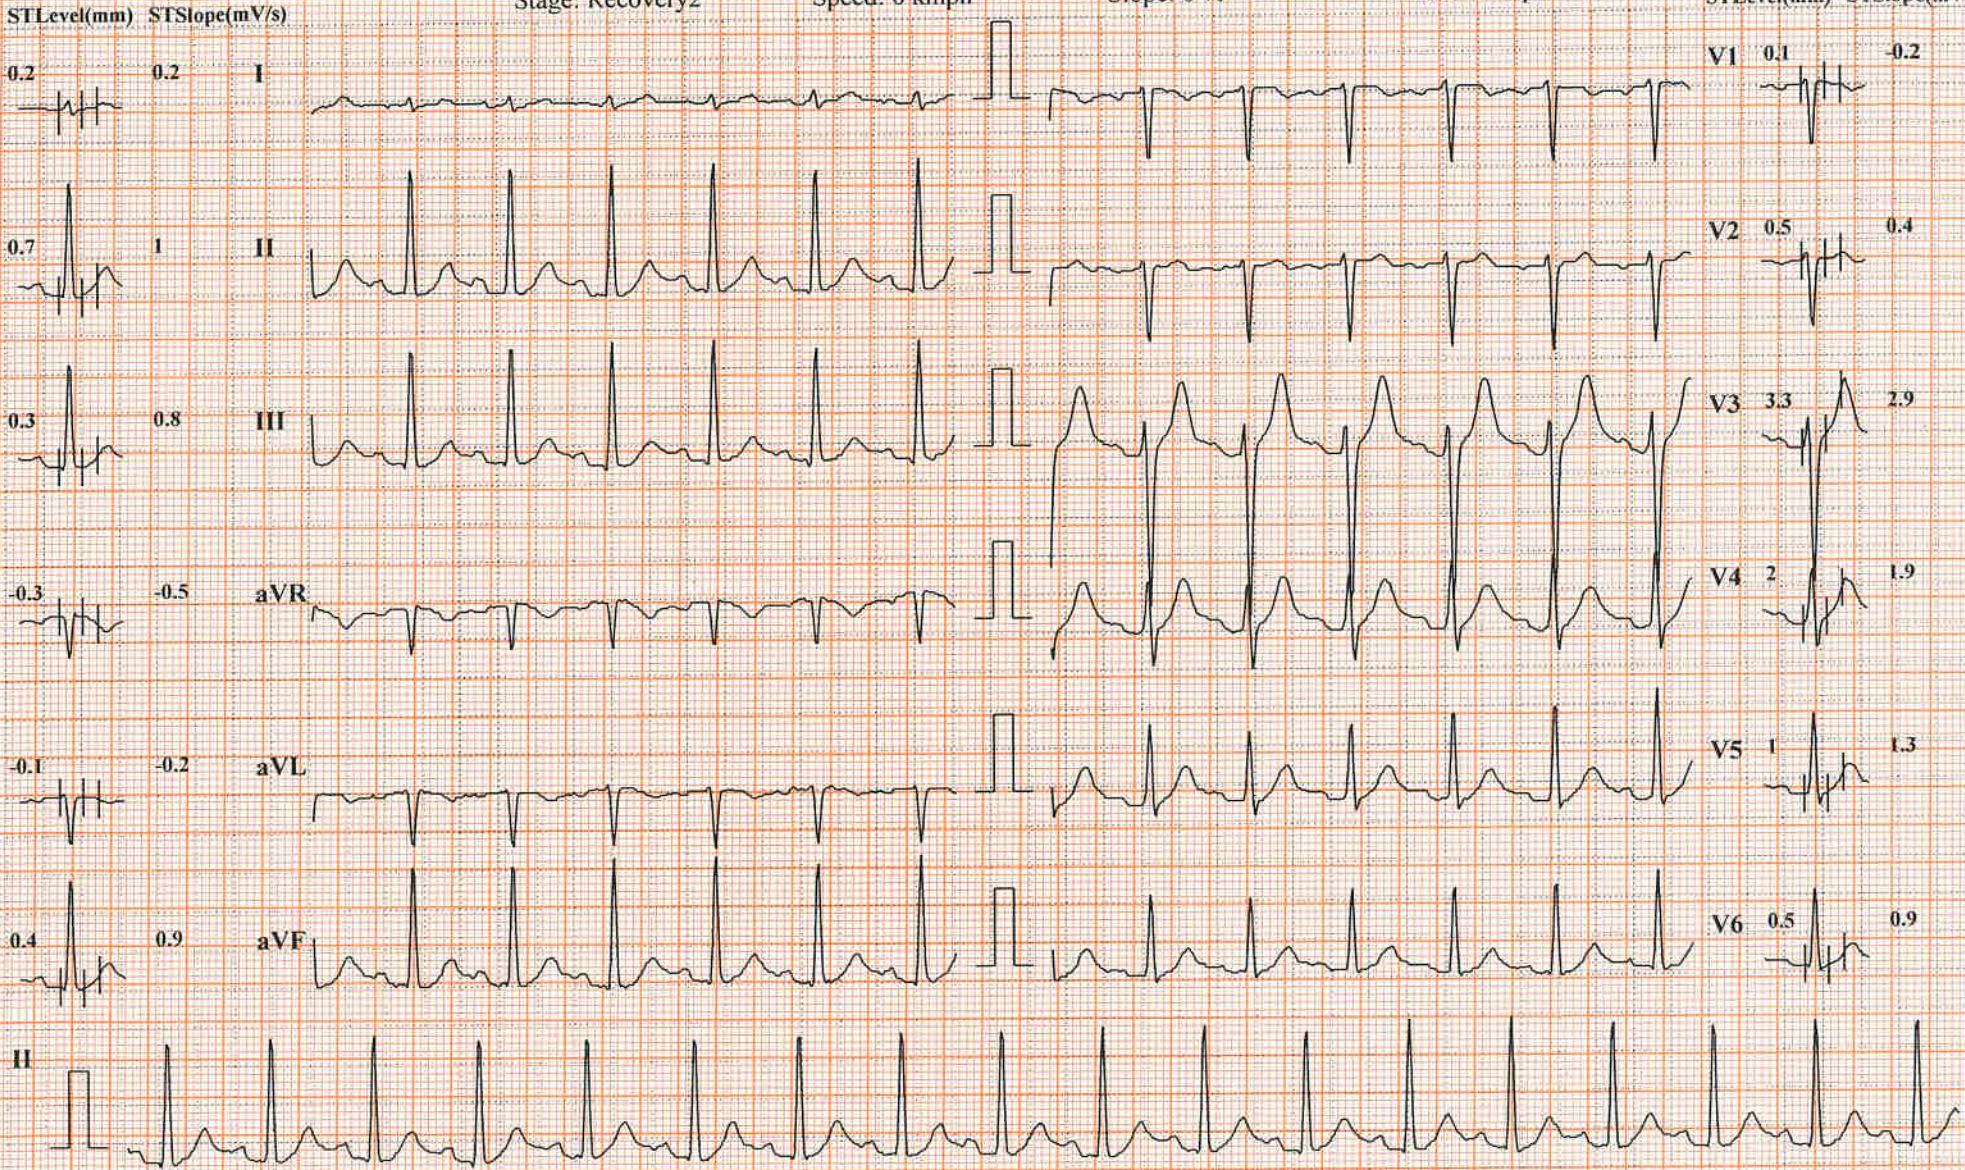


Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 25 Hz Mains Filter: ON

ISO = R - 60 ms, J = R + 60 ms, Post J = J + 80 ms

Schiller Cardiovit CS-10 Version 3.5

YODA DIAGNOSTICS CENTRE GUNTUR

MR.LALU NAICK BHUKYA (42 M)

ID: 53931

Date: 10-02-2024

Exec Time : 00:00

Stage Time: 01:00

HR: 109 bpm

Bruce Protocol

Stage: Recovery3

Speed: 0 kmph

Slope: 0 %

THR: 156 bpm

BP: 130/90 mmHg

STLevel(mm) STSlope(mV/s)

STLevel(mm) STSlope(mV/s)



Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 25 Hz Mains Filter: ON

ISO = R - 60 ms. J = R + 60 ms. Post J = J + 80 ms

Schiller Cardiovit CS-10 Version 3.5

MICRO MED CHARTS

YODA DIAGNOSTICS CENTRE GUNTUR

MR.LALU NAICK BHUKYA (42 M)

Bruce Protocol

ID: 53931

Date: 10-02-2024

Exec Time : 00:00

Stage Time: 00:02

HR: 107 bpm

Stage: Recovery4

Speed: 0 kmph

Slope: 0 %

THR: 156 bpm

BP: 130/90 mmHg

STLevel(mm) STSlope(mV/s)

STLevel(mm) STSlope(mV/s)

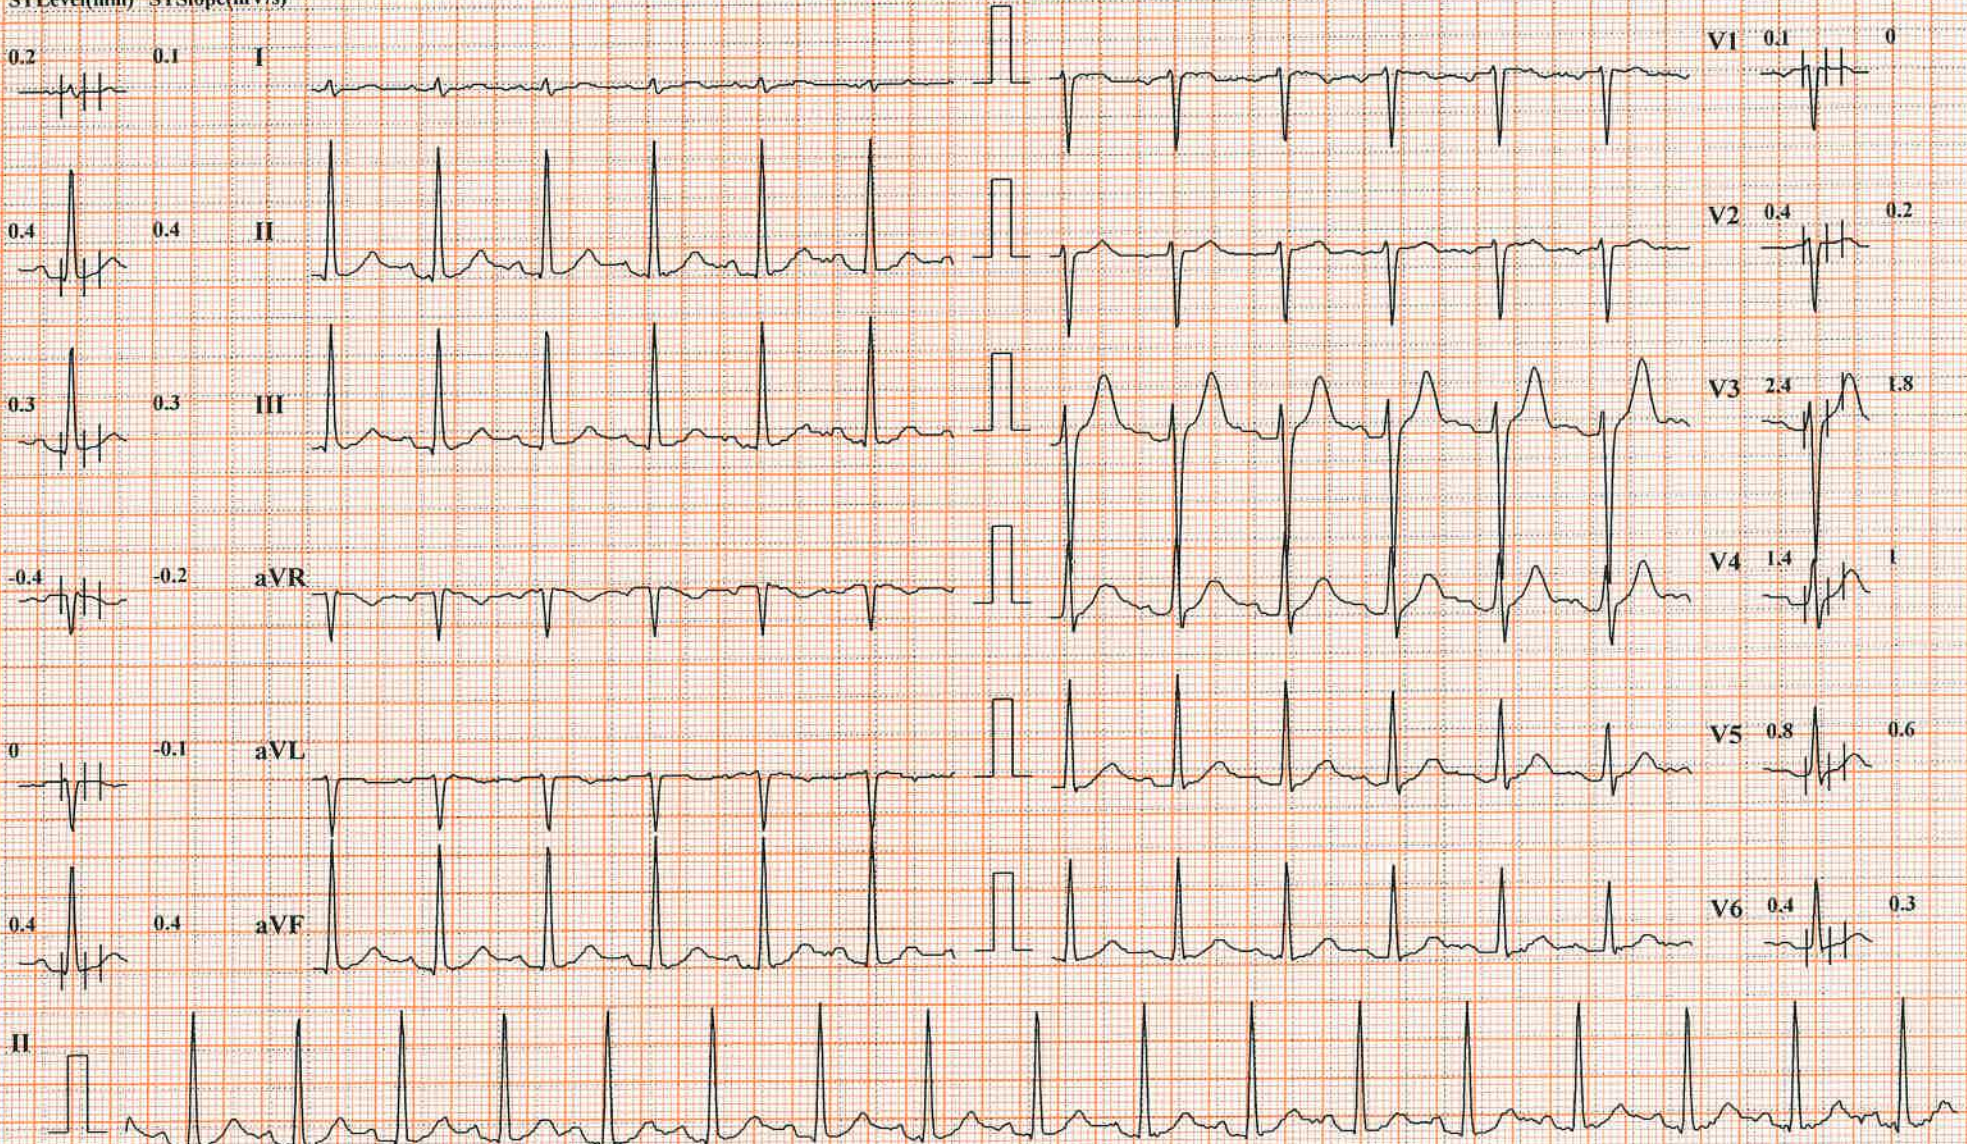


Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 25 Hz Mains Filter: ON


ISO = R - 60 ms, J = R + 60 ms, Post J = J + 80 ms

Schiller Cardiovit CS-10 Version:3.5

YODA
MAGNOSTICS

RECEPTION



 **GPS Map Camera**



Guntur, Andhra Pradesh, India

3-1-219/2, Old Club Rd, Gunturi Vari Thota, Kothapeta, Guntur, Andhra Pradesh 522001, India

Lat 16.299239°

Long 80.451623°

10/02/24 08:31 AM GMT +05:30