



భారత విశిష్ట గుర్తింపు ప్రాధికార సంస్థ

భారత ప్రభుత్వం
Unique Identification Authority of India
Government of India


రిజిస్ట్రేషన్/ Enrolment No.: 0623/02031/13237

Government Date: 23/09/2018

To
అంకల వెంకటేశ్వర రావు
Ankala Venkateswara Rao
S/O: Piru Dasu
12-11-402
3rd Lane
Ramireddy Thota
Guntur
Kothapeta(guntur)
Guntur Andhra Pradesh - 522001
9705817062

Generation Date: 08/09/2018

Signature valid



QR Code with Photograph

మీ ఆధార్ సంఖ్య / Your Aadhaar No. :

3040 8909 6077

నా ఆధార్, నా గుర్తింపు



భారత ప్రభుత్వం
Government of India



అంకల వెంకటేశ్వర రావు
Ankala Venkateswara Rao
పుట్టిన తేదీ/DOB: 14/03/1985
పులిమడు/ MALE

3040 8909 6077

నా ఆధార్, నా గుర్తింపు



Government of India



AADHAAR

సమాచారం

- ఆధార్ గుర్తింపుకు ధృవీకరణ, చారిత్రాత్మకంగా కాదు.
- గుర్తింపుకు ధృవీకరణ ఆన్‌లైన్ అథెంటికేషన్ ద్వారా సాధ్యమవుతుంది.
- ఇది ఎలక్ట్రానిక్ పద్ధతిలో వ్రాయబడిన లేఖ.

INFORMATION

- Aadhaar is a proof of identity, not of citizenship.
- To establish identity, authenticate online.
- This is electronically generated letter.


- ఆధార్ దేశమంతటా అమోదించబడుతుంది.
- ఆధార్ భవిష్యత్తులో ప్రభుత్వ మరియు ప్రభుత్వేతర సేవలు అందజేయడంలో సహాయ పడుతుంది.
- Aadhaar is valid throughout the country.
- Aadhaar will be helpful in availing Government and Non-Government services in future.



భారత విశిష్ట గుర్తింపు ప్రాధికార సంస్థ
Unique Identification Authority of India

చిరునామా:
అంకల వెంకటేశ్వర రావు / అల్లి వెంకటేశ్వర రావు, 12-11-402, 3వ లైన్,
రామిరెడ్డి తోట, గుంటూరు, గుంటూరు,
ఆంధ్ర ప్రదేశ్ - 522001

Address:
S/O: Piru Dasu, 12-11-402, 3rd Lane,
Ramireddy Thota, Guntur, Guntur,
Andhra Pradesh - 522001



QR Code with Photograph

3040 8909 6077



helpdesk@uidai.gov.in

www.uidai.gov.in

Mr. Venkateswara Rao 39 years / male
is not willing to give Blood. So, we
are not doing the blood tests.

Anantatejwaram.



ID: 99763
VENKATESWARA RAO
Male 39Years
Req. No. :

28-09-2024 12:36:19
HR : 76 bpm
P : 94 ms
PR : 128 ms
QRS : 87 ms
QT/QTcBz : 354/399 ms
P/QRS/T : 63/71/68 °
RV5/SV1 : 2.072/1.434 mV

Diagnosis Information:
Sinus Rhythm
Normal ECG

Report Confirmed by:



Dr. B. NAGARAJU
Regd. No. 76760 MBBS, M.D, DM
CONSULTANT CARDIOLOGIST
YODA DIAGNOSTICS-GUNTUR

Name: Venkateswara Rao
Date: 28/09/24 Age: 39 years Sex: Male
Address: Guntur



Came for Routine Health
checkup.

Cl: Epigastric Pain ⊕
Numbness of BL lower limbs.

USG Abdomen:-
Cholelithiasis - 7mm

FLA
5 days ⊕

- Rx
1. CAP PP Block DSR. plo 00
1-0-0 - (30)
 2. CAP J power plo Hls
0-0-1 - (30)
 3. Tab CIABAPIN - NT plo Hls
0-0-1 - (10)
 4. SYP SUCROL - 0 10ml plo
TID 1-1-1
flb BO 1-0-1

TEMP:
B.P: 120/80 mmHg
PULSE: 74 bps
WEIGHT: 74 kgs
HEIGHT: 161 cm

DR. KEERTHI KISHORE NAGALLA
Regd.No: 64905 MD, M.D. General Medicine
CONSULTANT GENERAL PHYSICIAN
YODA DIAGNOSTICS-GUNTUR

Keerthi

DATE: 28-09-24

NAME: Venkateshwar Rao

AGE: 39/40 ADDRESS: _____

TYPE OF LENS: GLASS CONTACTS

CR POLYCARBONATE

COATINGS : ARC HARD COAT

TINT: : White SP2 PHOTO GREY

BIFOCALS : KRYPTOK EXECUTIVE

"D" PROGRESSIVE

	R			L		
	SPH	CYL	AXIS	SPH	CYL	AXIS
DV	- 4.25			- 4.40		
ADD						

INSTRUCTIONS Blue coat

I.P.D. _____ D.V. 17 - 4.25
1100

N.V. _____ CONSTANT USE _____

SRF ID: 35E7067

Visit ID	: YGT99763	UHID/MR No	: YGT.0000099394
Patient Name	: Mr. VENKATESWARA RAO	Client Code	: YOD-DL-0021
Age/Gender	: 39 Y 0 M 0 D /M	Barcode No	: 11263238
DOB	:	Registration	: 28/Sep/2024 09:38AM
Ref Doctor	: SELF	Collected	: 28/Sep/2024 09:38AM
Client Name	: MEDI WHEELS	Received	:
Client Add	: F-701, Lado Sarai, Mehravli, N	Reported	: 28/Sep/2024 12:30PM
Hospital Name	:		

DEPARTMENT OF RADIOLOGY**ULTRASOUND WHOLE ABDOMEN****Clinical Details :** General check-up.**LIVER :** Normal in size and echo-texture. No focal lesion is seen. Intra hepatic biliary channels are not dilated.**GALL BLADDER :** Normally distended. **Few calculi noted, largest 7 mm.****CBD :** Normal.

Visualised common bile duct & portal vein appears normal.

PANCREAS : Normal in size and outlines. Parenchymal texture normal. No ductal dilatation. No calcifications / calculi.**SPLEEN :** Normal in size and echotexture. No focal lesion is seen.**RIGHT KIDNEY :** measures 5.3 x1.8 cm. Small in size and echogenic.**LEFT KIDNEY :** measures 12.1 x 4.8 cm. Normal in size with smooth contours. Parenchymal texture normal. No focal lesion is seen. Cortico-medullary differentiation well maintained. Collecting system does not show any dilatation or calculus.**URINARY BLADDER :** Well distended. No evidence of wall thickening / calculi.**PROSTATE :** Normal in size (volume-12 cc) and normal in echo-texture.

No enlarged nodes are visualised. No retro-peritoneal lesion is identified. Great vessels appear normal.

No free fluid is seen in peritoneal cavity.

IMPRESSION:

- **CHOLELITHIASES (Largest 7mm)**
- **SMALL ECHOGENIC RIGHT KIDNEY.**
For clinical correlation.

Verified By :
HARISCHANDRA PRASAD N

Approved By :


Dr. HARISCHANDRA PRASAD N
MBBS, DNB
CONSULTANT RADIOLOGIST

SRF ID: 35E7067

Visit ID	: YGT99763	UHID/MR No	: YGT.0000099394
Patient Name	: Mr. VENKATESWARA RAO	Client Code	: YOD-DL-0021
Age/Gender	: 39 Y 0 M 0 D /M	Barcode No	: 11263238
DOB	:	Registration	: 28/Sep/2024 09:38AM
Ref Doctor	: SELF	Collected	: 28/Sep/2024 09:38AM
Client Name	: MEDI WHEELS	Received	:
Client Add	: F-701, Lado Sarai, Mehravli, N	Reported	: 28/Sep/2024 02:25PM
Hospital Name	:		

DEPARTMENT OF RADIOLOGY

2D ECHO DOPPLER STUDY

MITRAL VALVE : Normal
AORTIC VALVE : Normal
TRICUSPID VALVE : Normal
PULMONARY VALVE : Normal
RIGHT ATRIUM : Normal
RIGHT VENTRICLE : Normal
LEFT ATRIUM : 3.2 cms
LEFT VENTRICLE : EDD : 4.8 cm IVS(d) : 0.7cm LVEF : 65%
ESD : 3.1 cm PW (d) : 0.7cm FS : 35%
No RWMA
IAS : Intact
IVS : Intact
AORTA : 2.8cms
PULMONARY ARTERY : Normal
PERICARDIUM : Normal
IVS/ SVC/ CS : Normal
PULMONARY VEINS : Normal
INTRA CARDIAC MASSES : No

Verified By :
B NAGARAJU



Approved By :


Dr. B. Nagaraju
MD (Internal Medicine)
DN (CARDIOLOGY)
APNC Reg. No 70760

SRF ID: 35E7067

Visit ID	: YGT99763	UHID/MR No	: YGT.0000099394
Patient Name	: Mr. VENKATESWARA RAO	Client Code	: YOD-DL-0021
Age/Gender	: 39 Y 0 M 0 D /M	Barcode No	: 11263238
DOB	:	Registration	: 28/Sep/2024 09:38AM
Ref Doctor	: SELF	Collected	: 28/Sep/2024 09:38AM
Client Name	: MEDI WHEELS	Received	:
Client Add	: F-701, Lado Sarai, Mehravli, N	Reported	: 28/Sep/2024 02:25PM
Hospital Name	:		

DEPARTMENT OF RADIOLOGY

DOPPLER STUDY :

MITRAL FLOW : E - 0.8m/sec, A -0.4 m/sec.
AORTIC FLOW : 1.0m/sec
PULMONARY FLOW : 0.8m/sec
TRICUSPID FLOW : TRJV :1.8 m/sec, RVSP - 28mmHg

COLOUR FLOW MAPPING: TRIVIAL MR/AR/TR/NO PAH

IMPRESSION :


- * NORMAL SIZED CARDIAC CHAMBERS
- * NO RWMA OF LV
- * GOOD LV FUNCTION
- * TRIVIAL MR/AR/TR/NO PAH
- * NO PE / CLOT /VEGETATIONS.


*** End Of Report ***

Verified By :
B NAGARAJU



Approved By :


Dr. B. Nagaraju
MD (Internal Medicine)
DN (CARDIOLOGY)
APNC Reg. No 70760

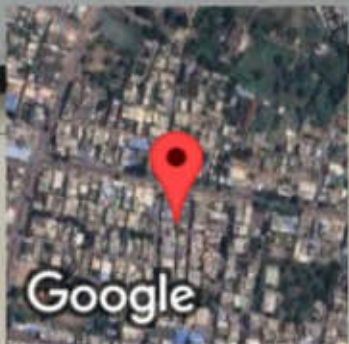

Guntur, Andhra Pradesh, India

3-1-219/2, Old Club Rd, Gunturi Vari Thota, Kothapeta, Guntur, Andhra Pradesh 522001, India

Lat 16.299207°

Long 80.451625°


28/09/24 09:19 AM GMT +05:30

YODA DIAGNOSTICS CENTRE GUNTUR

Name: Mr. VENKATESWARA RAO


Date: 28-09-2024

Time: 12:53

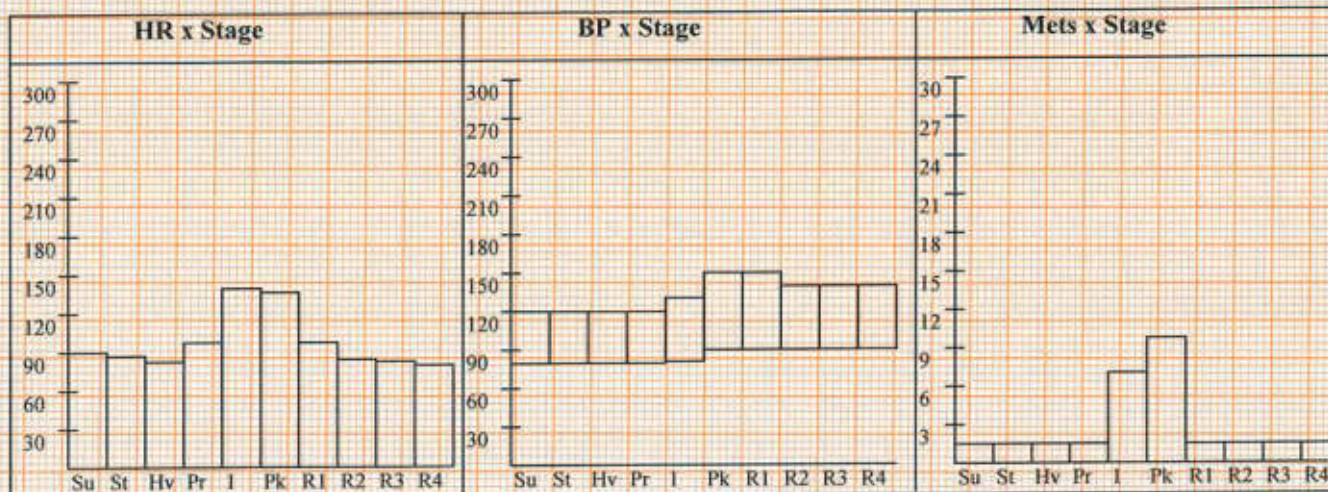

Interpretation

The Patient Exercised according to Bruce Protocol for 0:05:35 achieving a work level of 6.5 METS.
 Resting Heart Rate, initially 90 bpm rose to a max. heart rate of 140bpm (75% of Predicted Maximum Heart Rate).
 Resting Blood Pressure of 120/80 mmHg, rose to a maximum Blood Pressure of 150/90 mmHg
 * No Significant ST-T Changes During Exercise & Recovery
 * Fair Exercise Tolerance
 * THR Not Achieved
 * Patient Complaints Dypsonea.


Dr. B. NAGARAJU
 Regd.No: 70760 MBBS, M.D, DM
CONSULTANT CARDIOLOGIST
YODA DIAGNOSTICS-GUNTUR
 Doctor: DR.B NAGARAJU

Ref. Doctor: SELF

YODA DIAGNOSTICS CENTRE GUNTUR

Name: Mr. VENKATESWARA RAO

Date: 28-09-2024

Time: 12:53

Age: 39

Gender: M

Height: 161 cms

Weight: 44 Kg

ID: 99763

Clinical History: NO

Medications: NO

Test Details:

Protocol: Bruce

Predicted Max HR: 187

Target HR: 158 (85% of Pr. MHR)

Exercise Time: 0:02:57

Achieved Max HR: 140 (75% of Pr. MHR)

Max BP: 150/90

Max BP x HR: 21000

Max Mets: 6.5

Test Termination Criteria:

Protocol Details:

Stage Name	Stage Time	METS	Speed kmph	Grade %	Heart Rate bpm	BP mmHg	RPP	ST Level mm	ST Slope mV/S
Supine	00:20	1	0	0	90	120/80	10800	2.6 V3	1.7 V3
Standing	00:06	1	0	0	87	120/80	10440	2.5 V3	1.6 V3
HyperVentilation	00:07	1	0	0	82	120/80	9840	2.7 V3	1.8 V3
PreTest	00:37	1	1.6	0	97	120/80	11640	18.8 II	-3.1 I
Stage: 1	03:00	4.7	2.7	10	140	130/80	18200	-2 aVR	-2.3 I
Peak Exercise	02:35	6.5	4	12	136	150/90	20400	2.1 V3	2.1 V3
Recovery1	01:00	1	0	0	98	150/90	14700	1.4 V3	2.9 V3
Recovery2	01:00	1	0	0	84	140/90	11760	1.6 V3	1.3 V3
Recovery3	01:00	1	0	0	82	140/90	11480	1.5 V3	0.9 V3
Recovery4	00:04	1	0	0	79	140/90	11060	1.5 V3	1.1 V3

YODA DIAGNOSTICS CENTRE GUNTUR

Mr. VENKATESWARA RAO (39 M)

ID: 99763

Date: 28-09-2024

Excc Time : 0:00:00

Stage Time: 00:20

HR: 90 bpm

Bruce Protocol

Stage: Supine

Speed: 0 km/h

Slope: 0%

TIIR: 158 bpm

BP: 120/80 mmHg

STLevel(mm) STSlope(mV/s)

STLevel(mm) STSlope(mV/s)

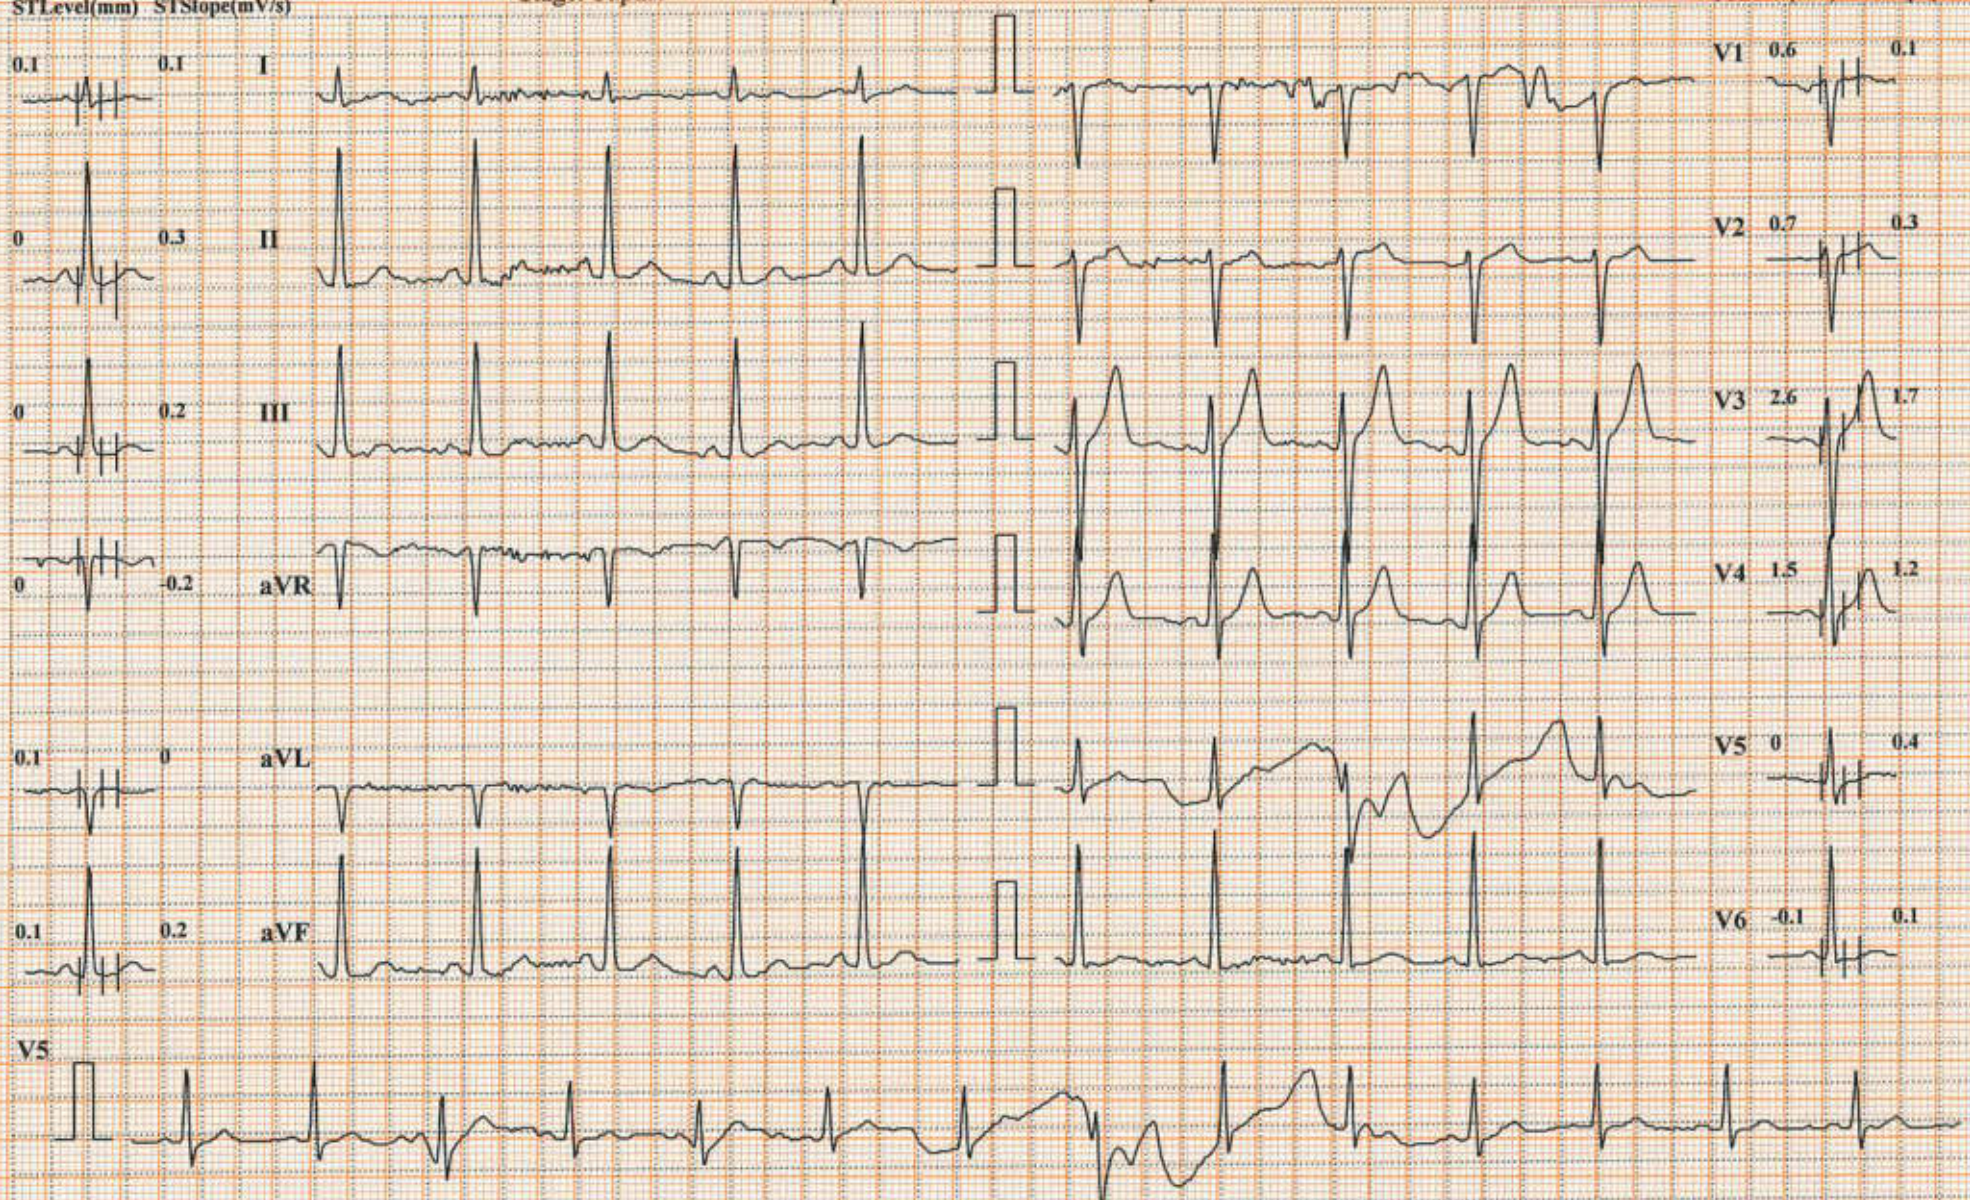


Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 25 Hz Mains Filter: ON

ISO = R - 60 ms, J = R + 60 ms, Post J = J + 80 ms

Schiller Cardiovit CS-10 Version: 3.5

YODA DIAGNOSTICS CENTRE GUNTUR

Mr. VENKATESWARA RAO (39 M)

Bruce Protocol

ID: 99763

Date: 28-09-2024

Exec Time : 0:00:00

Stage Time: 00:06

HR: 87 bpm

BP: 120/80 mmHg

Stage: Standing

Speed: 0

Slope: 0 %

THR: 158 bpm

STLevel(mm) STSlope(mV/s)



Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 25 Hz Mains Filter: ON

ISO = R - 60 ms, J = R + 60 ms, Post J = J + 80 ms

Schiller Cardiovit CS-10 Version:3.5

YODA DIAGNOSTICS CENTRE GUNTUR

Mr. VENKATESWARA RAO (39 M)

ID: 99763

Date: 28-09-2024

Exec Time : 0:00:00

Stage Time: 00:07

HR: 82 bpm

Bruce Protocol

Stage: HyperVentilation

Speed: 0

Slope: 0 %

THR: 158 bpm

BP: 120/80 mmHg

STLevel(mm) STSlope(mV/s)

STLevel(mm) STSlope(mV/s)

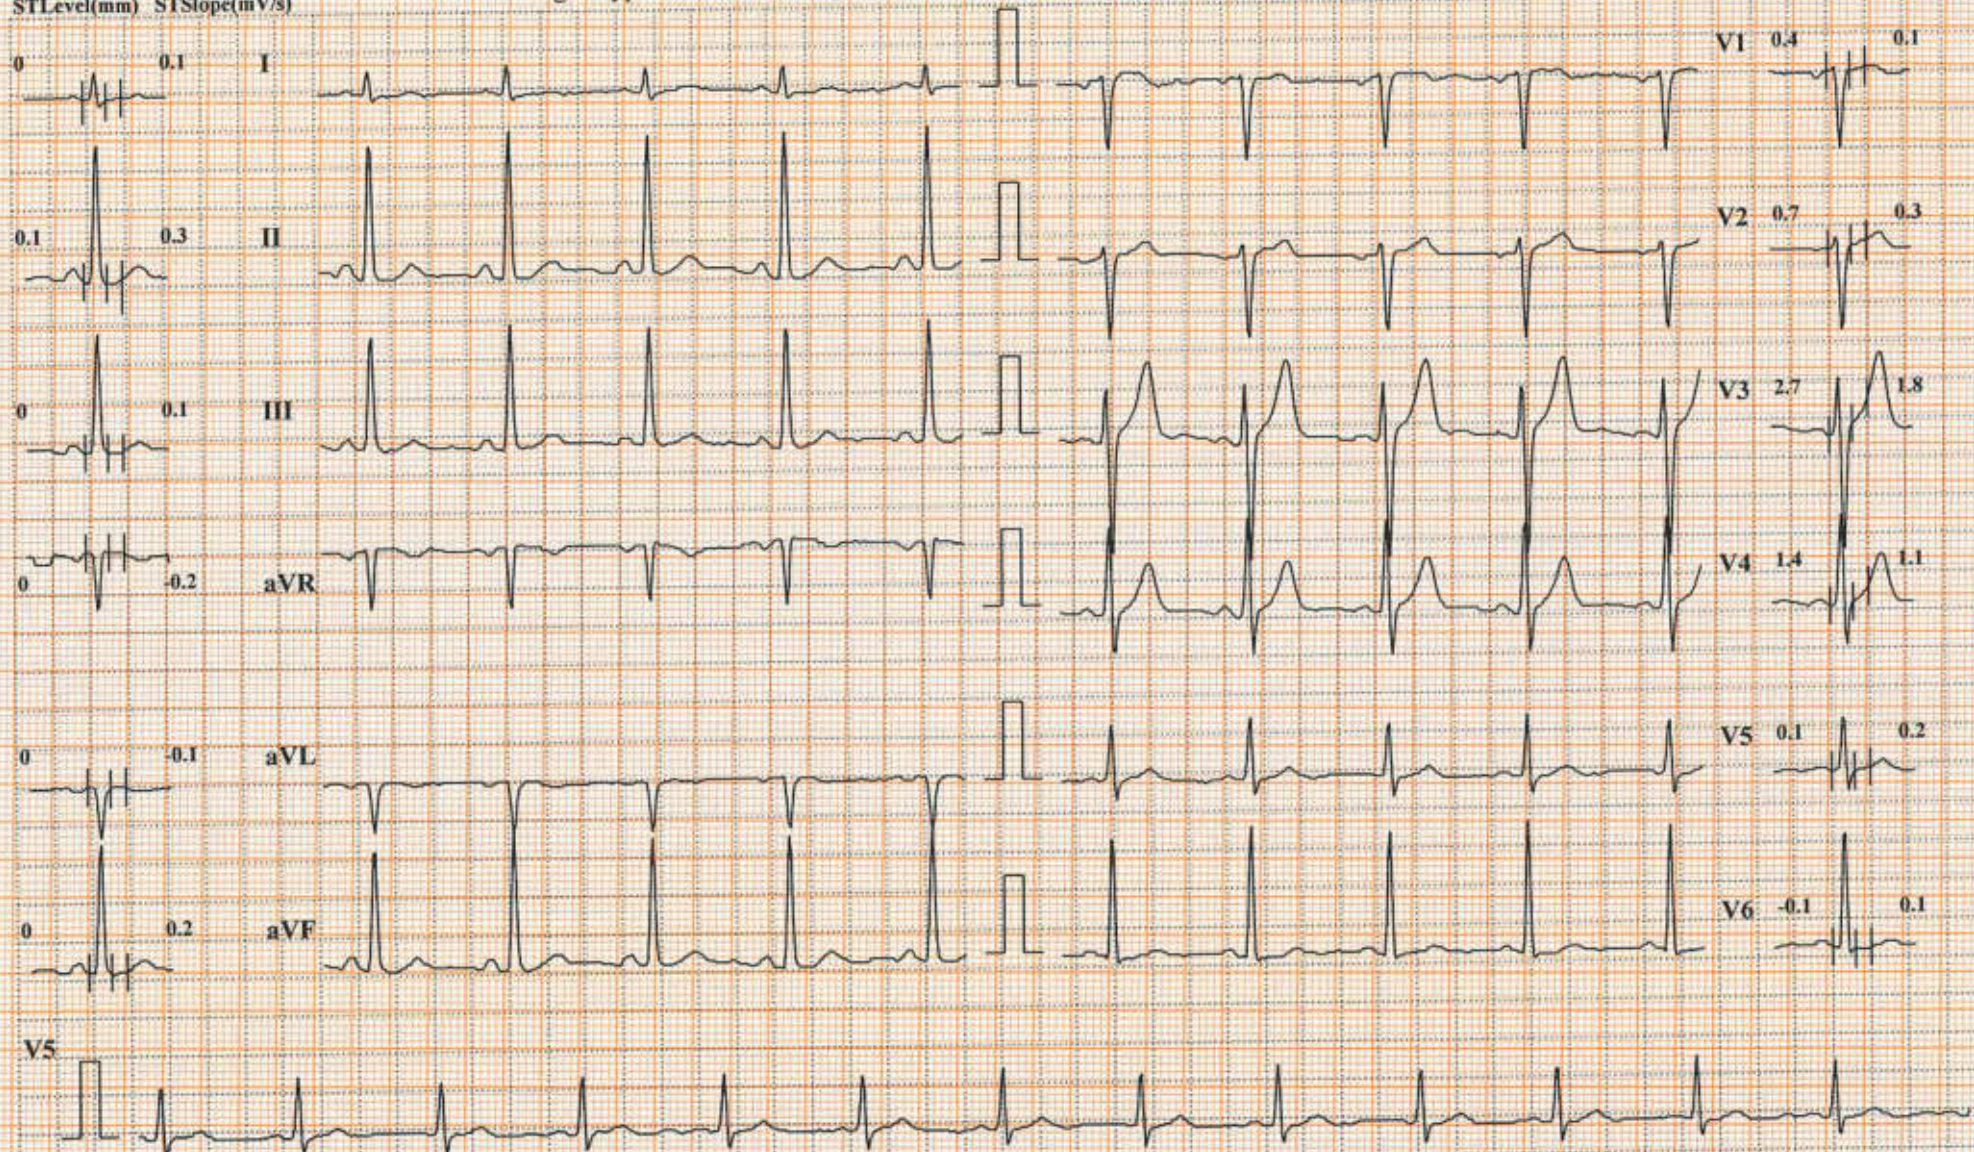


Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 25 Hz Mains Filter: ON

ISO = R - 60 ms, J = R + 60 ms, Post-J = J + 80 ms

Schiller Cardiovit CS-10 Version 3.5

YODA DIAGNOSTICS CENTRE GUNTUR

Mr. VENKATESWARA RAO (39 M)

Bruce Protocol

ID: 99763

Date: 28-09-2024

Exec Time : 0:02:57

Stage Time: 02:56

HR: 130 bpm

Stage: 1

Speed: 2.7 kmph

Grade: 10%

TIR: 158 bpm

BP: 130/80 mmHg

STLevel(mm) STSlope(mV/s)

STLevel(mm) STSlope(mV/s)

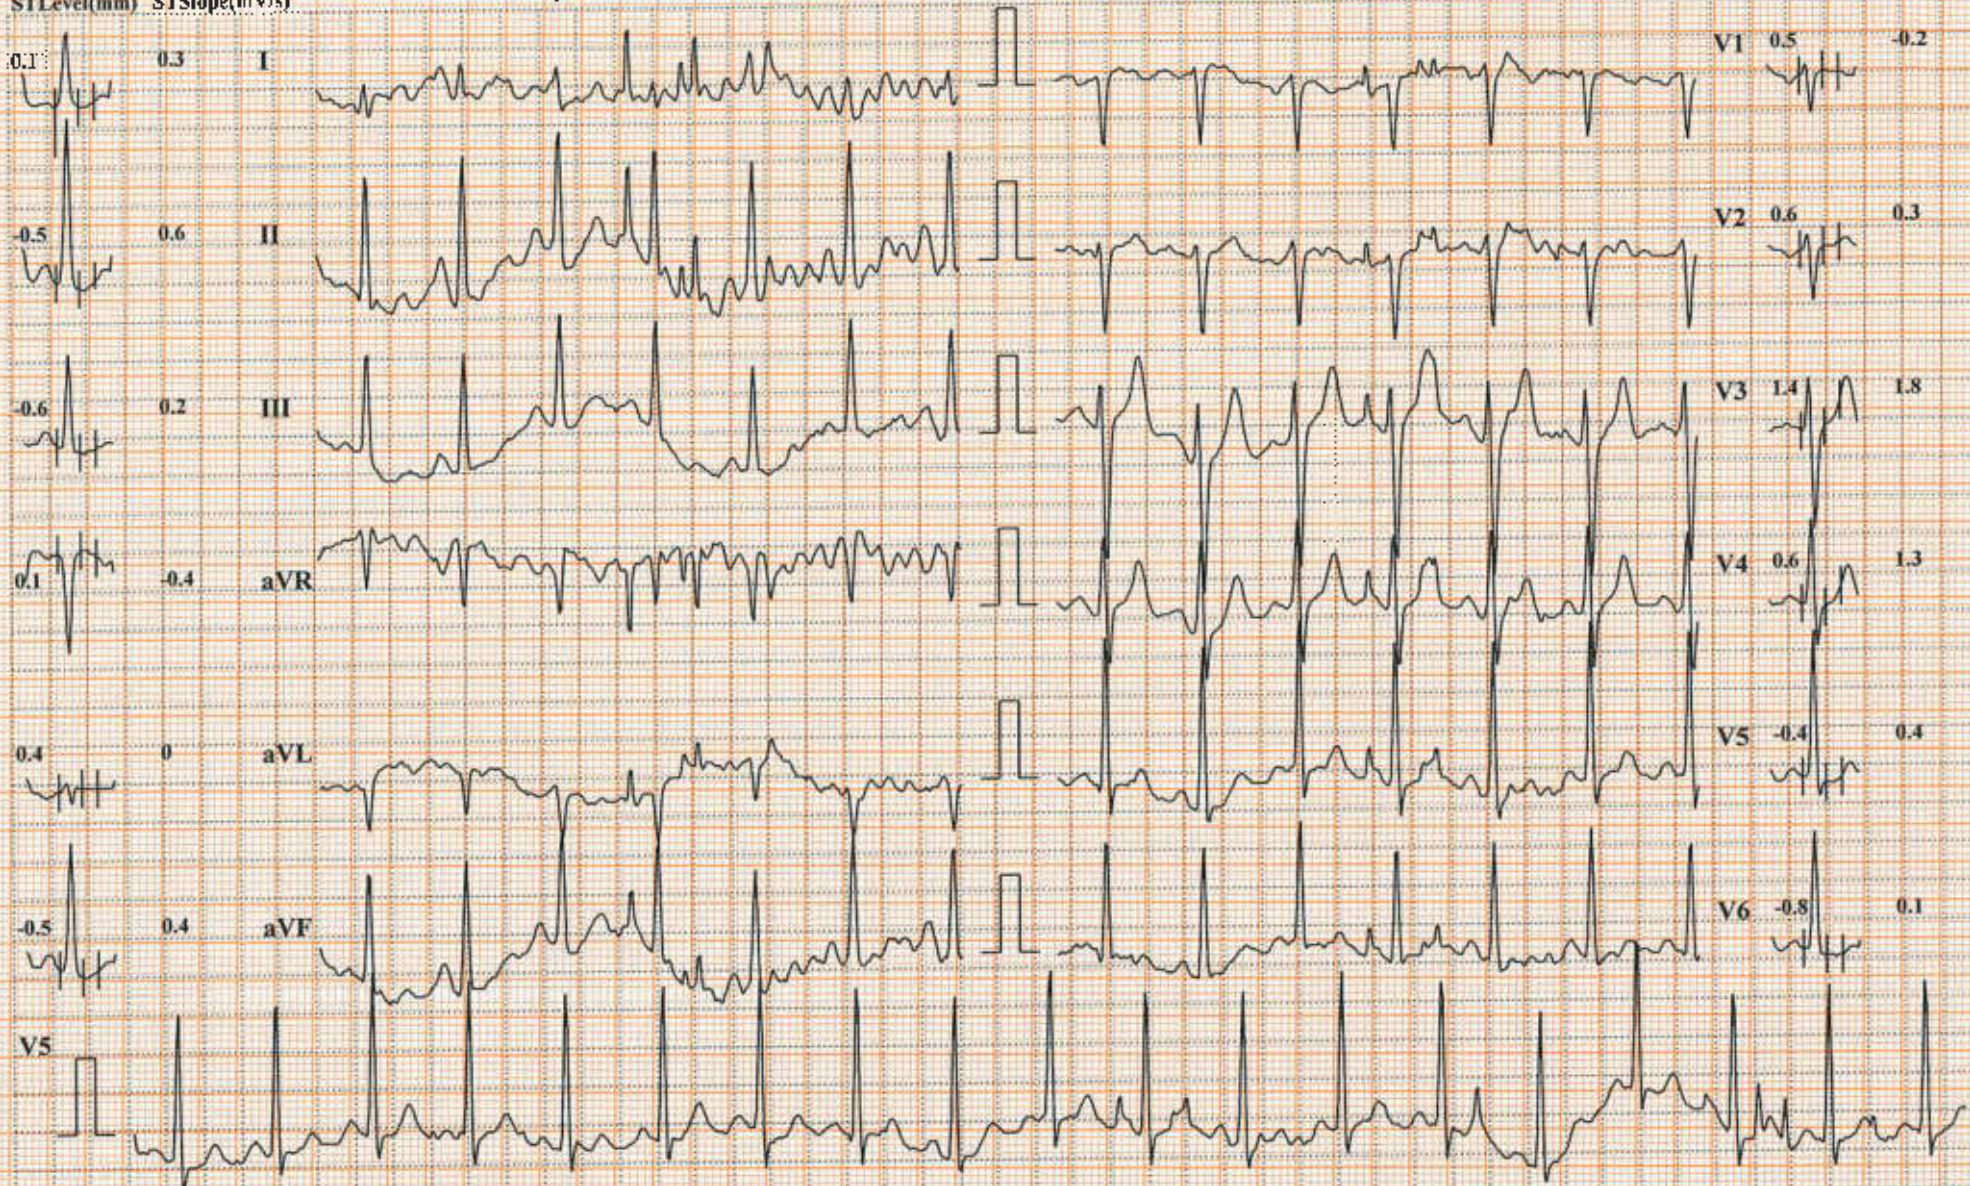


Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 25 Hz Mains Filter: ON

ISO = R - 60 ms, J = R + 60 ms, Post-J = J + 80 ms

Schiller Cardiovit CS-10 Version: 3.5

YODA DIAGNOSTICS CENTRE GUNTUR

Mr. VENKATESWARA RAO (39 M)

ID: 99763

Date: 28-09-2024

Exce Time : 0:05:35

Stage time: 02:35

HR: 136 bpm

Brice Protocol

Stage: 2 Peak Exercise

Speed: 4 kmph

Slope: 12 %

THR: 158 bpm

BP: 150/90 mmHg

STLevel(mm) STSlope(mV/s)

STLevel(mm) STSlope(mV/s)

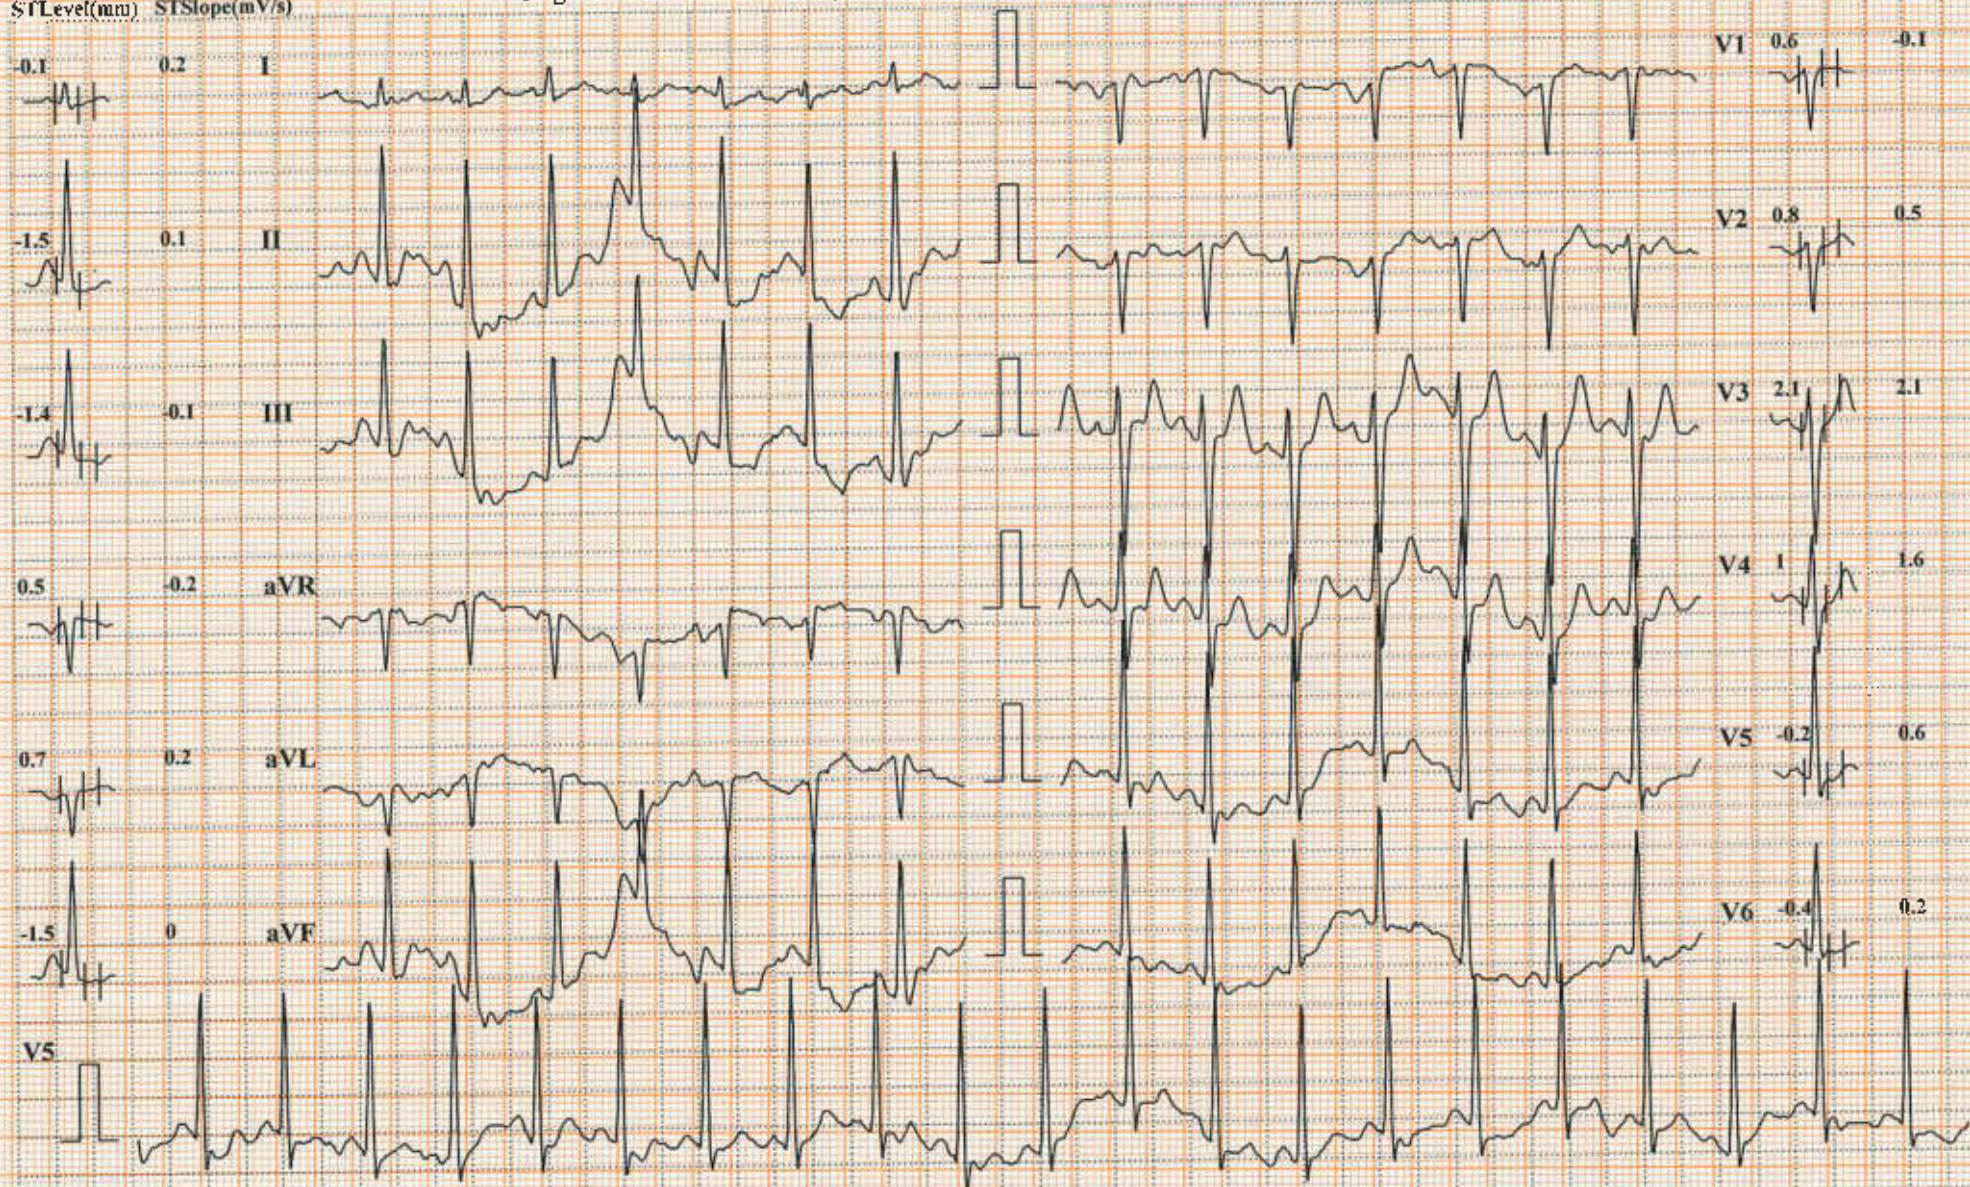


Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 25 Hz Mains Filter: ON

ISO - R - 60 ms, J - R - 60 ms, Post J - J + 80 ms

Schiller Cardiovit CS-10 Version: 3.5

YODA DIAGNOSTICS CENTRE GUNTUR

Mr. VENKATESWARA RAO (39 M)

ID: 99763

Date: 28-09-2024

Exoc Time: 00:00

Stage Time: 01:00

HR: 98 bpm

Bruce Protocol

Stage: Recovery1

Speed: 0 kmph

Slope: 0 %

THR: 158 bpm

BP: 150/90 mmHg

STLevel(mm) STSlope(mV/s)

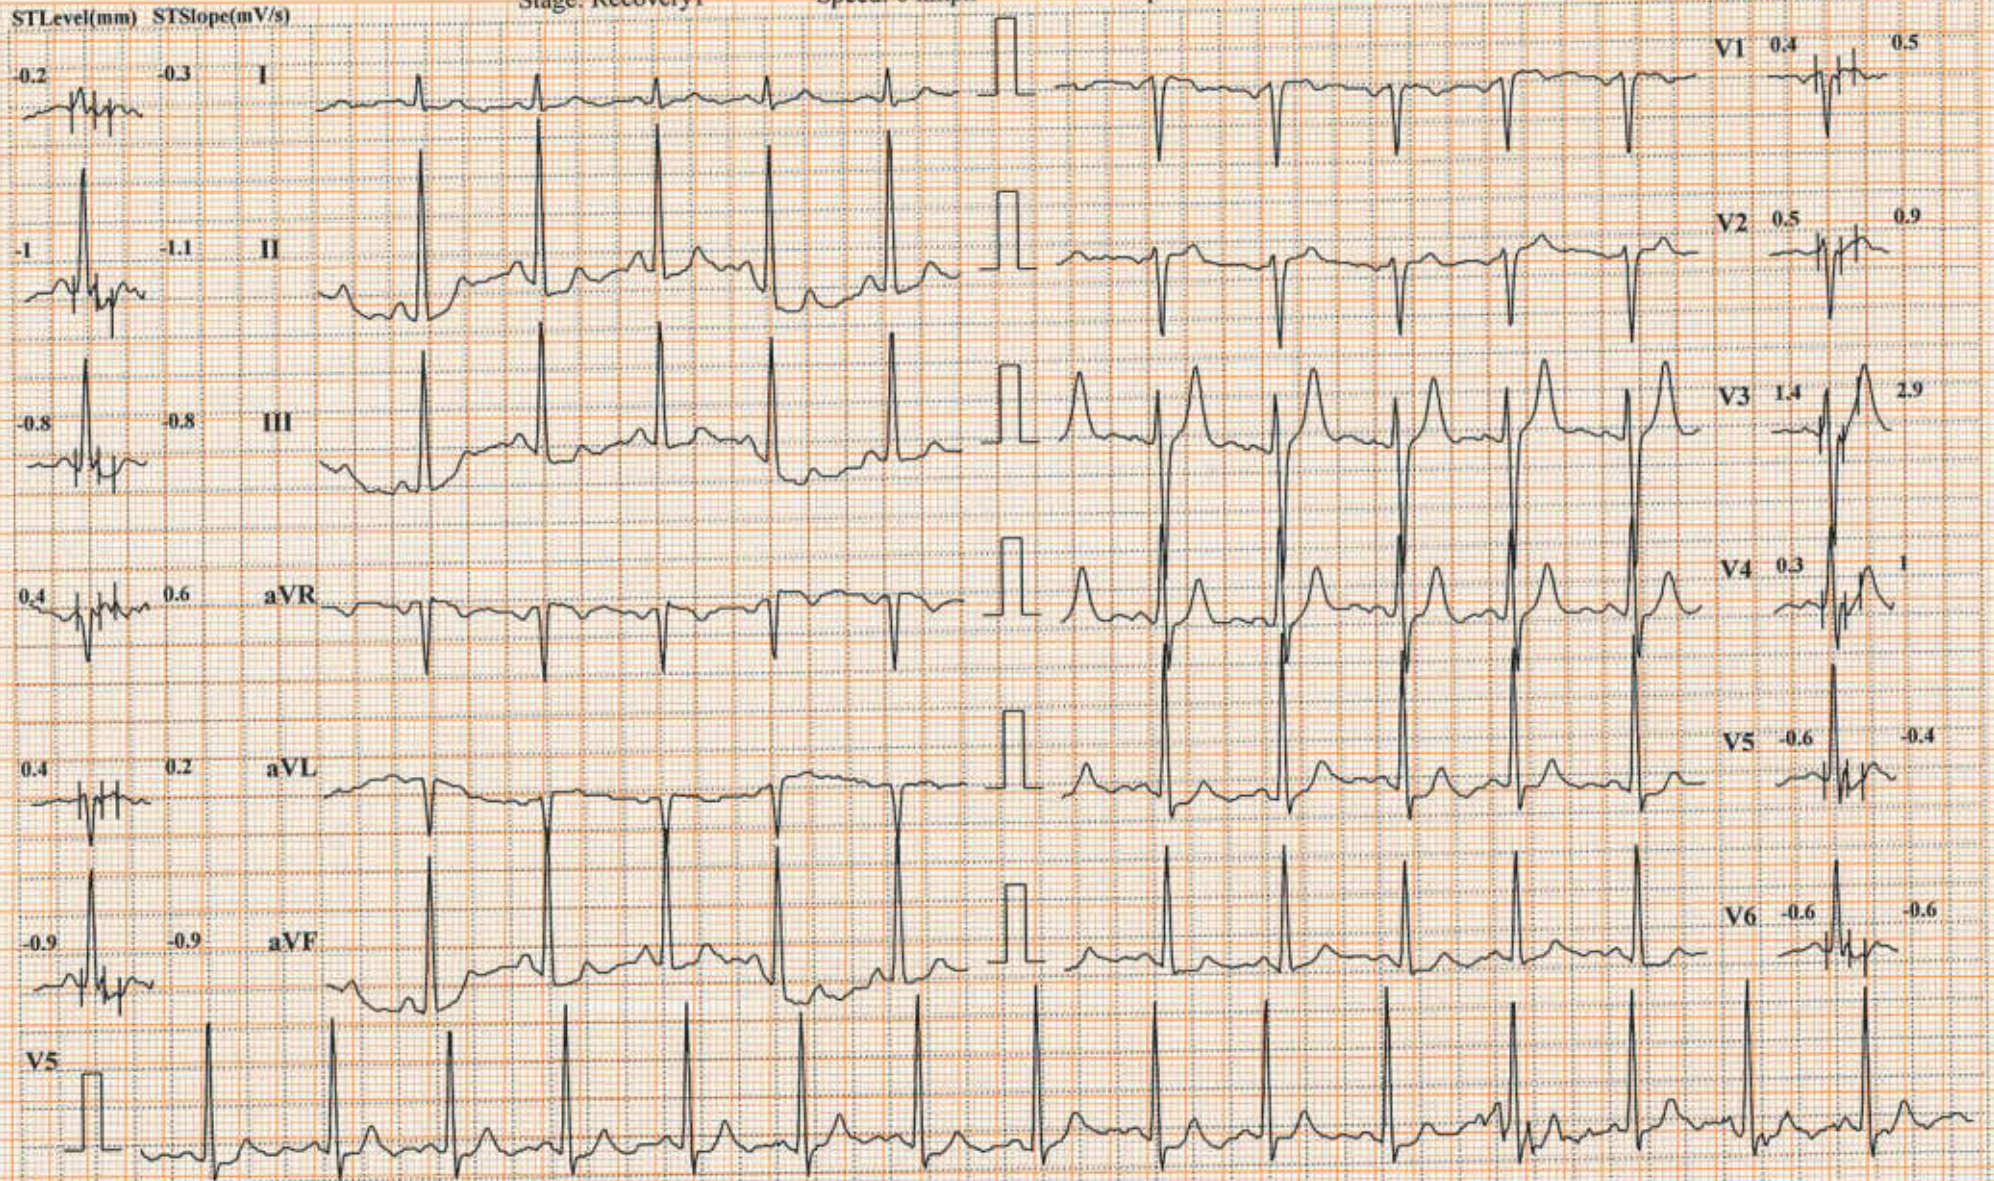


Chart Speed: 25 mm/sec Amplitude: 10mm/mV Filter: 25 Hz Mains Filter: ON ISO = R - 60 ms, J = R + 60 ms, PostJ = J + 80 ms

Schiller Cardiovit CS-10 Version 3.5

YODA DIAGNOSTICS CENTRE GUNTUR

Mr. VENKATESWARA RAO (39 M)

ID: 99763

Date: 28-09-2024

Exec Time : 00:00

Stage Time: 01:00

HR: 84 bpm

Bruce Protocol

Stage: Recovery2

Speed: 0 kmph

Slope: 0 %

THR: 158 bpm

BP: 140/90 mmHg

STLevel(mm) STSlope(mV/s)

STLevel(mm) STSlope(mV/s)

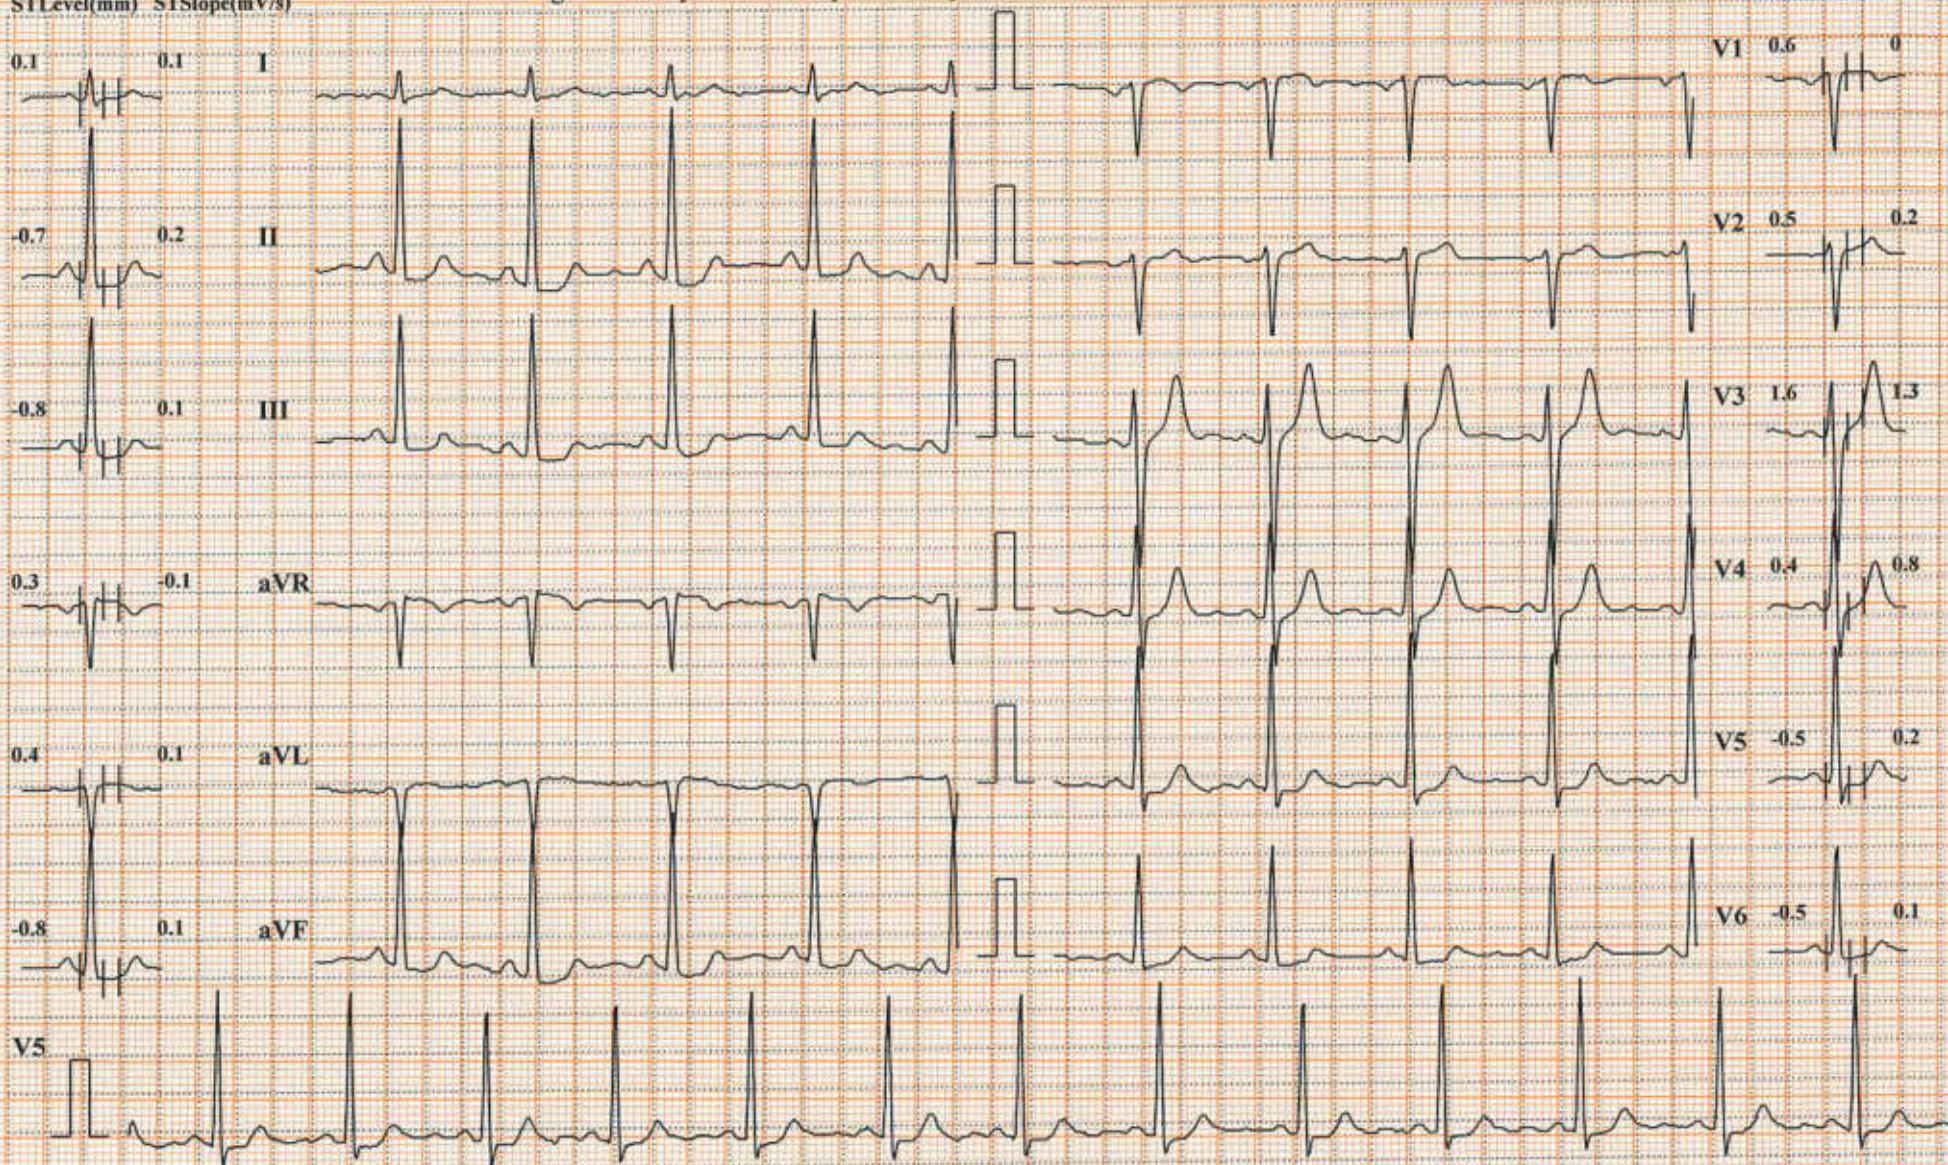


Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 25 Hz Mains Filter: ON

ISO = R - 60 ms, J = R + 60 ms, Post J = J + 80 ms

Schiller Cardiovit CS-10 Version:3.5

YODA DIAGNOSTICS CENTRE GUNTUR

Mr. VENKATESWARA RAO (39 M)

ID: 99763

Date: 28-09-2024

Excc Time: 00:00

Stage Time: 01:00

HR: 82 bpm

Bruce Protocol

Stage: Recovery3

Speed: 0 kmph

Slope: 0 %

THR: 158 bpm

BP: 140/90 mmHg

STLevel(mm) STSlope(mV/s)

STLevel(mm) STSlope(mV/s)

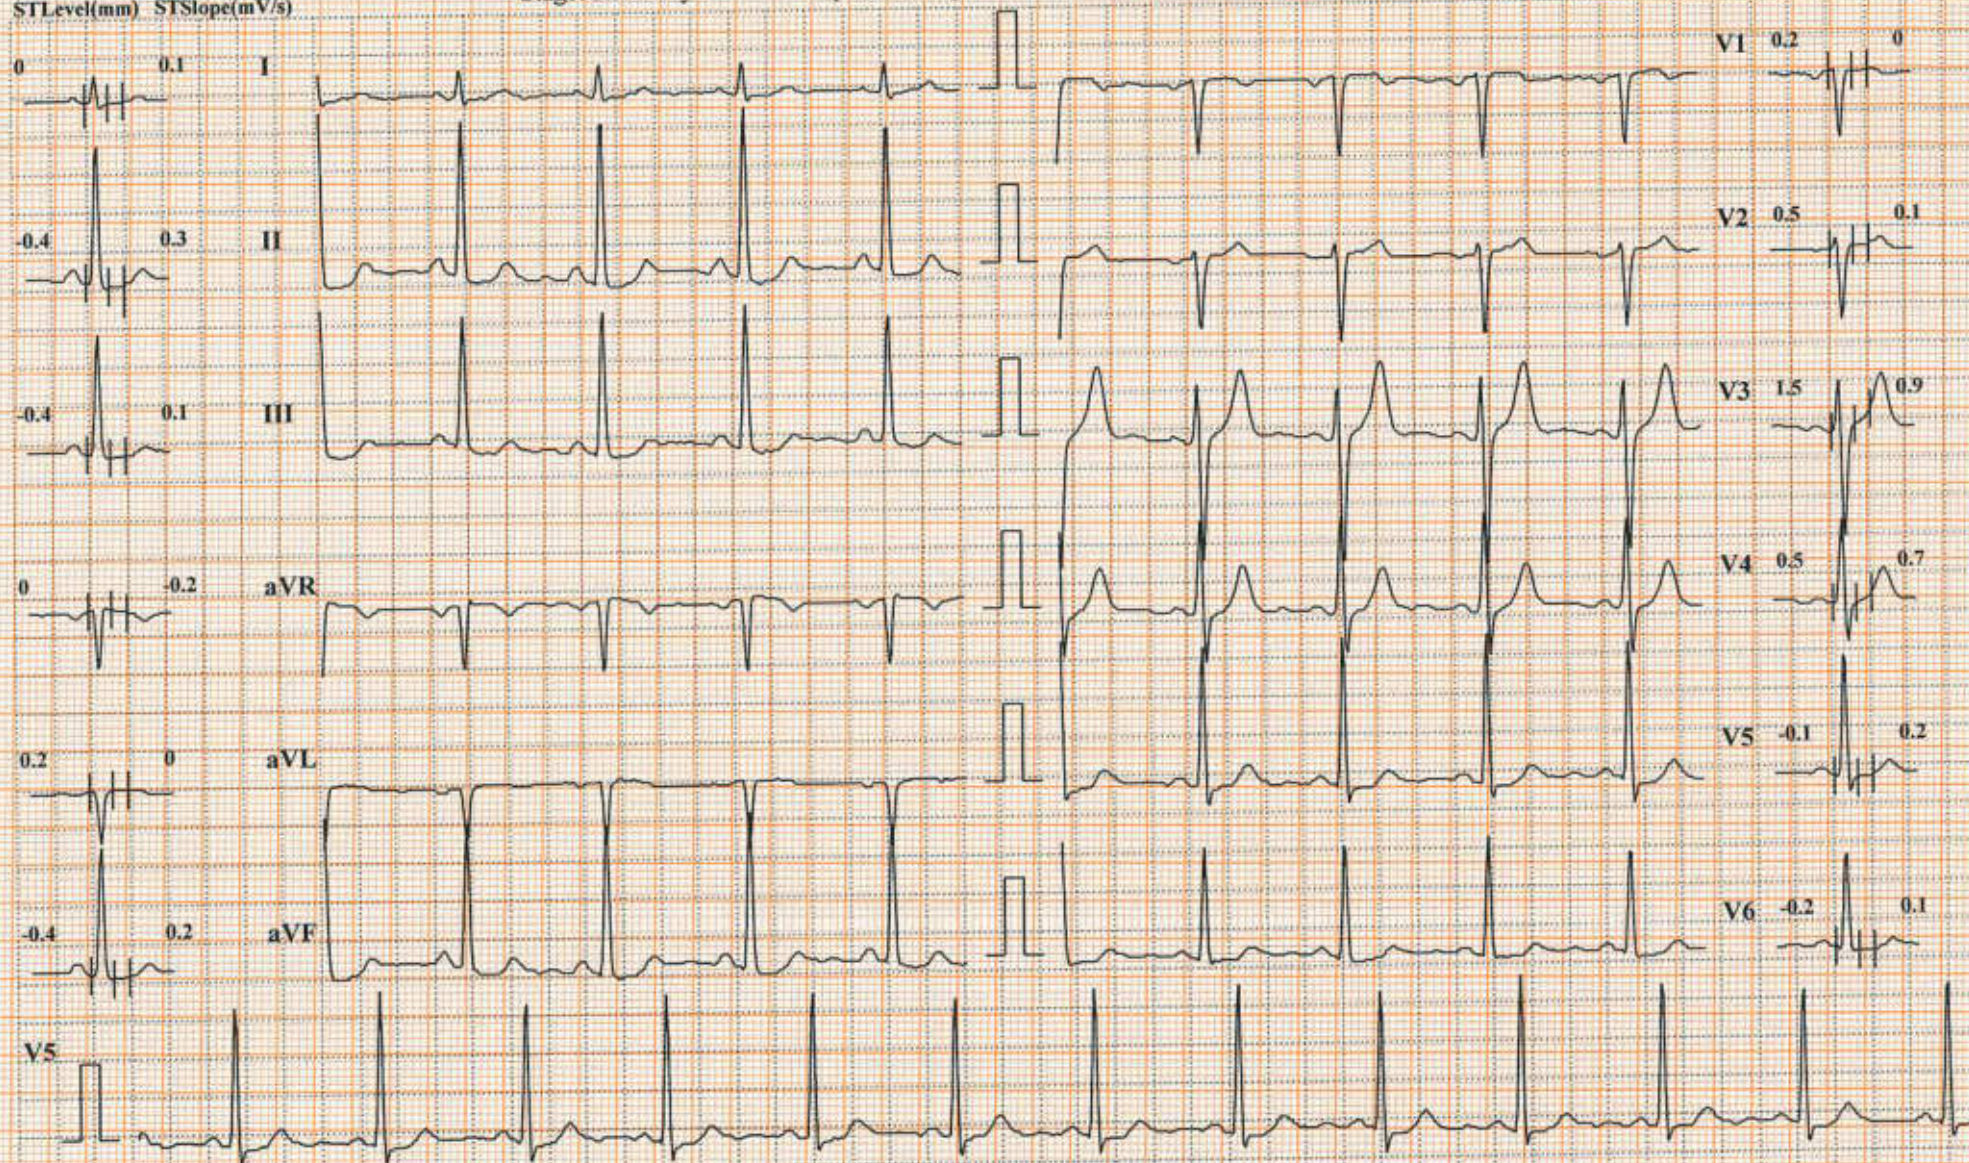


Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 25 Hz Mains Filter: ON

ISO = R - 60 ms, J = R + 60 ms, Post.J = J + 80 ms

Schiller Cardiovit CS-10 Version 3.5

YODA DIAGNOSTICS CENTRE GUNTUR

Mr. VENKATESWARA RAO (39 M)
ID: 99763

Date: 28-09-2024

Exec Time : 00:00

Stage Time: 00:04

HR: 79 bpm

Bruce Protocol

Stage: Recovery4

Speed: 0 kmph

Slope: 0 %

THR: 158 bpm

BP: 140/90 mmHg

STLevel(mm) STSlope(mV/s)

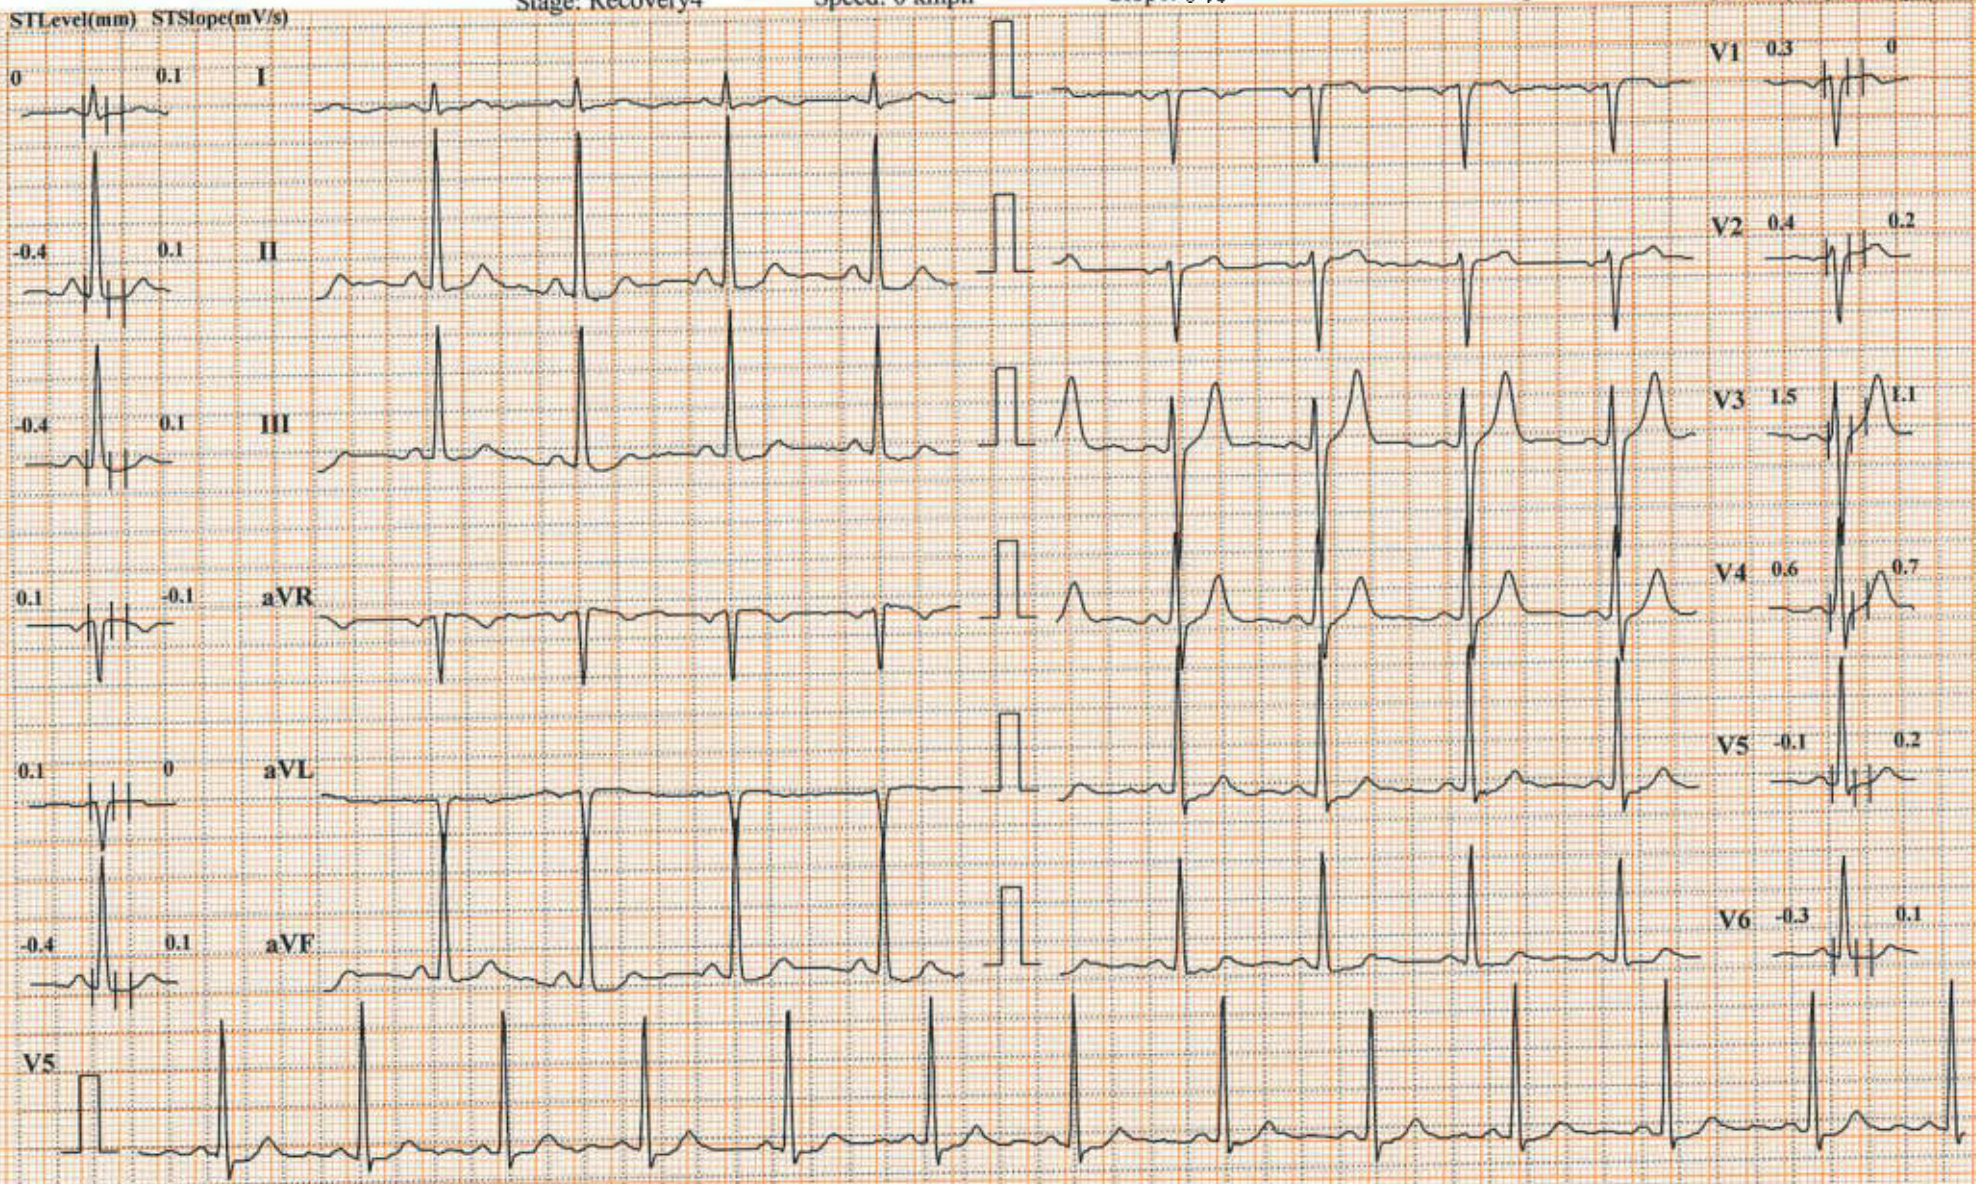


Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 25 Hz Mains Filter: ON

ISO = R - 60 ms, J = R + 60 ms, PostJ = J + 80 ms

Schiller Cardiovit CS-10 Version: 3.5

DEPARTMENT OF RADIOLOGY

Patient Name	Mr. VENKATESWARA RAO	Visit ID	YGT99763	Barcode	11263238
Age / Gender	39 Y / MALE	UHID	YGT.0000099394	Collection Date	28-09-2024 09:38 AM
Ref Doctor	Dr. SELF	Client Name	MEDI WHEELS	Registration Date	28-09-2024 09:38 AM
Hospital Name		Client Code	YOD-DL-0021	Received Date	
Sample Type		Client Add	F-701, Lado Sarai, Mehrauli, New Delhi	Reported Date	28-09-2024 07:02 PM

X-RAY CHEST PA VIEW

FINDINGS:

Trachea is midline.
Mediastinal outline, and cardiac silhouette are normal.
Bilateral lung fields show normal vascular pattern with no focal lesion.
Bilateral hila are normal in density.
Bilateral costo-phrenic angles and domes of diaphragms are normal.
The rib cage and visualized bones appear normal.

IMPRESSION:

- No significant abnormality detected.

*** End Of Report ***

Suggested clinical correlation & follow up



Approved by



Dr. Prithvi Rani Gadadasu
MD, CONSULTANT
RADIOLOGIST





VENKATESWARA RAO 39Y MALE YGT99763 CHEST PA 28-Sep-24

YODA DIAGNOSTICS