

Adarsh

Curovis Healthcare Pvt Ltd, Ahmedabad

TARUNKUMAR CHAUDHARI (41 M)

Brace Protocol ID: 430

ST1:rv1(mm) ST1:sv1(muV/s) Stage: Supine

Date: 09-03-2024 Speed: 0 kmph

Exec Time: 0:00:00 Grade: 9%

Stage Time: 09:11 T1:R: 152 bpm

H1R: 102 bpm

BP: 130/80 mmHg

ST1:rv1(mm) ST1:sv1(muV/s)

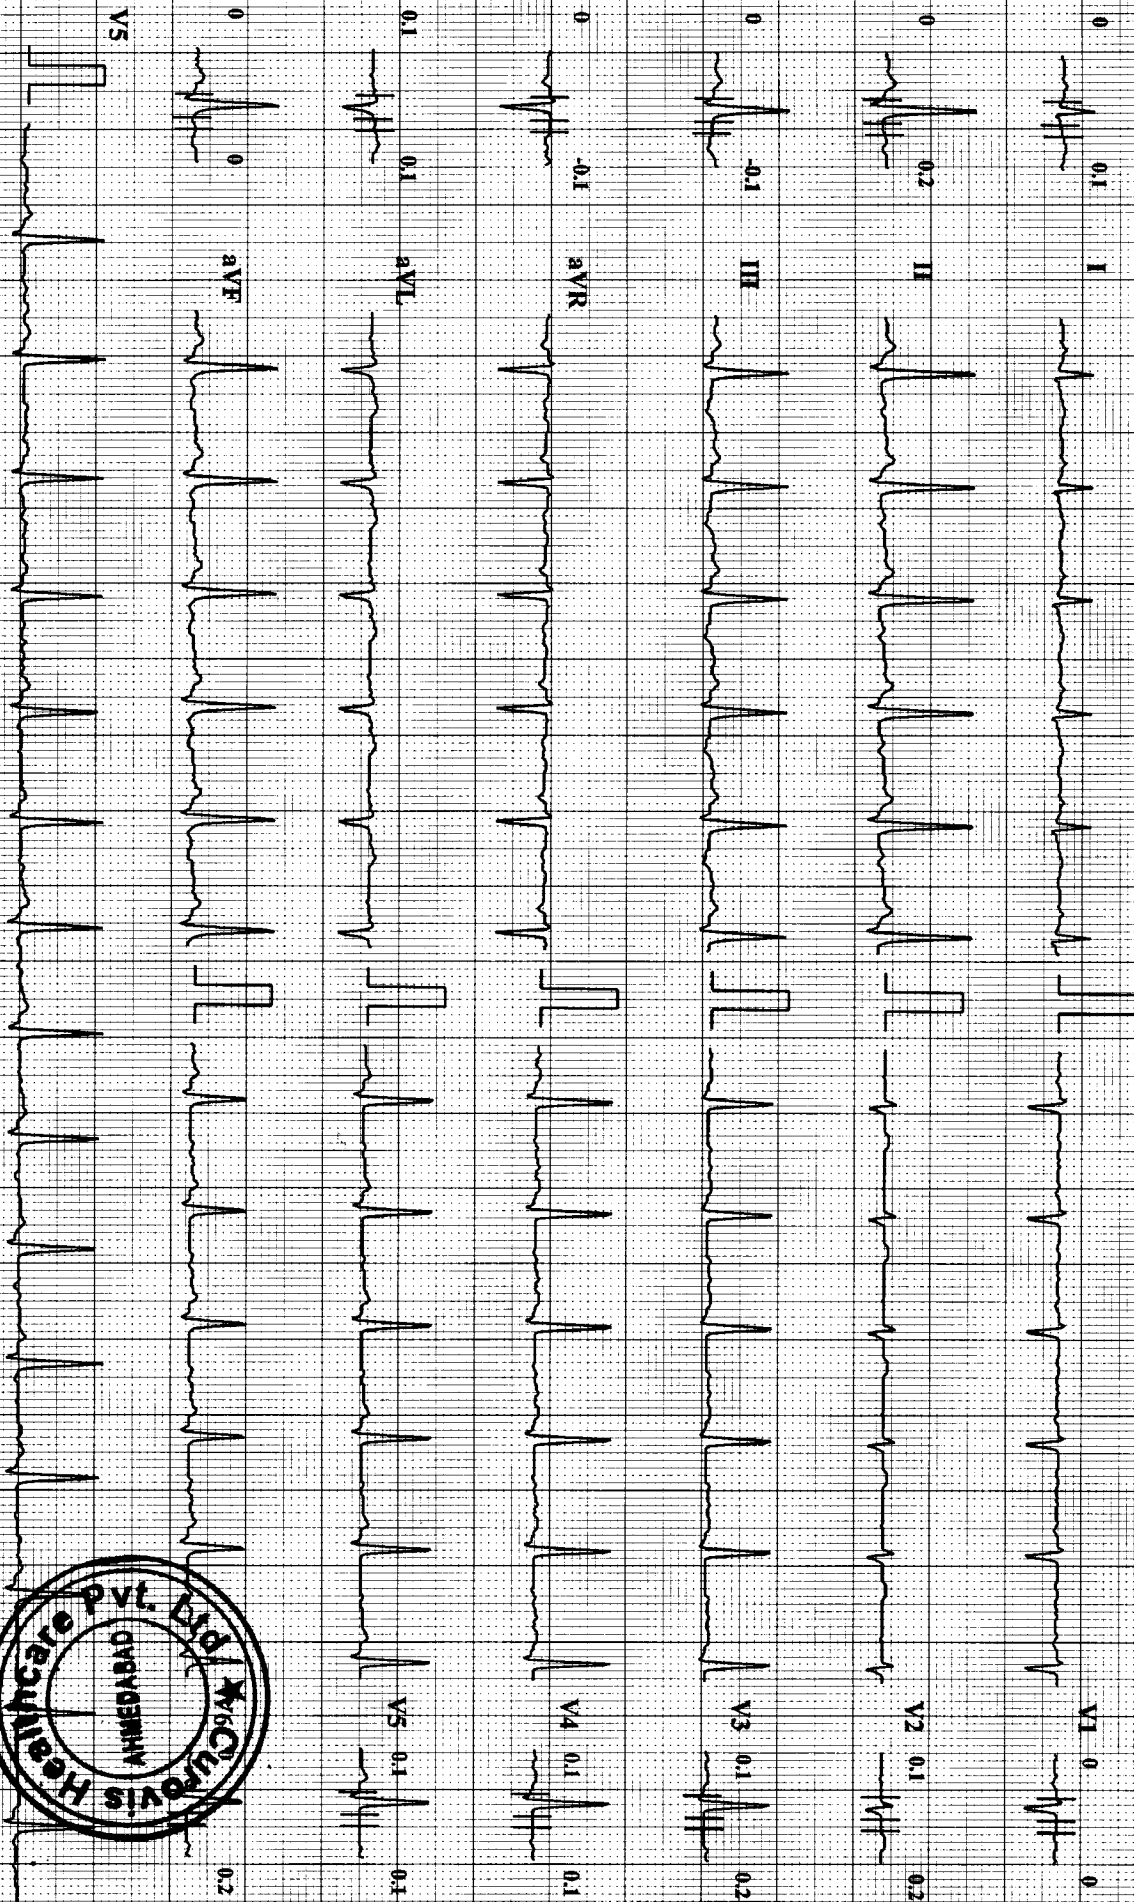


Chart Speed: 25 mm/sec


Amplitude: 10mm/mV

Filter: 35 Hz Mains Filter: ON

ISO - R - 60 ms, J - R - 60 ms, Post J - J + 60 ms

Schiller CardioIT CS-10 Version:3.4

VS



Curovis Healthcare Pvt Ltd, Ahmedabad

TARUNKUMAR CHAUDHARI (41 M)

Bruce Protocol

ID: 430

Date: 09-03-2024

Exec Time: 0100:00

Stage Time: 00:12

HR: 103 bpm

STLevel(mm) STISlope(mV/s)

Stage Standing

Speed: 0 kmph

Grade: 0%

THR: 152 bpm

BP: 130/80 mmHg
STLevel(mm) STISlope(mV/s)

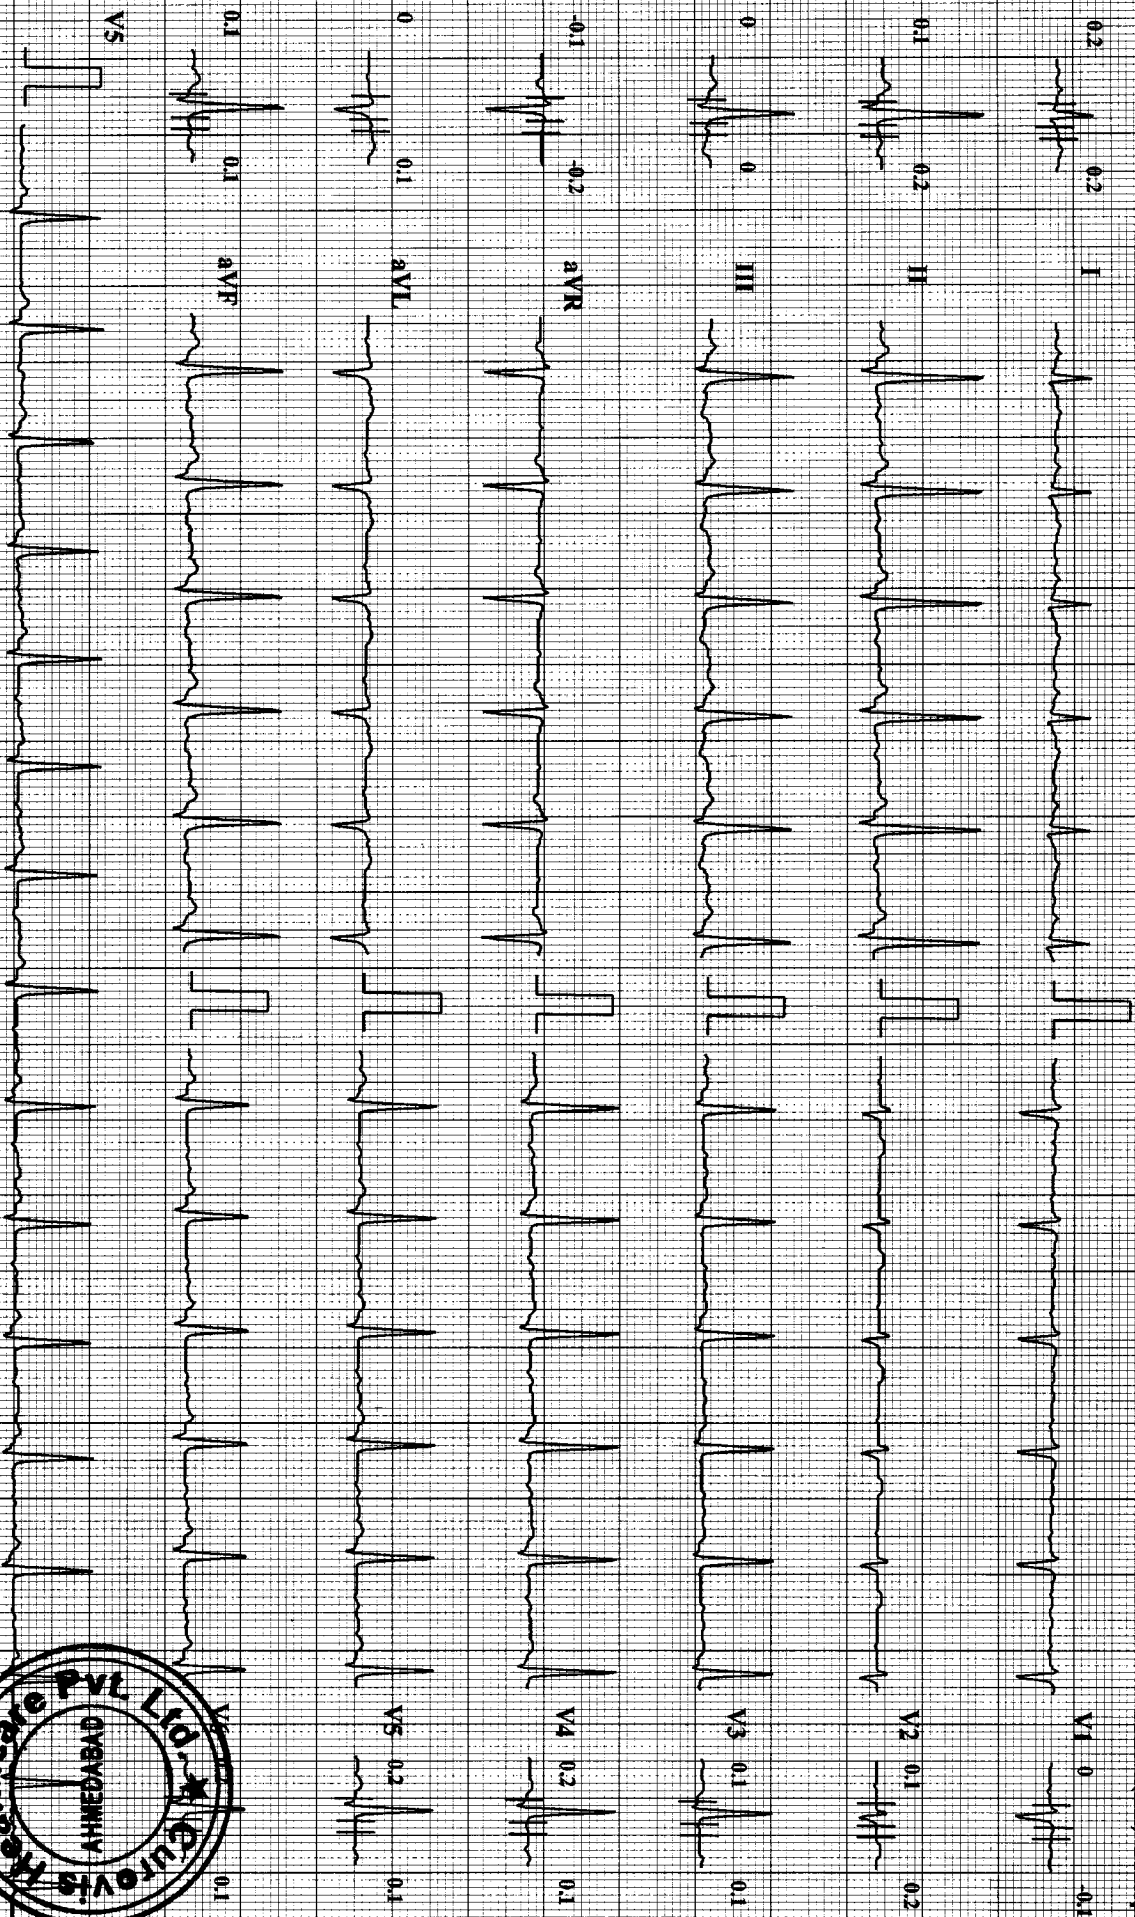



Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 35 Hz Mains Filter ON

ISO = R - 60 ms, J = R + 60 ms, Post J = J + 60 ms

Linked Median

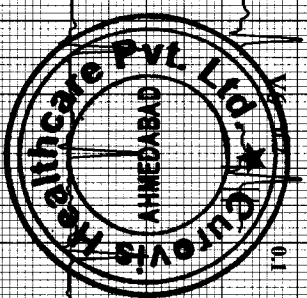

Curovis Healthcare Pvt Ltd, Ahmedabad

TARUNKUMAR CHAUDHARI (41 M)

Birth Protocol

ID: 436

Date: 09-03-2024

Exec Time: 01:00:00

Stage Time: 00:10

HR: 99 bpm

STLevel(mm) STISlope(mV/s)

Stage: Hyperventilation Speed: 0 kmph

Grade: 0%

THR: 152 bpm

BP: 130/80 mmHg
STLevel(mm) STISlope(mV/s)

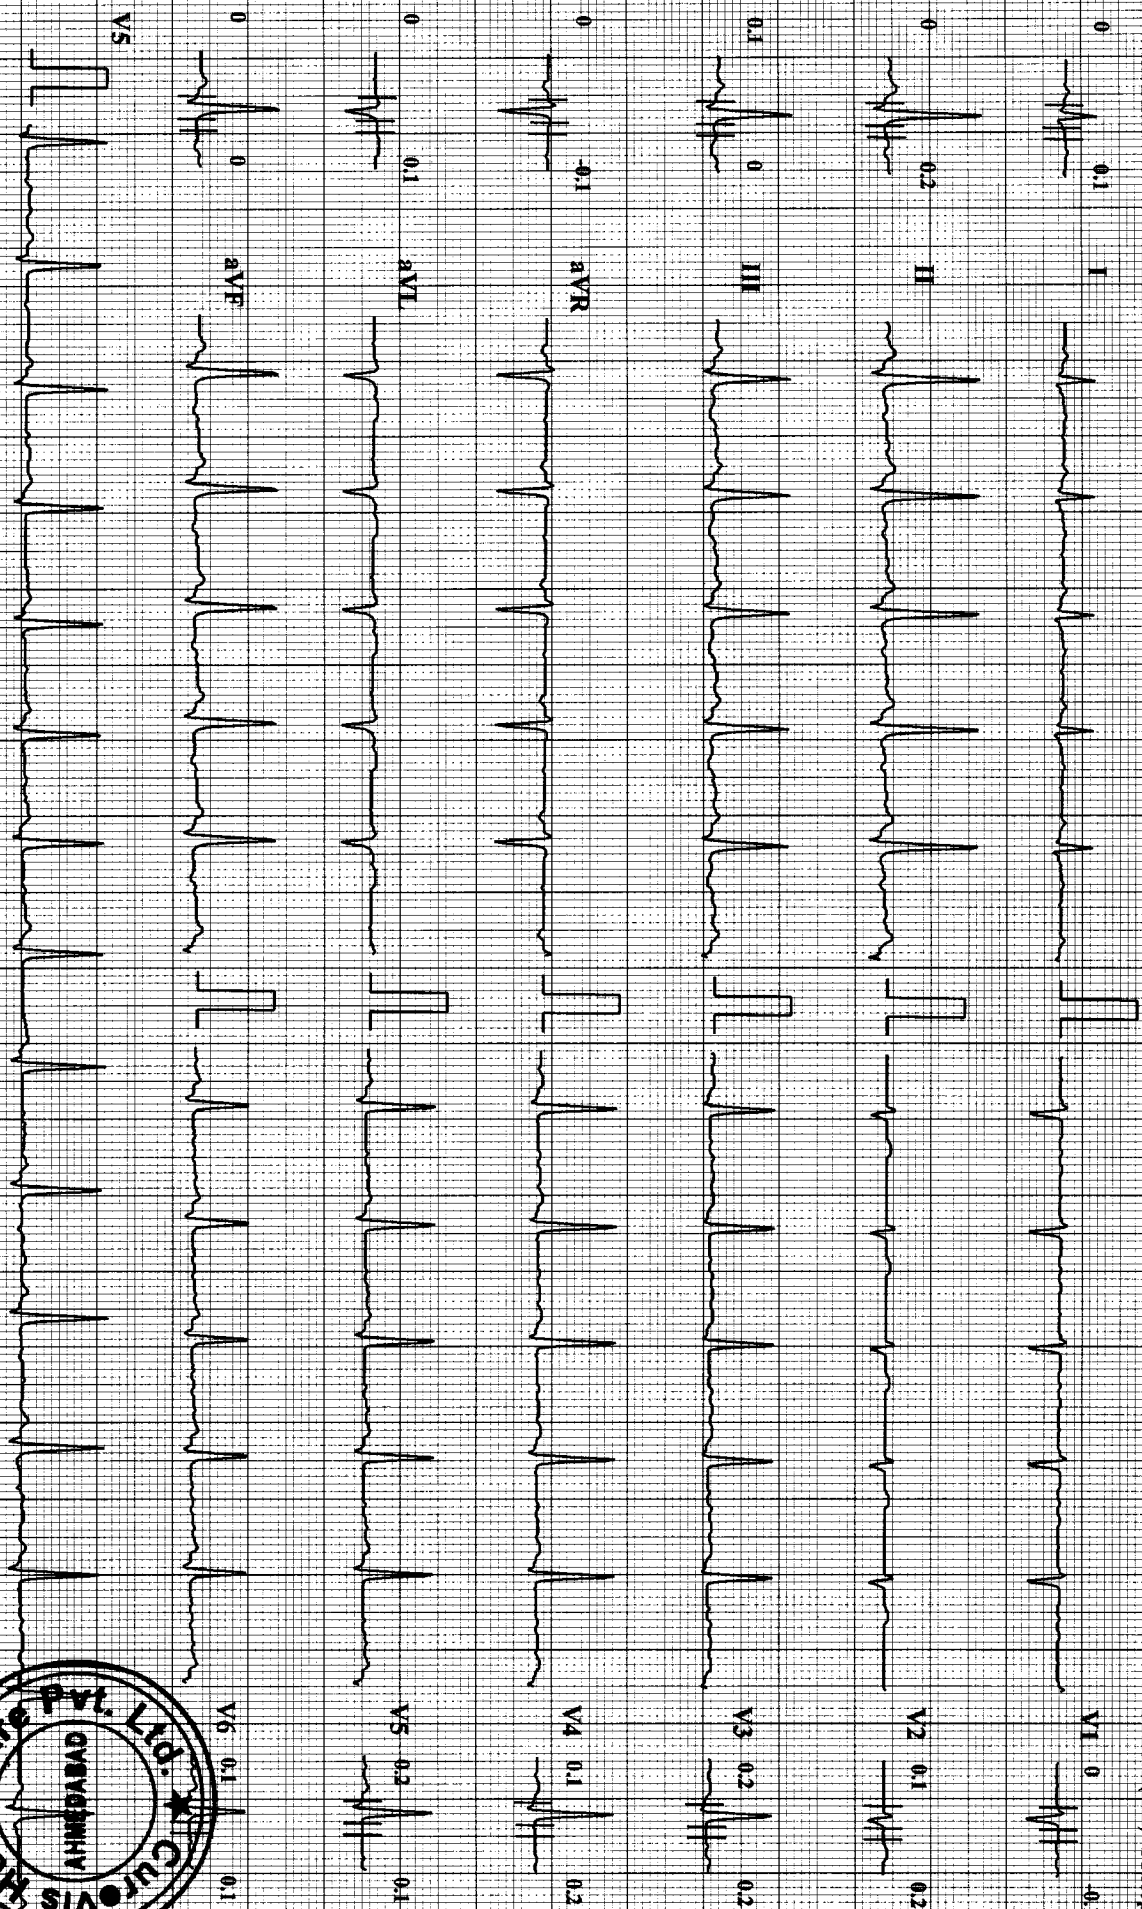


Chart Speed: 25 mm/sec


Amplitude: 10mm/mV

Filter: 35 Hz Mains Filter: ON

ISO - R - 60 ms, J - R + 60 ms, Post J - J + 60 ms

Linked Median

Seiler CardioVt CS-10 Version 3.4



Curovis Healthcare Pvt Ltd, Ahmedabad

TARUNKUMAR CHAUDHARI (41 M)

ID: 430

Bruce Protocol
STSegment(m) STSlope(mV/s)

Stage: Pre-Test

Date: 09-03-2024

Speed: 1.6 kmph

Exec Time: 0:00:00

Grades: 0%

Stage Time: 00:10

T:HR: 152 bpm

HR: 103 bpm

BP: 130/80 mmHg

STLevel(m) STSlope(mV/s)

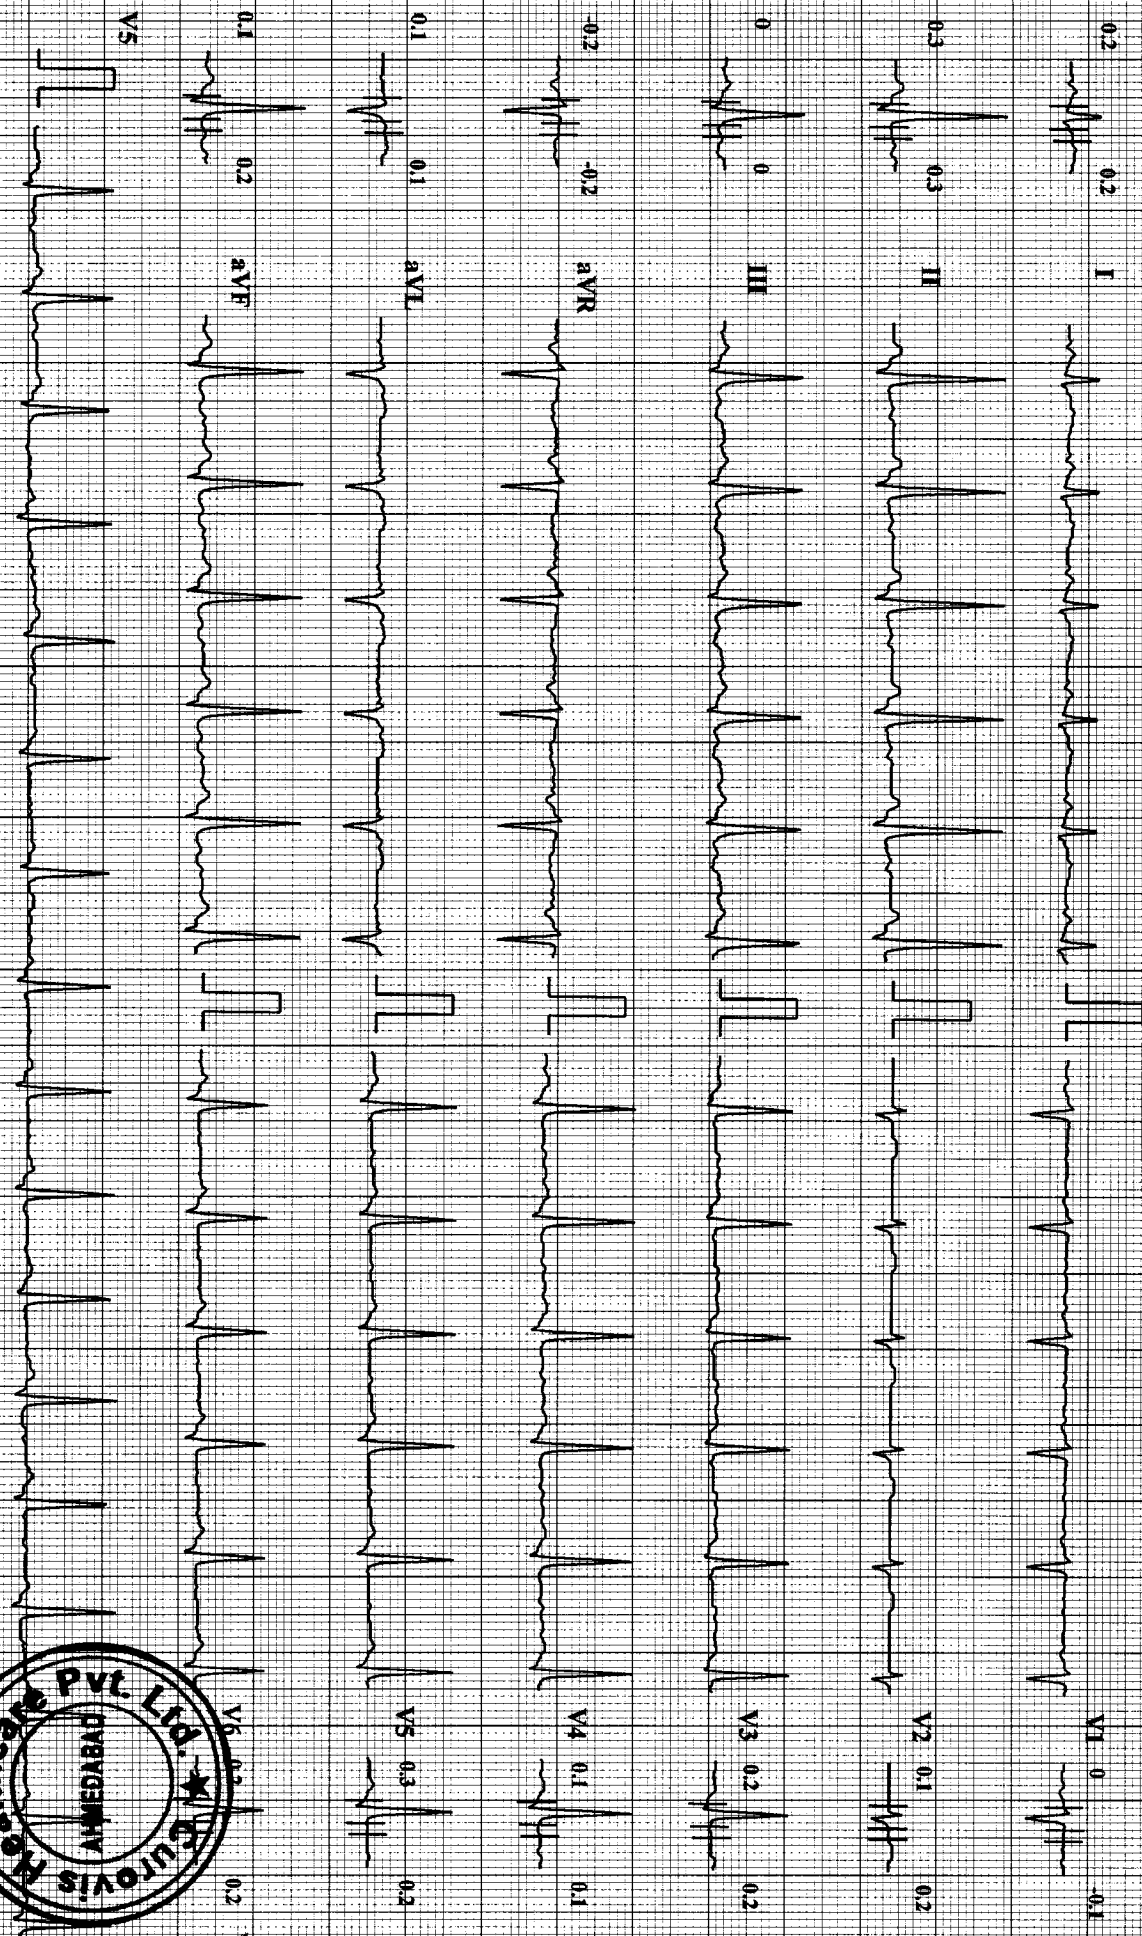



Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 35 Hz Mains Filter: ON

ISO - R - 60 ms, J - R + 60 ms, Post J - J + 60 ms

Scyller Cardiovit CS-10 Version: 3.4

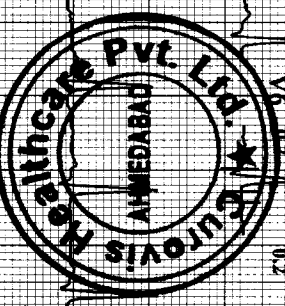

VS

Curovis Healthcare Pvt Ltd, Ahmedabad

TARUNKUMAR CHAUDHARI (41 M)

Bruce Protocol
STLevel(mm) STSlope(mV/s)

ID: 430
Stage: 1

Date: 09-03-2024
Speed: 2.7 kmph

Exec Time : 0:03:00
Grade: 10%

Stage Time: 03:00
THR: 152 bpm

HRR: 136 bpm

BP: 138/88 mmHg
STLevel(mm) STSlope(mV/s)

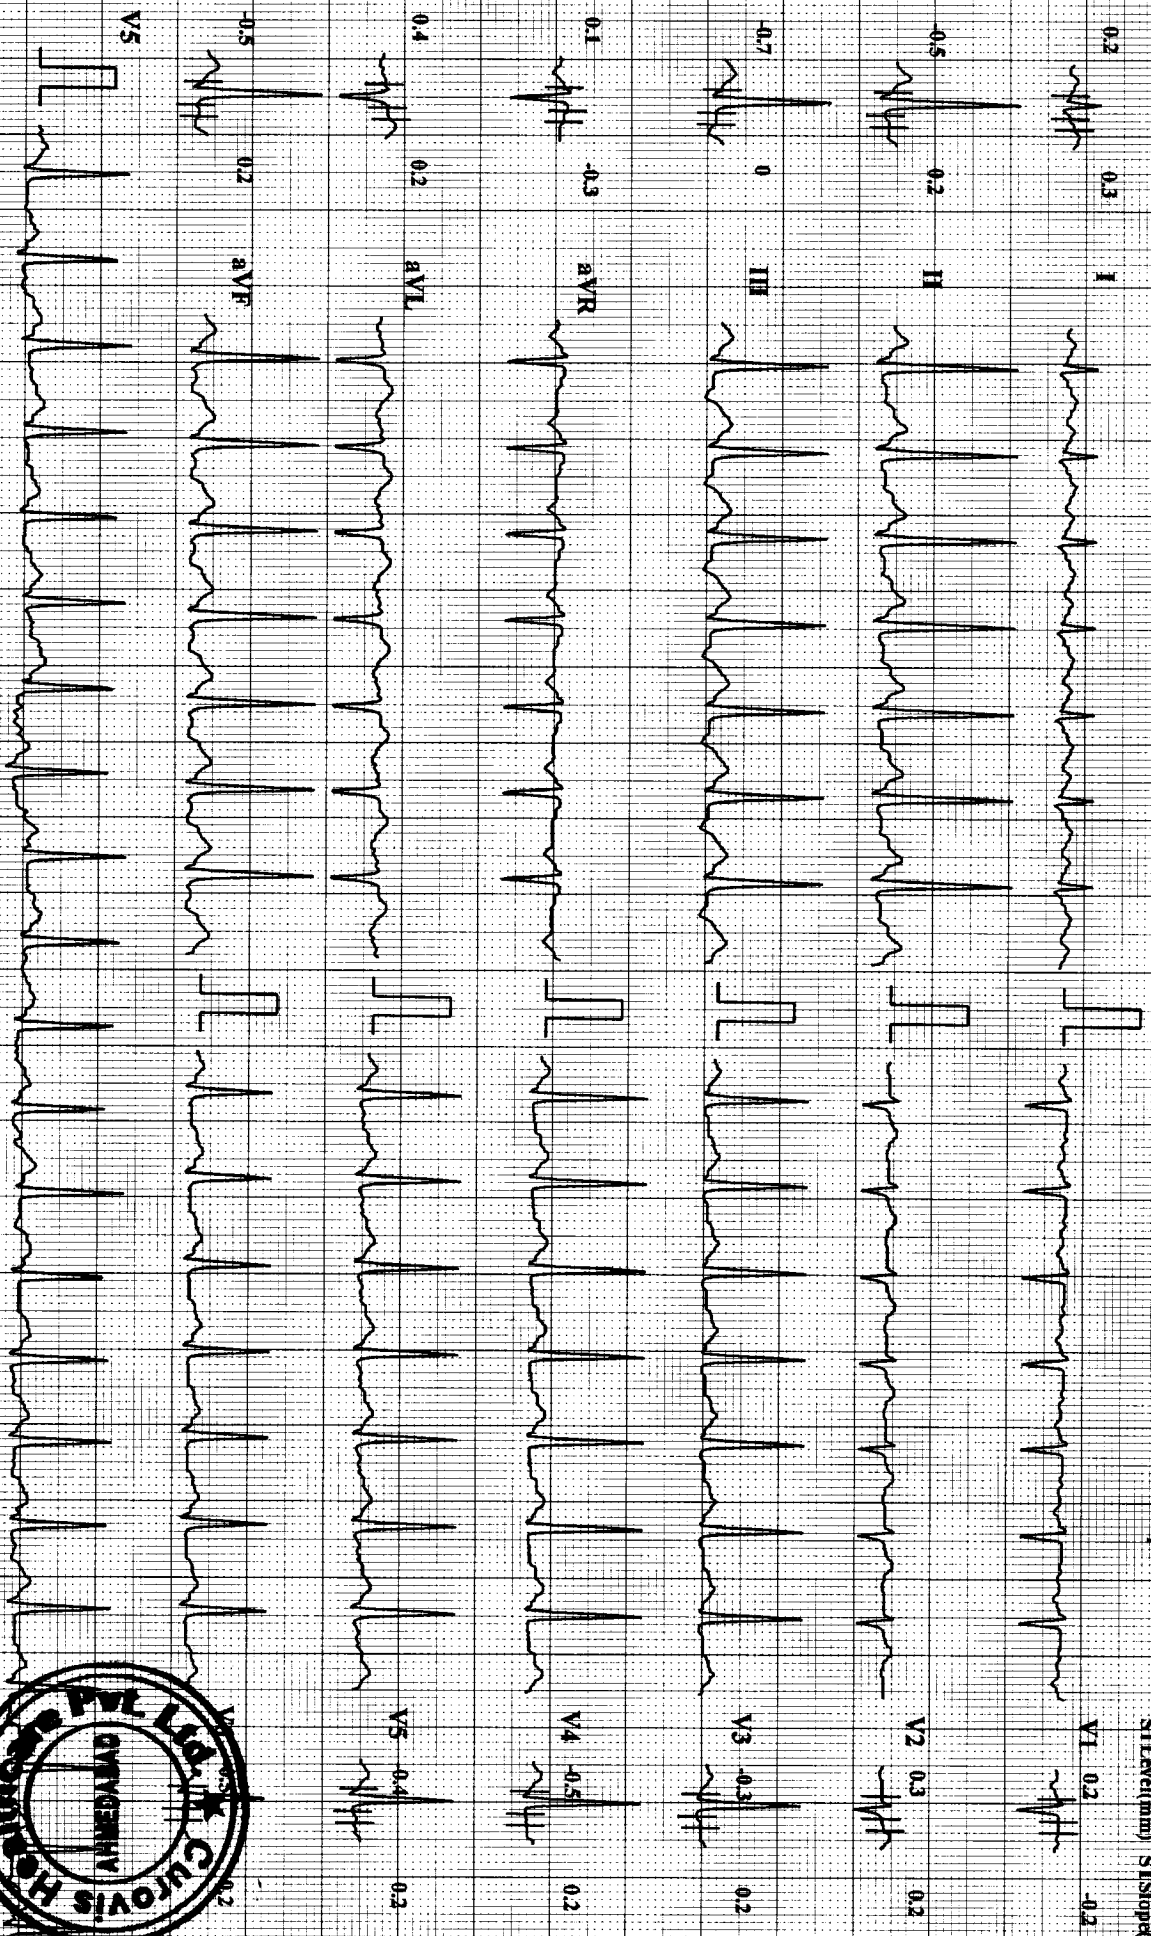



Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 35 Hz Mains Filter: ON

ISO - R - 60 ms, J - R + 60 ms, Post J = J + 60 ms

Linked Median

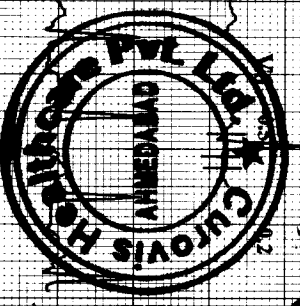

Curovis Healthcare Pvt Ltd, Ahmedabad

TARUNKUMAR CHAUDHARI (41 M)

Bruce Protocol ID: 430

STLevel(mm) STSlope(mV/s) Stage: 2

Date: 09-03-2024

Speed: 4 kmph

Exec Time : 0:06:00

Grade: 12%

Stage Time: 03:00

CHR: 152 bpm

HR: 157 bpm

BP: 146/96 mmHg

STLevel(mm) STSlope(mV/s)

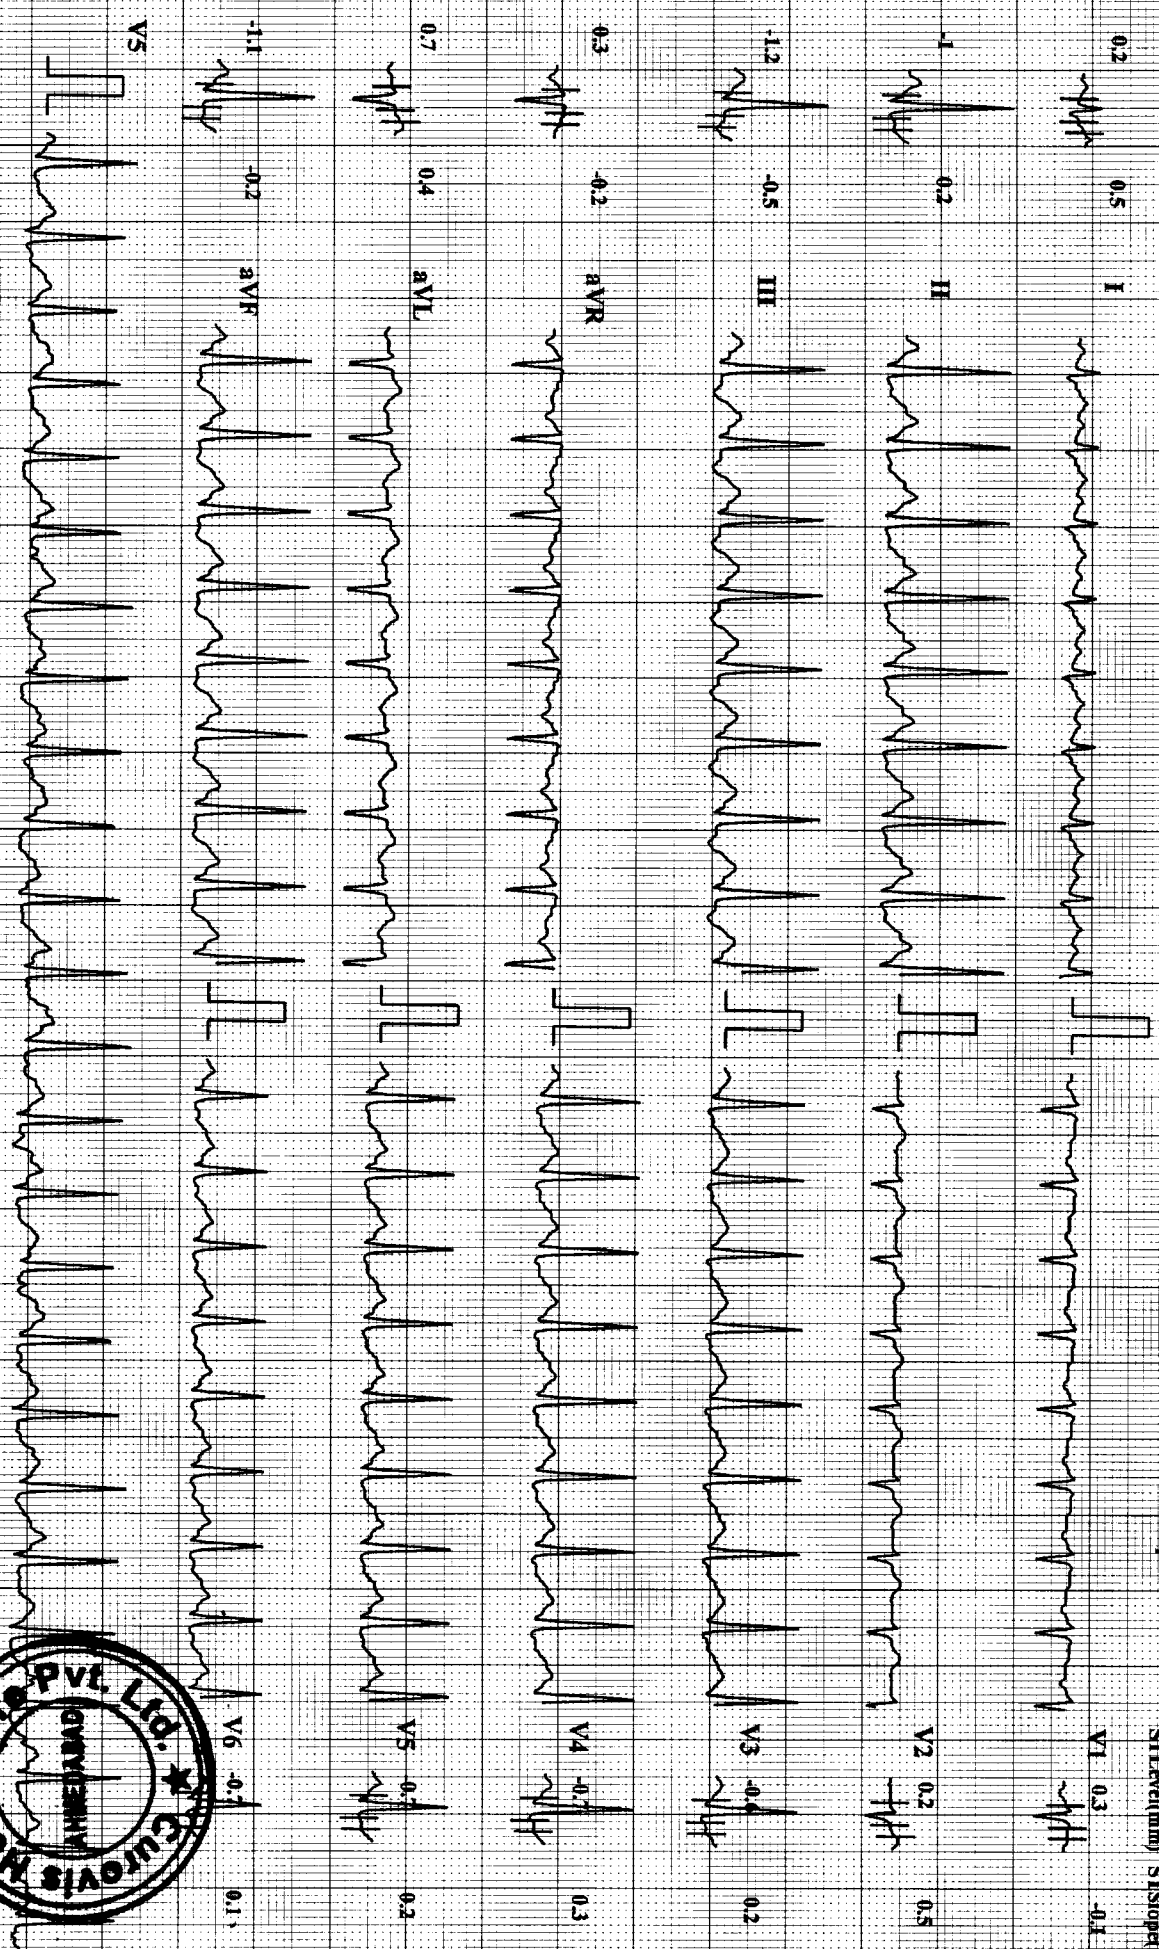



Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 35 Hz Main Filter ON

ISO - R - 60 ms, J - R + 60 ms, Post J = J + 60 ms

Linked Median

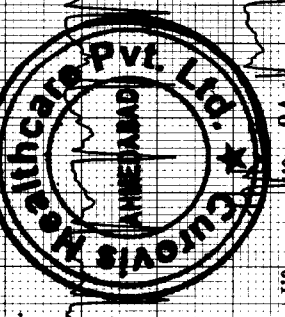

VS

Curovis Healthcare Pvt Ltd, Ahmedabad

TARUNKUMAR CHAUDHARI (41 M)

Bruce Protocol

ID: 430

Date: 09-03-2024

Exec Time : 0:07:03

Stage Time: 01:03

HR: 167 bpm

STLevel(mm) STISlope(mV/s)

Stage Peak Exercise

Speed: 5.5 kmph

Grade: 14%

T.H.R: 152 bpm

BP: 154/104 mmHg
STLevel(mm) STISlope(mV/s)

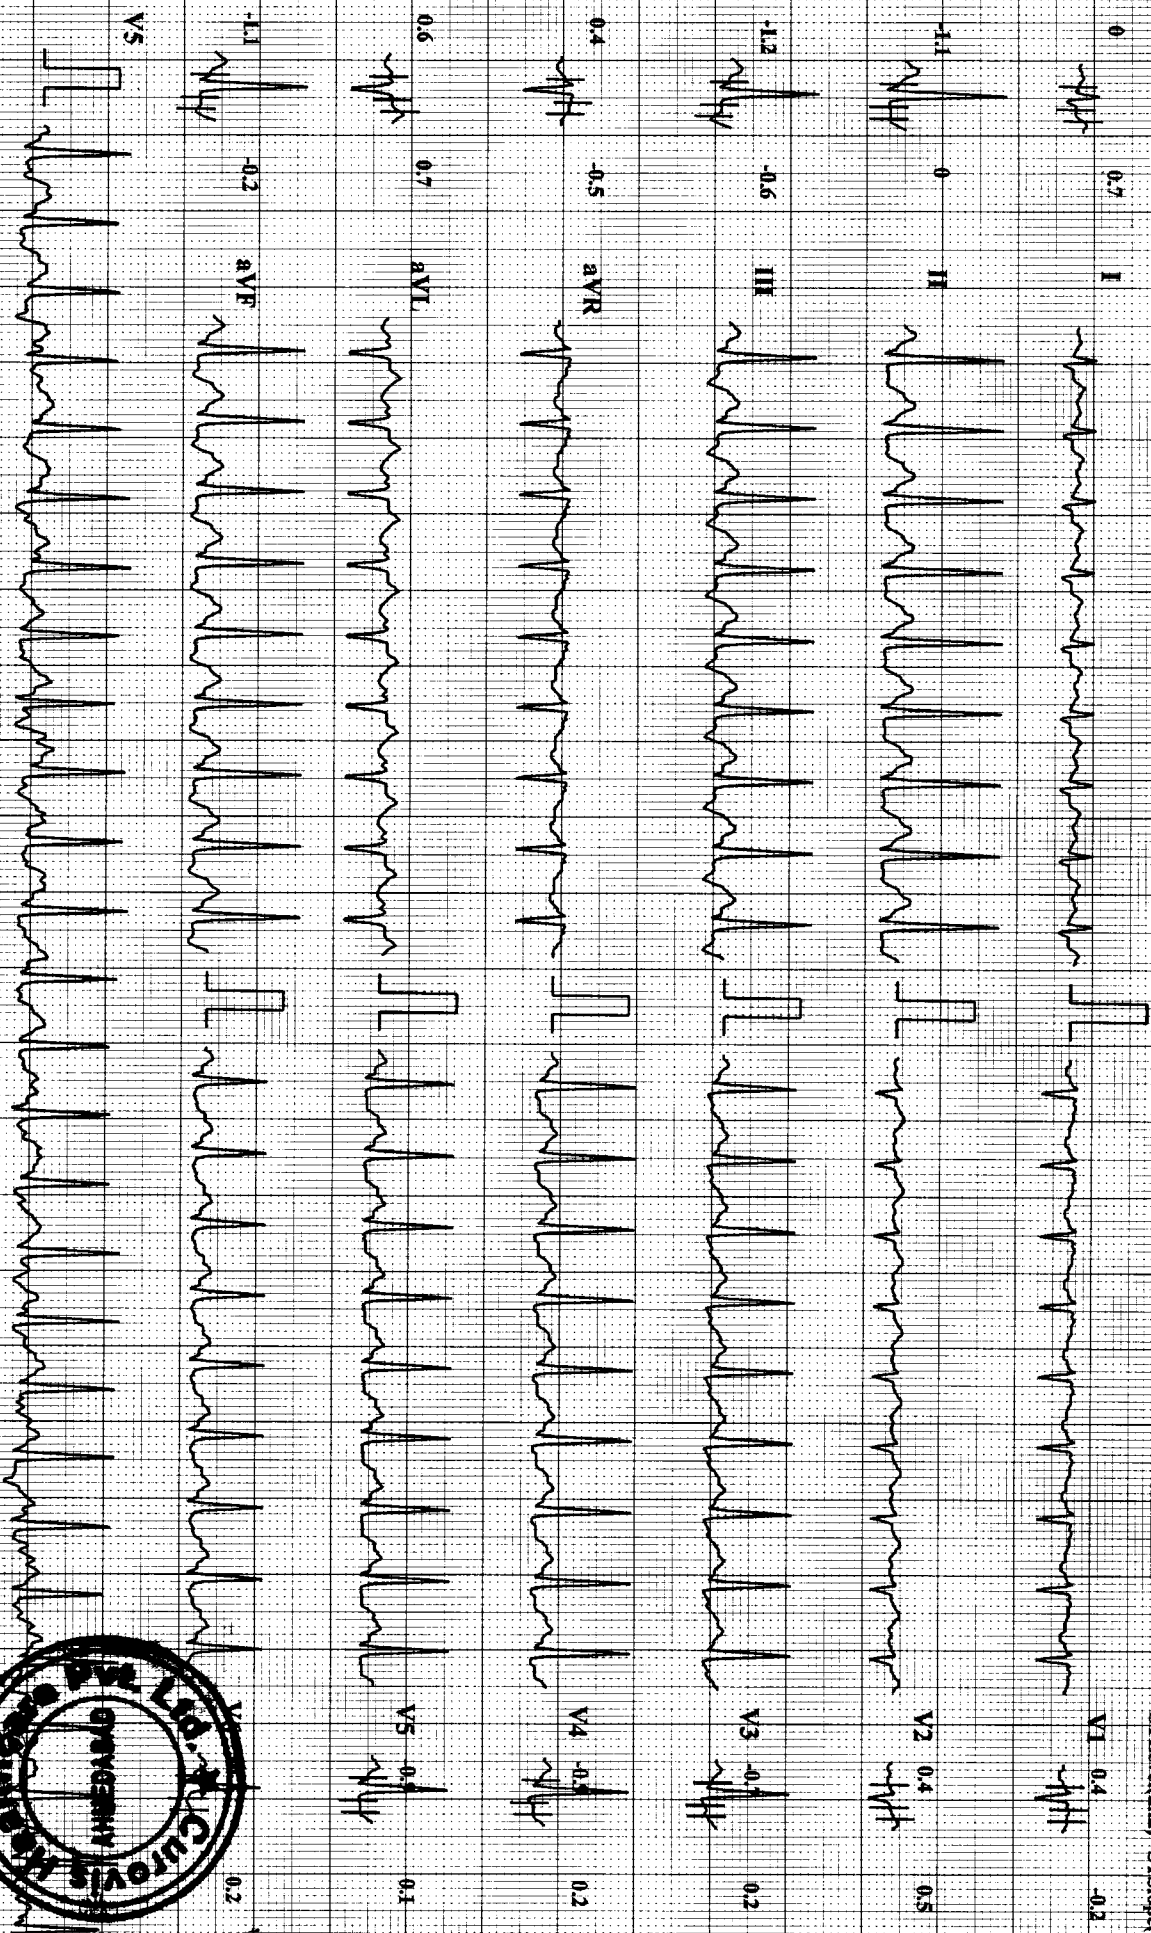



Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 35 Hz Mains Filter: ON

ISO - R - 60 ms, J - R + 60 ms, Post J - J + 60 ms

Linked Median

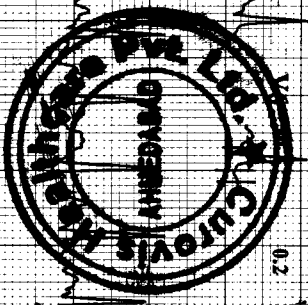

Curovis Healthcare Pvt Ltd, Ahmedabad

TARUNKUMAR CHAUDHARI (41 M)

Brucce Protocol

ID: 430

Date: 09-03-2024

Exec Time: 0:08:03

Stage Time: 01:00

HRR: 149 bpm

STLevel(mm) STISlope(mV/s)

Stage: Recovery/1

Speed: 0 kmph

Grade: 0%

THR: 152 bpm

BP: 143/98 mmHg
STLevel(mm) STISlope(mV/s)

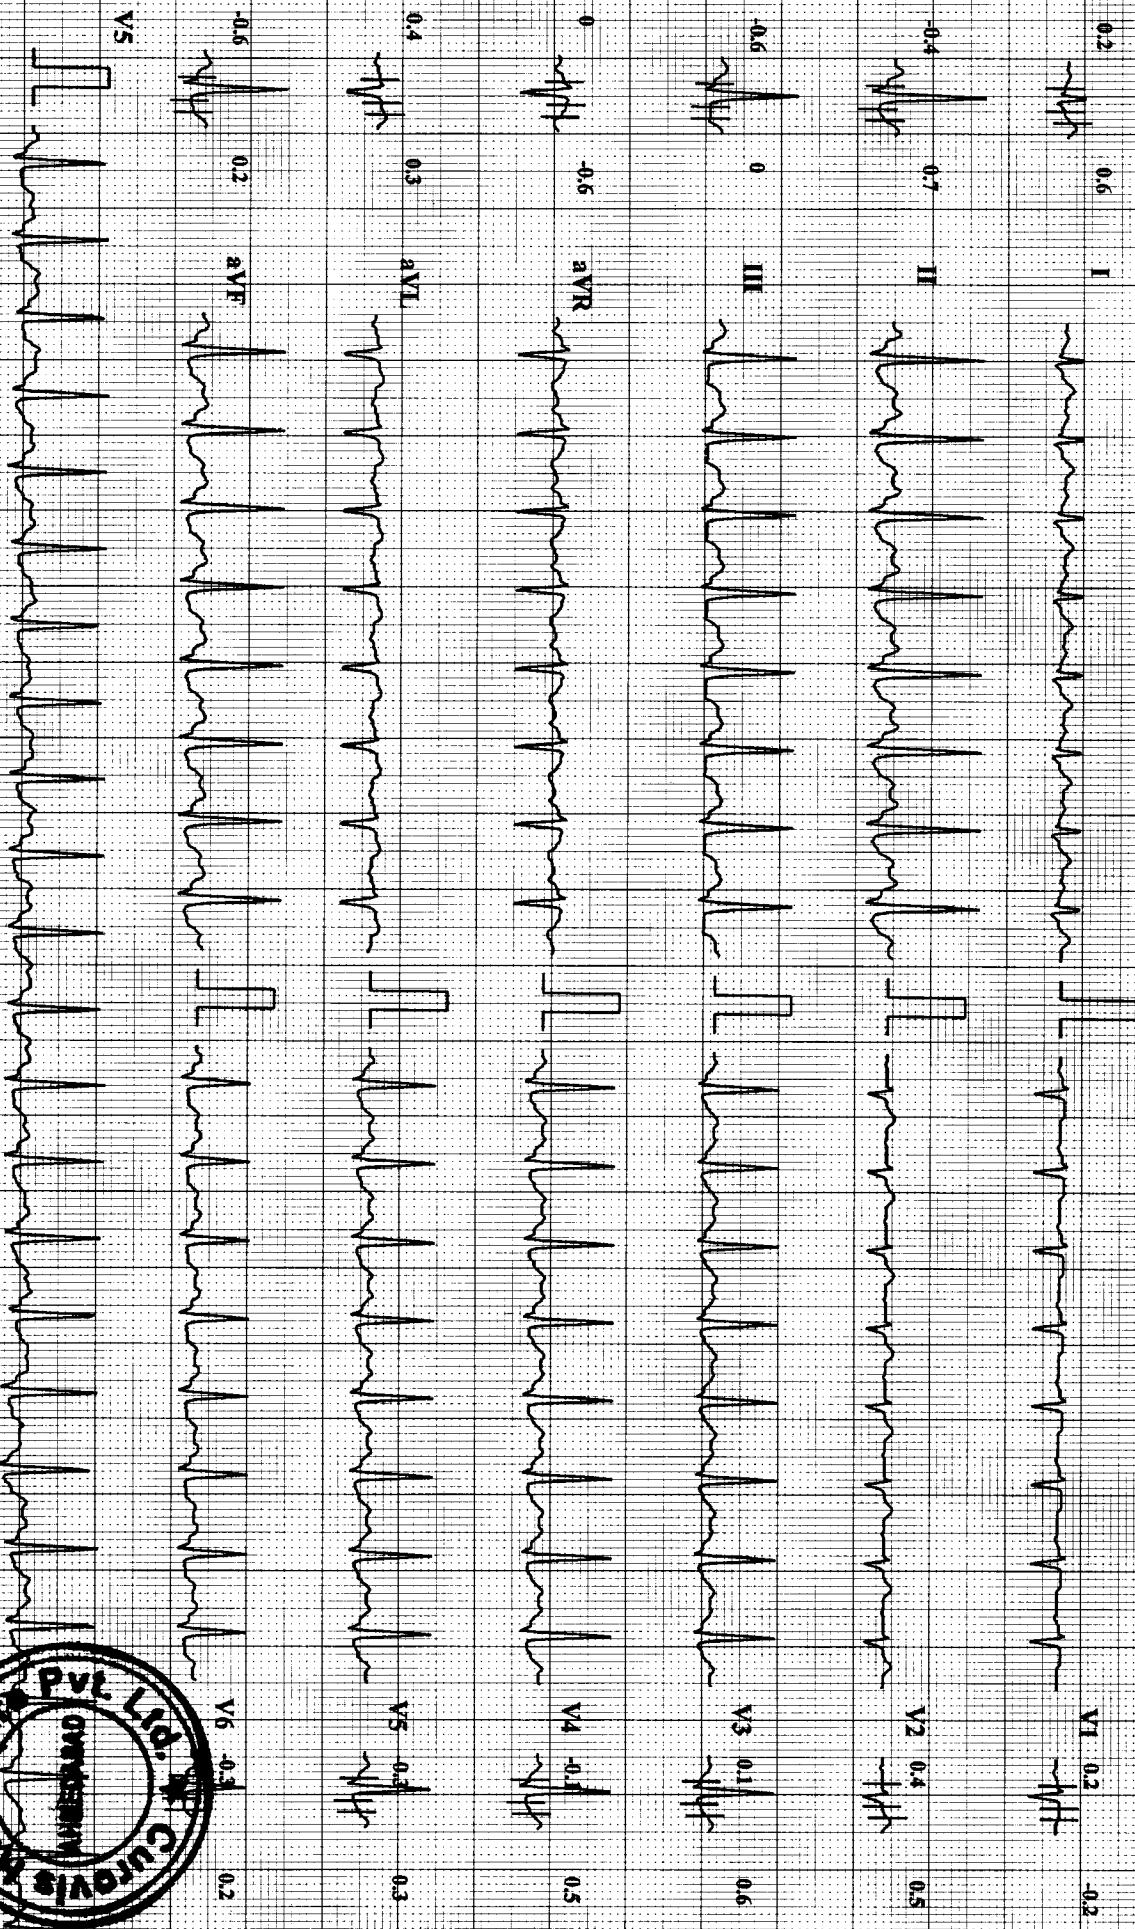


Chart Speed: 25 mm/sec


Amplitude: 10mm/mV

Filter: 35 Hz Main Filter: ON

ISO - R - 60 ms, J - R + 60 ms, Post J - J + 60 ms

Schiller CardioNet CS-10 Version: 3.4

Linked Median

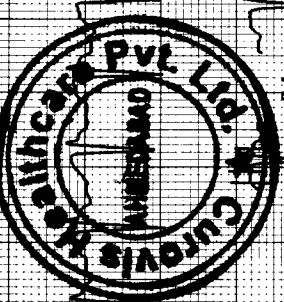

Curovis Healthcare Pvt Ltd, Ahmedabad

TARUNKUMAR CHAUDHARI (41 M)

Brace Protocol ID: 430

STISlope(mV/s) STISlope(V/s)

Strayer: Recovery2

Date: 09-03-2024

Speed: 0 kmph

Exec Time: 0:09:03

Grade: 0%

Stage Time: 01:30

THR: 152 bpm

HRR: 133 bpm

BP: 142/92 mmHg

STISlope(mV/s) STISlope(V/s)

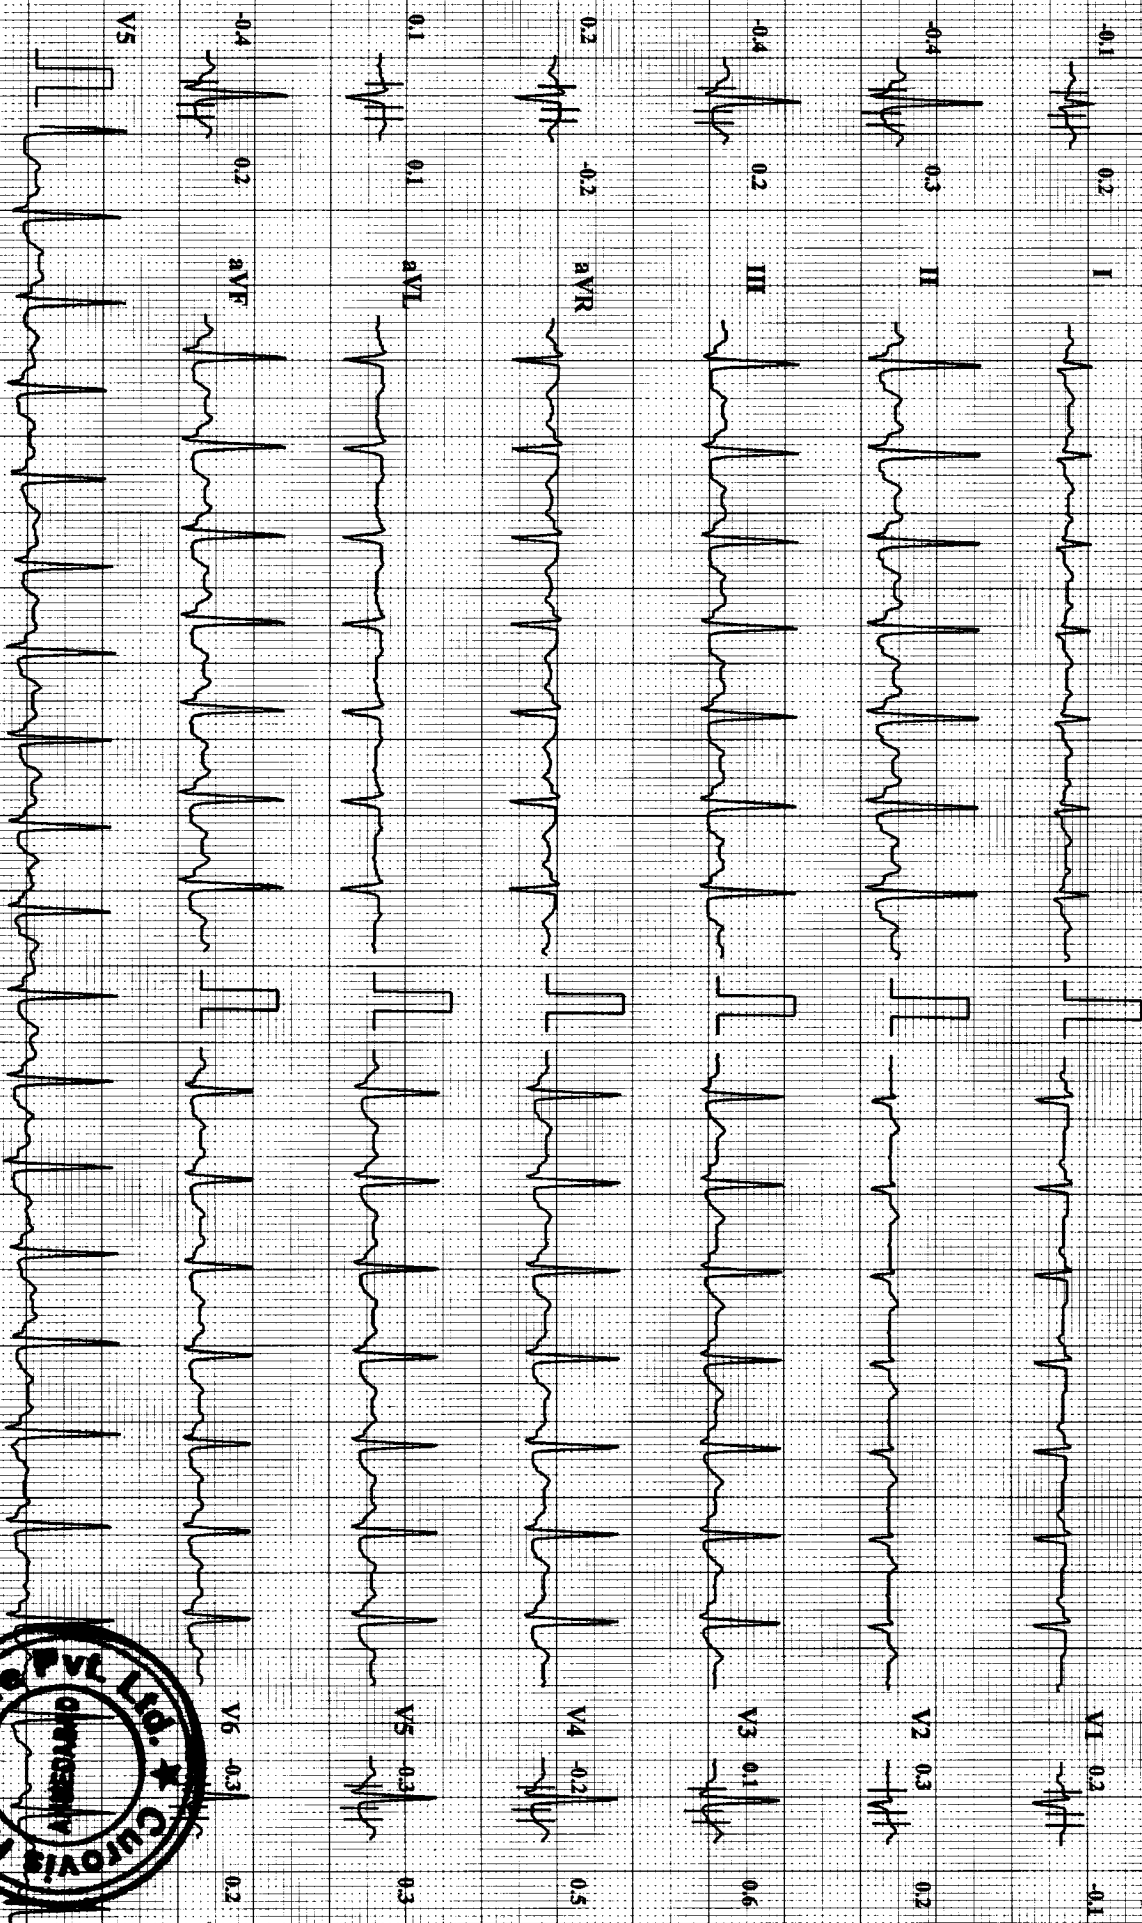


Chart Speed: 25 mm/sec


Amplitude: 10mm/mV

Filter: 35 Hz Mains Filter: ON

ISO - R - 60 ms, f - R + 60 ms, Post f - f # 60 ms

Linked Median

Software Version: 3.4

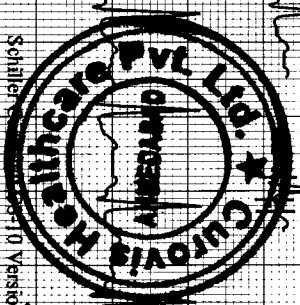

Handwritten signature

Curvix Healthcare Pvt Ltd, Ahmedabad

TARUNKUMAR CHAUDHARI (41 M)

BRUCE Protocol ID: 430

STLevel(mV) STISlope(mV/s)

Stage: Recovery3

Date: 09-03-2024

Speed: 0 kmph

Exec Time: 0:09:26

Grade: 0%

Stage Time: 00:23

T1RR: 152 bpm

HR: 123 bpm

BP: 136/86 mmHg

STLevel(mV) STISlope(mV/s)

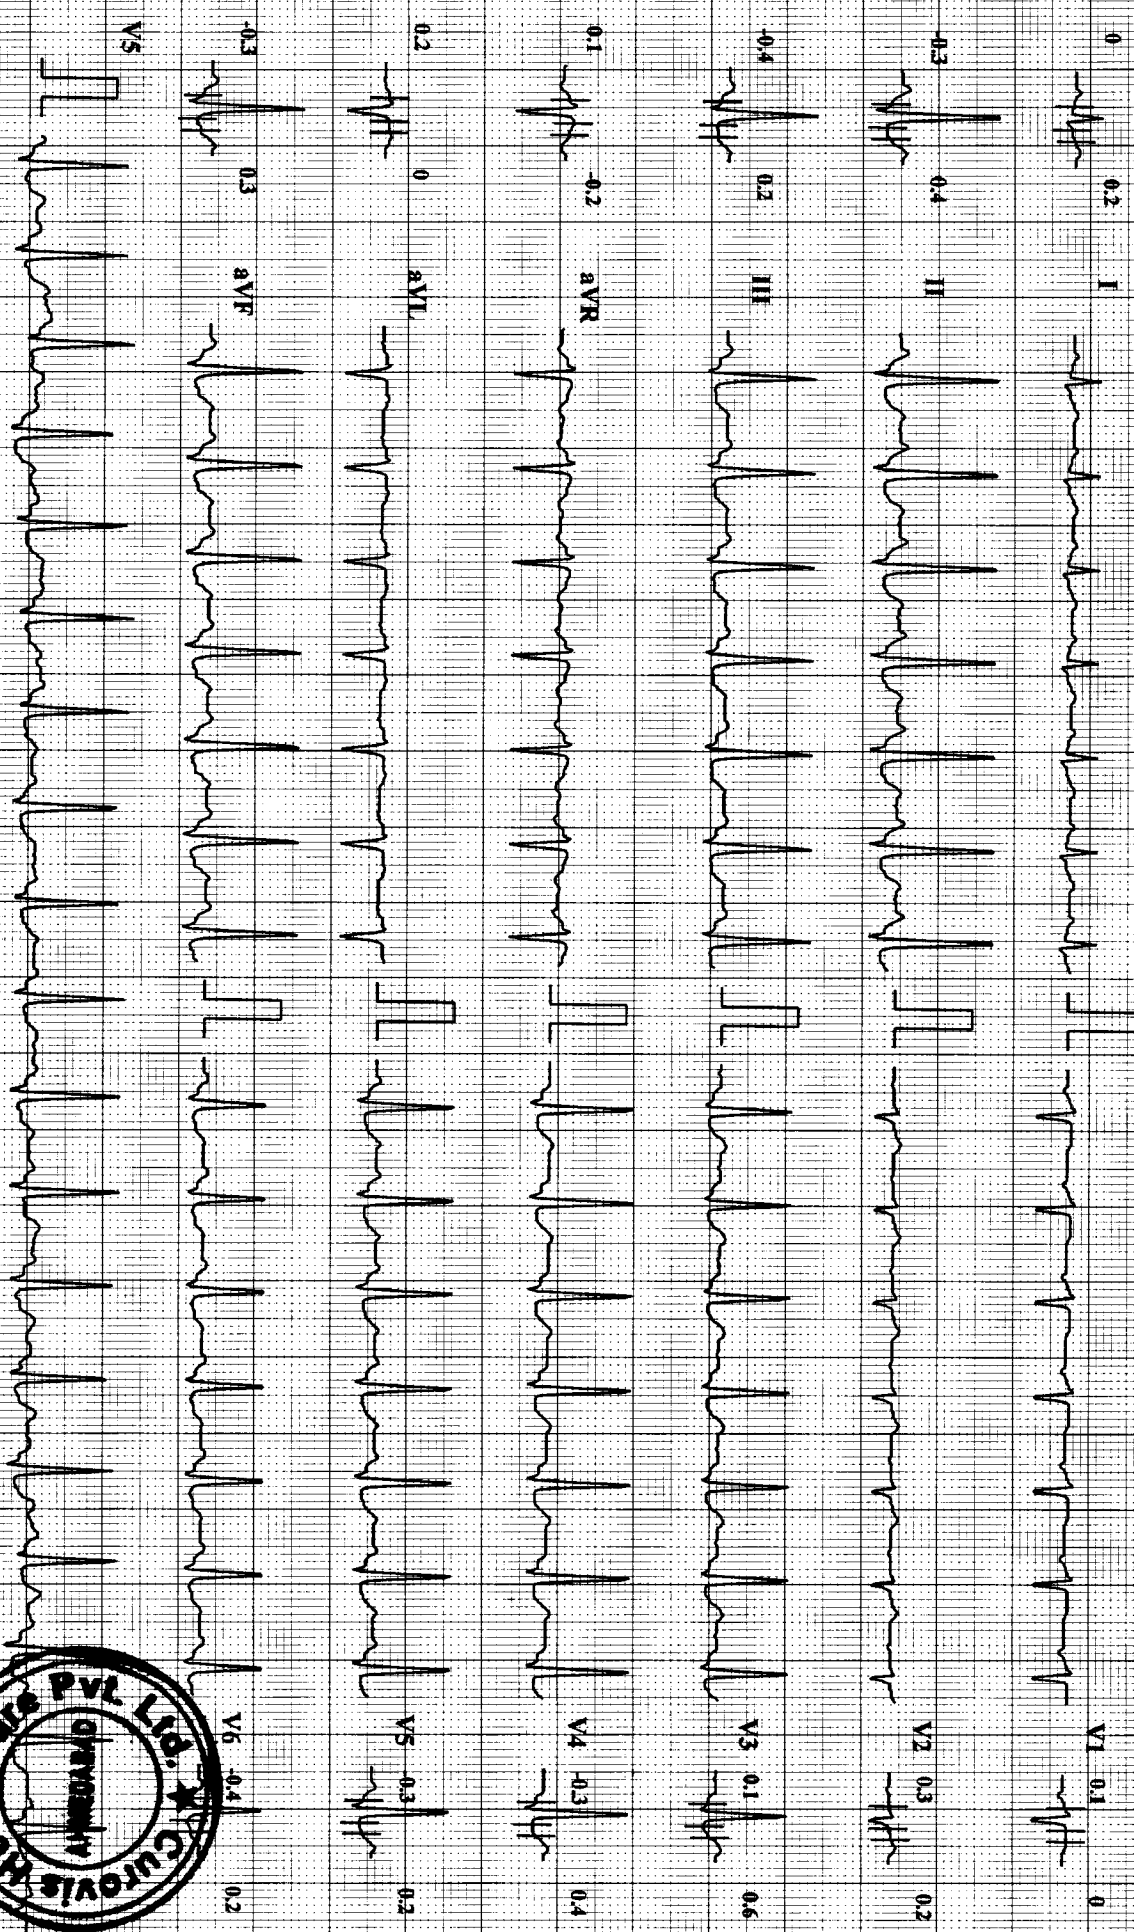



Chart Speed: 25 mm/sec

Amplitude: 10mm/mV

Filter: 35 Hz Mains Filter: ON

ISO - R - 60 ms, J - R + 60 ms, Post J - J + 60 ms

Linked Median

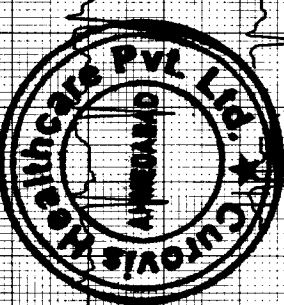

Curovis Healthcare Pvt Ltd, Ahmedabad

Name: TARUNKUMAR CHAUDHARI **Date:** 09-03-2024 **Time:** 13:05

Age: 41 **Gender:** M **Height:** 161 cms **Weight:** 73 Kg **ID:** 430

Clinical History:

Medications:

Test Details:

Protocol: Bruce **Predicted Max HR:** 179 **Target HR:** 152 (85% of Pr. MHR)

Exercise Time: 0:07:03 **Achieved Max HR:** 167 (93% of Pr. MHR)

Max BP: 154/104 **Max BP x HR:** 25718 **Max Mets:** 7.9

Test Termination Criteria: Target HR attained


Protocol Details:

Stage Name	Stage Time	METS	Speed kmph	Grade %	Heart Rate bpm	BP mmHg	RPP	Max ST Level mm	Max ST Slope mV/s
Supine	00:11	1	0	0	102	130/80	13260	0.1 aVL	0.2 II
Standing	00:12	1	0	0	103	130/80	13390	0.2 I	0.2 I
HyperVentilation	00:10	1	0	0	99	130/80	12870	0.2 V3	0.2 II
PreTest	00:10	1	1.6	0	103	130/80	13390	0.3 II	0.3 II
Stage: 1	03:00	4.7	2.7	10	136	138/88	18768	-0.7 III	0.3 I
Stage: 2	03:00	7	4	12	157	146/96	22922	-1.2 III	0.5 I
Peak Exercise	01:03	7.9	5.5	14	167	154/104	25718	-1.2 III	0.7 I
Recovery1	01:00	1	0	0	149	148/98	22052	-0.6 III	0.7 II
Recovery2	01:00	1	0	0	133	142/92	18886	-0.4 II	0.6 V3
Recovery3	00:23	1	0	0	123	136/86	16728	-0.4 III	0.6 V3

Interpretation

The Patient Exercised according to Bruce Protocol for 0:07:03 achieving a work level of 7.9 METS.
 Resting Heart Rate, initially 102 bpm rose to a max. heart rate of 167bpm (93% of Predicted Maximum Heart Rate).
 Resting Blood Pressure of 130/80 mmHg, rose to a maximum Blood Pressure of 154/104 mmHg.

Negative Stress Test.



Dr. Jay Soni
 M.D. (General Medicine)
 Reg. No. G-23899

Ref. Doctor: Curovis Health checkup

Doctor: Curovis Health checkup

SCHILLER
 The Art of Diagnostics

(Summary Report edited by User)
 Cardioit CS-10 Version:3.4